

The Connecticut General Assembly

Legislative Commissioners' Office

Edwin J. Maley, Jr.
Commissioner
Leonard A. Fasano
Commissioner

Nicholas Bombace
Director



Legislative Office Building
Suite 5500
Hartford, Connecticut
06106-1591
(860) 240-8410
fax (860) 240-8414
e-mail: lco@cga.ct.gov

Memorandum

To: Senator Sujata Gadkar-Wilcox
Representative Christie Carpino
Senator John Kissel
Representative Mary Welander

From: Sarah O'Connor, Angela Rehm, Marie Grady and Michael Tellerico

Date: December 16, 2025

Subject: Proposed 2026 Connecticut State Fire Safety Code

The **2026 Connecticut State Fire Safety Code** was submitted on December 2, 2025 under section 29-292a of the general statutes, which permits the State Fire Marshal and the Codes and Standards Committee within the Department of Administrative Services to use a process for its adoption that is different than the process required for the adoption of regulations under chapter 54 of the general statutes, the Uniform Administrative Procedure Act.

Attached are the pages of the proposed **2026 Connecticut State Fire Safety Code**. There are handwritten comments on the pages of the proposed code referenced in the table below that make recommendations for corrections or seek further clarification.

In addition, substantive concerns, additional technical corrections and formatting issues are noted below.

Substantive Concerns:

1. On page 10, in Section 107.1, the proposed code specifies that permits for temporary structures, uses, equipment and systems, "shall be limited as to time of service, but shall not be permitted for more than 180 days." It is not clear what is meant by "time of service" and "permitted" in this context. If the intent is to indicate that permits shall expire at the fire code official's discretion, but not later than 180 days from issuance, this should be stated. If another meaning is contemplated, the language should be clarified to reflect such meaning.

Additionally, the proposed code indicates that the fire code official may grant extensions for "demonstrated cause." The proposed code is silent as to whether reference by a permit applicant to *any* condition or event resulting in the need for an extension would qualify as a demonstration of cause, or whether a determination of whether cause has been demonstrated is left to the discretion of the fire code official. Finally, the proposed code is silent as to the duration of permit extensions, and the number of extensions a permit applicant may seek. Although these provisions appear in the International Fire Code, they should be amended to provide guidance to the regulated community.

2. On page 97, in section 1104.27.1 (7.), the proposed code states, "Smoke detection shall be used in all spaces except where not appropriate due to environmental conditions." It is unclear what is meant by "environmental conditions", who assesses the presence of such conditions and whether, if such conditions are determined to be present, the local fire marshal must approve of any plan not to use smoke detectors in such spaces.

Additional Comments:

LCO Comments	Page Numbers
Technical corrections	1-15, 17-37, 39, 42-54, 56, 58-60, 62, 65-129, 131-153, 157-164
Seek clarification	2, 7, 12, 15, 19, 23, 25, 27, 35, 43, 51, 52, 59, 98, 107, 114, 120-122, 136, 137, 153, 158, 159

The following technical corrections and formatting issues were not noted in handwritten comments, but should be addressed and incorporated in the proposed code:

1. Throughout the proposed code, defined terms are frequently, but not always, italicized. Each defined term appearing in the proposed code should be italicized, for consistency.
2. Chapter and section titles appear throughout the proposed code, but not consistently. For example, on page 8, "SECTION 105 PERMITS" appears, but on page 9, there is no reference to

"SECTION 106 CONSTRUCTION DOCUMENTS" prior to the insertion of the provisions of Section 106. Chapter and section titles should be inserted throughout the proposed regulation, for consistency. Alternatively, only those chapter and section titles that are being added or amended should appear, for consistency.

3. The phrase "of this code" should be inserted, where appropriate, throughout the proposed code, for accuracy. For example, on page 10, in Sections 106.2.2.1 and 106.2.2.2, "of this code" should be inserted after "Chapter 80".

4. There is not a consistently utilized format for numbers, particularly metric measurements, within the proposed code. See, e.g., Section 118.2, "1,524"; Section 304.3.5, "3048"; and Section 503.1.1, "45 720". Similarly, the format utilized for fractions is not consistent. See, e.g., Section S106.3.4.1, "8¼"; and Section 1011.5.2, Exception 5, "8-1/4". Numbers and fractions appearing in the proposed code should conform to a standard format, for consistency.

5. National Fire Protection Association standards are cited throughout the proposed code, and titles for the referenced standards are inconsistently included in such citations. Citations to National Fire Protection Association standards should be made uniform throughout the proposed code by either inserting titles where they do not appear, or removing titles that do appear, for consistency.

Recommendation:

	Approval in whole with technical corrections with deletions with substitute pages
	Disapproval in whole or in part
X	Rejection without prejudice

Authorizing Statute:

Sec. 29-292a. Procedure for adoption and amendment of Fire Safety Code. (a) For the purposes of this section, "proposed code" means a proposal by the State Fire Marshal and the Codes and Standards Committee for a new Fire Safety Code or for a change in, addition to or repeal of any provision of the Fire Safety Code.

(b) Notwithstanding the provisions of chapter 54, the adoption of the Fire Safety Code and any amendments thereto shall not be required to comply with the provisions of chapter 54, except as provided in this section.

(c) Prior to the adoption of the Fire Safety Code and any amendments thereto, the State Fire Marshal shall (1) post any proposed code, a statement of purpose for which the proposed code is proposed, a fiscal note associated with compliance with the proposed code prepared pursuant to section 4-168, and a regulatory flexibility analysis prepared pursuant to section 4-168a on the Internet web site of the Department of Administrative Services, (2) give notice electronically to the joint standing committee of the General Assembly having cognizance of matters relating to public safety and security, (3) give notice to any person who has requested the State Fire Marshal for advance notice of the proposed code adoption proceedings, (4) provide for a public comment period of forty-five days following the posting of such proposed code, fiscal note and regulatory flexibility analysis, and (5) hold a public hearing on the proposed code not less than twenty nor more than thirty-five days after such posting.

(d) After the close of the public comment period, the State Fire Marshal and the Codes and Standards Committee shall respond to each written and oral comment respecting the proposed code received during the public comment period and at the public hearing. Such response shall include any change made to the proposed code if applicable, and the rationale for such change. The State Fire Marshal shall post such response on the Internet web site of the Department of Administrative Services not later than thirty days after the close of the public comment period.

(e) The State Fire Marshal and the Codes and Standards Committee shall create and maintain a code-making record for each proposed code, submit such code-making record electronically to the standing legislative regulation review committee and the joint standing committee of the General Assembly having cognizance of matters relating to public safety and security, and post such code-making record on the Internet web site of the Department of Administrative Services. Such code-making record shall include, but

need not be limited to: (1) The final wording of the proposed code in a format consistent with a nationally recognized model building code, (2) the fiscal note prepared pursuant to subsection (c) of this section, (3) the regulatory flexibility analysis prepared pursuant to subsection (c) of this section, (4) all written and oral comments received during the public comment period, and (5) the response to such comments prepared pursuant to subsection (d) of this section.

(f) The standing legislative regulation review committee shall have not more than forty-five days from the date the code-making record is submitted to the committee pursuant to subsection (e) of this section to convene a meeting to approve, disapprove or reject without prejudice the proposed code, in whole or in part. If the proposed code is withdrawn, the State Fire Marshal shall resubmit the proposed code and the committee shall have not more than forty-five days from the date of such resubmittal to convene a meeting to approve, disapprove or reject without prejudice the resubmitted proposed code. If the committee notifies the State Fire Marshal in writing that it is waiving its right to convene a meeting or does not act on a proposed code or a resubmitted proposed code, as the case may be, within such forty-five-day period, the proposed code or resubmitted proposed code shall be deemed to be approved by the committee.

(g) If the committee disapproves a proposed code, in whole or in part, the committee shall notify the State Fire Marshal of the disapproval and the reasons for the disapproval. The State Fire Marshal shall not take any action to implement such disapproved code, except that the State Fire Marshal may submit a substantively new proposed code in accordance with the provisions of this section, provided the General Assembly may reverse such disapproval in accordance with the provisions of section 4-171.

(h) If the committee rejects a proposed code without prejudice, in whole or in part, the committee shall notify the State Fire Marshal of the reasons for the rejection and the State Fire Marshal shall resubmit the proposed code in revised form to the committee not later than thirty days after the date of rejection without prejudice. Each resubmission of the proposed code under this subsection shall include a summary of any revisions to the proposed code. The committee shall have not more than forty-five days after the receipt of the resubmittal to review and take action on such resubmitted proposed code in the same manner as provided in subsection (f) of this section.

(i) The Fire Safety Code or any amendment thereto approved or deemed approved by the committee pursuant to subsection (f) of this section is effective and enforceable

against any person or party upon its posting on the Internet web site of the Department of Administrative Services, except that: (1) If a later date is required by statute or specified in the code, the later date is the effective date, and (2) a code may not be effective before the effective date of the public act requiring or permitting the code. Such posting shall include a statement by the State Fire Marshal certifying that the electronic copy of the code is a true and accurate copy of the code approved or deemed approved in accordance with subsection (f) of this section. The electronic copy of the Fire Safety Code posted on the Internet web site of the Department of Administrative Services shall be the official version for all purposes, including all legal and administrative proceedings.

(j) No provision of the Fire Safety Code or any amendment thereto adopted after May 31, 2016, is valid unless adopted in substantial compliance with the requirements of this section. A proceeding to contest any provision of the code on the ground of noncompliance with the requirements of this section shall be commenced within two years from the effective date of the code.

(k) The State Fire Marshal shall advise the public concerning how to obtain a copy of the Fire Safety Code and any amendments thereto.

2026 Connecticut State Fire Safety Code

Michelle Gilman
Commissioner

Lauri Volkert
State Fire Marshal


DRAFT

For Legislative Regulations Review Committee

December 2, 2025



CONNECTICUT
Administrative Services

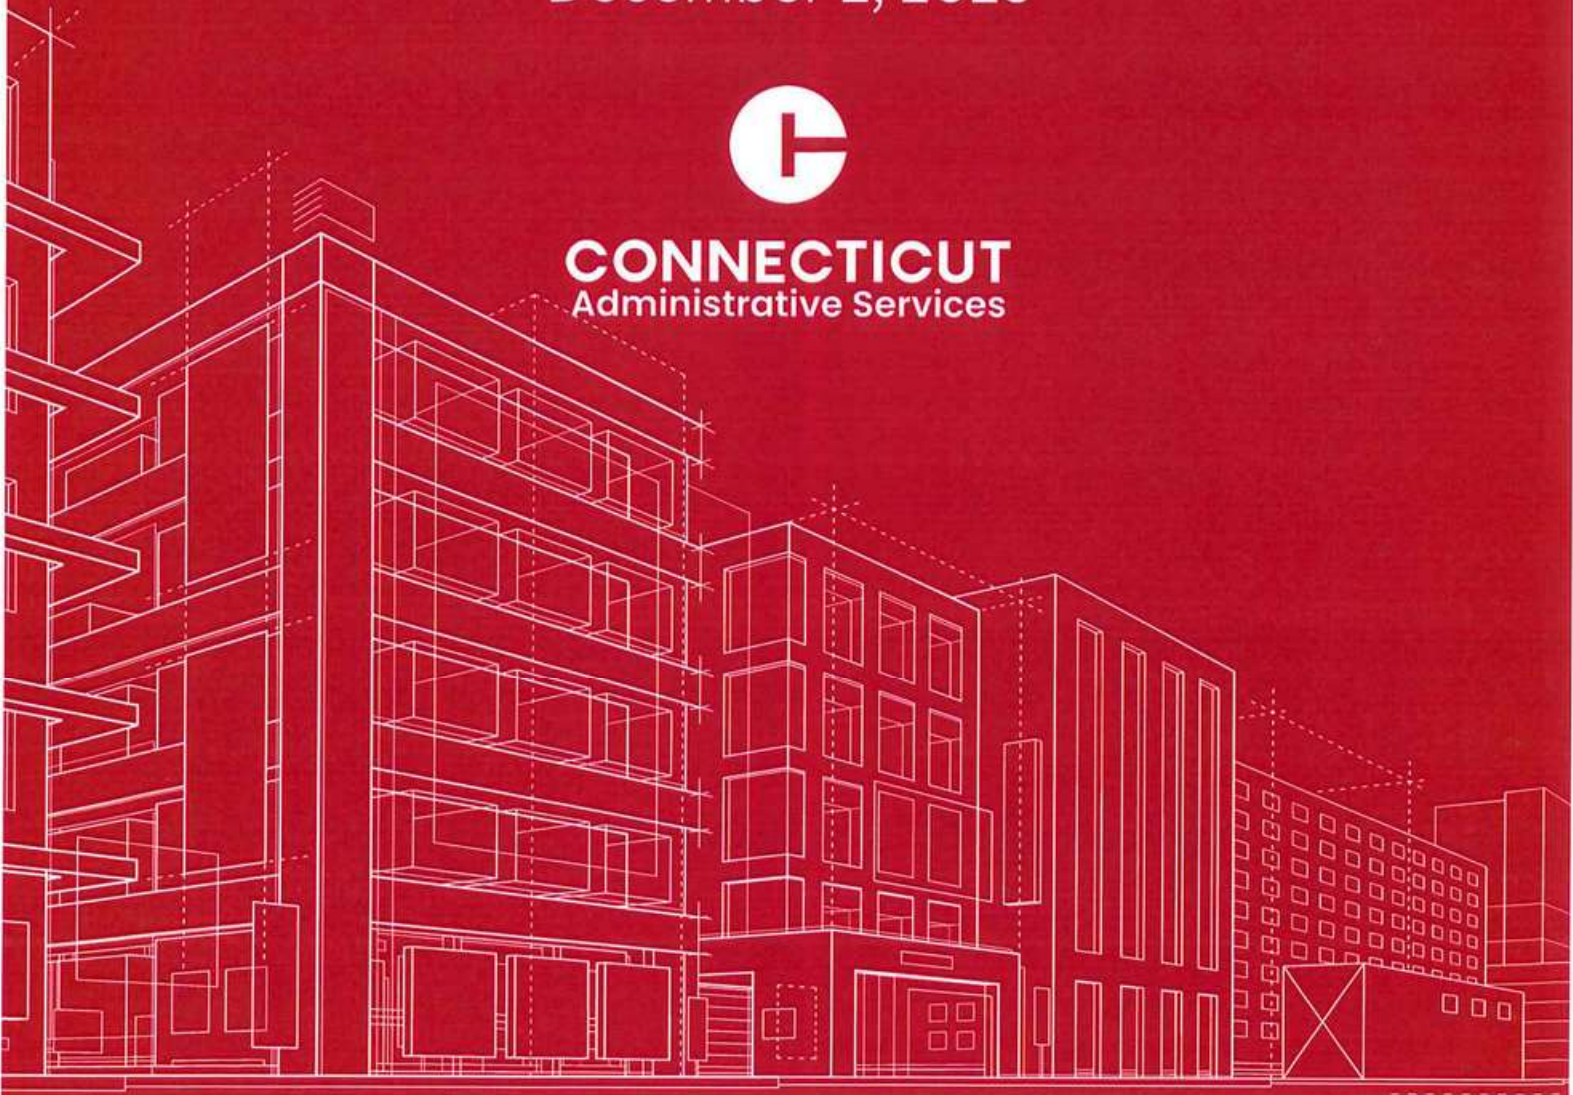

CONNECTICUT STATE FIRE SAFETY CODE

Amendments to the 2024 International Fire Code

CHAPTER 1 SCOPE & ADMINISTRATION

SECTION 101 SCOPE & GENERAL REQUIREMENTS

(Amd) **101.1 Title.** The Connecticut State Fire Safety Code and the adopted standards, as amended, shall be known as the Connecticut State Fire Safety Code, hereinafter referred to as "the code" or "this code".

(Add) **101.1.1 Adopted standard.** The following standard, including selected appendices, is hereby adopted as amended ~~herein~~ ^{in this code} as the Connecticut State Fire Safety Code:

International Fire Code® of the International Code Council, Inc., 2024 edition except as amended, altered or deleted and by the addition of certain provisions as indicated in this code.

The following appendices are adopted as part of this code: Appendices A, D, I, J, N, O, and S as amended.

The following appendices are permitted to be used as guidance: Appendices B, E, F, G, and H as amended.

International Fire Code® is available from the International Code Council, Inc., 4051 W. Flossmoor Road, Country Club Hills, IL 60478-5795; 1-888-422-7233; www.iccsafe.org.

(Add) **101.1.1.1 Classification of occupancy and use.** Both the *fire code official* and the *building official* shall jointly determine the classification of occupancy and use. The provisions for the classification of occupancy and use are found in Section 116, *Occupancy Classification and Use*.

(Add) **101.1.2 Connecticut amendment conventions.** The model codes adopted in 101.1.1 are amended to meet the needs of the state of Connecticut as identified by the following conventions: ^{Section}

(a) A section or subsection in the Connecticut Amendments preceded by "Amd" indicates the substitution of the provision.

(b) A section or subsection in the Connecticut Amendments preceded by "Del" indicates the deletion of the provision.

(c) A section or subsection in the Connecticut Amendments preceded by "Add" indicates the addition of the provision.

(Add) **101.1.3** ^{Catchline} Nothing in this code shall be construed to prohibit a better type of building construction, an additional *means of egress*, or an otherwise safer condition than that specified by the minimum requirements of this code.

(Amd) **101.2 Scope** ^{bold} This code establishes regulations affecting or relating to structures, premises and safeguards regarding all of the following:

1. The hazard of fire and explosion arising from the storage, handling or use of structures, materials or devices.
2. Conditions hazardous to life, property or public welfare in the occupancy of structures or premises.
3. Fire hazards in the structure or on the premises from occupancy or operation.
4. Matters related to the construction, extension, repair, alteration or removal of fire protection systems.
5. Conditions affecting the safety of firefighters and emergency responders during emergency operations.

Exception: Detached *one- and two-family dwellings* and multiple single-family dwellings (townhouses) not more than three stories above grade plane in height with a separate *means of egress* and ~~their~~ ^{any} accessory structures not more than three stories above grade plane in height, shall comply with the *International Residential Code* portion of the Connecticut State Building Code.

SECTION 102 APPLICABILITY

(Amd) **102.1 Application.** This code shall apply to all buildings, structures, or portions thereof, or facilities, as outlined below, except as specifically provided for in the wording of a section. See Figure 102.1 for the Connecticut State Fire Safety Code Application Flow Chart.


(a) For initial building permit applications made on or after the effective date of this code, this code shall apply to:

- (1) The design and construction of new buildings, structures, facilities or portions thereof.
 - (2) Buildings, structures, or portions thereof; ^{or} conditions undergoing repairs, alterations, and additions.
 - (3) Buildings, structures, or portions thereof; ^{that are} undergoing a change of occupancy or use as specified in "Change of occupancy or use" in ^{Section} 102.3 of this code.
 - (4) For *existing* occupancies subject to an abatement order for violations of Chapter 11 of this code or the Connecticut State Fire Prevention Code, only new fire protection systems, and electrical and mechanical system work.
- (b) Chapter 11 of this code shall apply to *existing* buildings, structures, facilities, or portions thereof, or conditions prior to the adoption of this code. See Figure 102.1(b) for *existing* building application flow chart.


Notes:

Pursuant to section 29-291a of the Connecticut General Statutes, the Connecticut State Fire Prevention Code shall be applicable for oil burners, flammable and combustible liquids, gas equipment and piping, liquefied gas and liquefied natural gas, hazardous chemicals, and processes and activities that occur in the building or structure that are not used to support the building components services or systems.

(Add) **Figure 102.1 Connecticut State Fire Safety Code Application Flow Chart.**

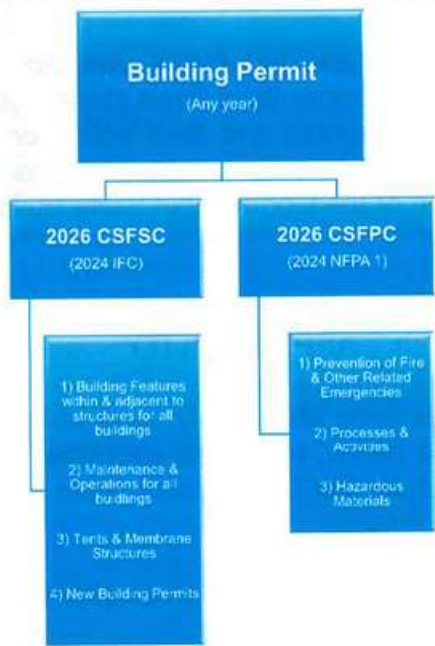

(Add) **Figure 102.1 (b) Existing Building Application Flow Chart.**

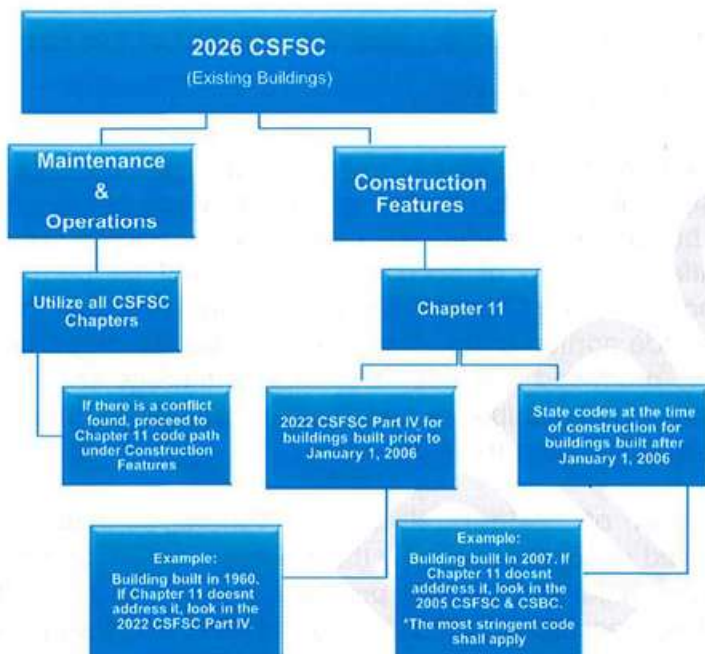

(Add) **102.1.1 Alternative compliance.** Any *existing* building or portion thereof, or structure, evaluated and determined by the *fire code official* in conjunction with the *building official* to be in compliance with the *International Existing Building Code* portion of the Connecticut State Building Code, shall be deemed to be in compliance with this code. Regardless of any wording in the *International Existing Building Code* portion of the Connecticut State Building Code, the *means of egress* in *existing* buildings shall meet the requirements of Chapter 11 of this code for the proposed occupancy.

(Add) **102.1.2 Grandstands and bleachers.** The Connecticut State Fire Safety Code shall not apply to portable grandstands or bleachers providing seating for fewer than 100 persons located outside of a building.

(Add) **102.1.3 Federal agency.** The Connecticut State Fire Safety Code shall not apply to any federal agency performing construction or operating on federally owned land or on leased land totally under the control of the federal government.

(Add) **102.1.4 Public service companies.** This code shall not apply to the installation, alteration or repair of generation, transmission, distribution, metering or other related equipment that is under the ownership or control of a public service company as defined in section 16-1 of the Connecticut General Statutes.

(Amd) **102.2 Administrative, operational and maintenance provisions**.^{bold} The administrative, operational and maintenance provisions of this code shall be administered as provided in Chapter 541 of the Connecticut General Statutes and shall apply to:

1. Conditions and operations arising after the adoption of this code.
2. Existing conditions and operations.

(Amd) **102.3 Change of use or occupancy**. In any building, structure, or portion thereof, whether or not a physical *alteration* is needed, a change made in the use or occupancy that would place the building or structure in a different division of the same group or occupancy or in a different group of occupancies shall not be permitted unless the structure, building or portion thereof conforms with the requirements of this code and the *International Building Code* portion of the Connecticut State Building Code that apply to new construction for the proposed new use. A change of tenants or ownership shall not be construed to be a change of occupancy classification where the nature of the use and assigned occupancy classification remain the same. ^{if}

(Amd) **102.5 Application of residential code**. Where structures are designed, constructed, and occupied in accordance with the *International Residential Code* portion of the Connecticut State Building Code the provisions of this code shall only apply to detached private dwellings occupied by one or two families and townhouses (not more than three stories above grade plane in height with a separate *means of egress* and their accessory structures not more than three stories above grade plane in height) with respect to smoke alarms and carbon monoxide detectors as specified in the Connecticut State Building Code and subject to the specific inspection criteria for smoke detection and warning equipment of section 29-305 of the Connecticut General Statutes. Tents and membrane structures erected on property of detached private dwellings occupied by one or two families and townhouses shall not be regulated by the Connecticut State Fire Safety Code. ^{any}

(Del) **102.6 Historic buildings**. Delete section.

(Amd) **102.8 Subjects not regulated by this code**. Pursuant to section 29-291a of the Connecticut General Statutes, the Connecticut State Fire Prevention Code shall be applicable for oil burners, flammable and combustible liquids, gas equipment and piping, liquefied gas and liquefied natural gas, hazardous chemicals, and processes and activities that occur in the building or structure that are not used to support the building components services or systems.

(Amd) **102.9 Matters not provided for**. See section 29-306 of the Connecticut General Statutes.

(Add) **102.13 Building Code**. Any references within the body of this code to the *International Building Code* shall be considered references to the 2024 *International Building Code* portion of the Connecticut State Building Code. Any references to the

International Building Code portion of the Connecticut State Building Code shall also be considered requirements of the Connecticut State Fire Safety Code.

(Add) **102.13.1** ^{Catchline} Any references ~~within the body~~ ⁱⁿ of this code to the *International Residential Code* shall be considered references to the 2024 *International Residential Code* portion of the Connecticut State Building Code.

(Add) **102.13.2** ^{Catchline} Any references ~~within the body~~ ⁱⁿ of this code to the *International Existing Building Code* shall be considered references to the 2024 *International Existing Building Code* portion of the Connecticut State Building Code.

(Add) **102.14 Gas.** The *International Fuel Gas Code* is not adopted by this code. Any references to the *International Fuel Gas Code* ~~within the body~~ ⁱⁿ of this code shall be considered references to requirements of NFPA 54, National Fuel Gas Code; NFPA 2, Hydrogen Technologies Code; and NFPA 58, Liquefied Petroleum Gas Code.

(Add) **102.15 Electrical.** Any references ~~within the body~~ ⁱⁿ of this code to the *National Electrical Code* shall be considered references to the 2023 NFPA 70, *National Electrical Code* portion of the Connecticut State Building Code.

(Add) **102.16 Mechanical Code.** Any references ~~within the body~~ ⁱⁿ of this code to the *International Mechanical Code* shall be considered references to the 2024 *International Mechanical Code* portion of the Connecticut State Building Code.

**(Del) SECTION 103
CODE COMPLIANCE AGENCY**

Delete section in its entirety.

^{bold}
**(Amd) SECTION 104
DUTIES AND POWERS OF THE FIRE CODE OFFICIAL (FIRE MARSHAL)**

(Amd) **104.1 Authority having jurisdiction.**

^{not ital.} (a) For the purposes of this code and the standards adopted by reference in this code, the authority having jurisdiction (AHJ) shall mean the State Fire Marshal regarding the proper administration, application, interpretation and modification of the requirements contained within this code.

(b) The local fire marshal is the authority having jurisdiction (AHJ) of their respective jurisdiction who shall make the initial determination concerning compliance with this code, except as expressly provided in the wording of a section

Subsections

or in subsection (a) and (c) of this section. A decision of a local fire marshal may be appealed to the State Fire Marshal as provided in subsection (d) of this section.

(c) The State Fire Marshal shall make determinations concerning compliance with this code on state-owned property.

(d) A decision of the local fire marshal or State Fire Marshal may be appealed to the Codes and Standards Committee in accordance with section 29-309 of the Connecticut General Statutes.

Note: The terms "fire code official" and "fire marshal" shall have the same meaning.

Consider deleting this note as unnecessary - it is duplicative of "local fire marshal" and "State Fire Marshal" defined term for "fire code official".

(Amd) 104.2 Determination of compliance. The fire code official shall have the authority to determine compliance with this code and to adopt policies and procedures in order to clarify the application of its provisions. Such policies and procedures:

- 1. Shall be in compliance with the intent and purpose of this code.
- 2. Shall not have the effect of waiving requirements specifically provided for in this code.

(Del) 104.2.2. Technical Assistance. Delete section and subsections in its entirety.

(Amd) 104.2.3 Alternative materials, design and methods of construction and equipment. The provisions of this code are not intended to prevent the installation of any material or to prohibit any design or method of construction not specifically prescribed by this code, provided that any such alternative is not specifically prohibited by this code and has been approved.

(Amd) 104.2.3.5 Tests. Tests conducted to demonstrate equivalency in support of an alternative material, design or method of construction application shall be of a scale that is sufficient to predict performance of the end use configuration. Tests shall be performed by a party an approved agency acceptable to the fire code official. Removed for clarity - already included in defined term.

(Amd) 104.2.3.5.1 Fire tests. Tests conducted to demonstrate equivalent fire safety in support of an alternative material, design or method of construction application shall be of a scale that is sufficient to predict fire safety performance of the end use configuration. Tests shall be performed by a party an approved agency acceptable to the fire code official.

(Del) 104.2.3.6.2 Other reports. Delete section in its entirety.

(Del) 104.2.4 Modifications. Delete section in its entirety.

(Add) 104.2.4 Modifications, variations, or exemptions. In accordance with section 29-296 of the Connecticut General Statutes, the State Fire Marshal may modify the requirements of the Connecticut State Fire Safety Code where the State Fire Marshal

deems strict compliance would entail practical difficulty or unnecessary hardship, or is otherwise adjudged unwarranted, provided any such variation or exemption or *approved* equivalent or alternative compliance shall, in the opinion of the State Fire Marshal, secure the public safety.

(Amd) **104.4 Inspections and right of entry.** See section 29-305 of the Connecticut General Statutes.

(Del) **104.4.1 Warrant.** Delete section.

(Del) **104.7 Official records.** Delete section in its entirety.

(Add) **104.7 Official records.** See section 29-305 of the Connecticut General Statutes.

(Del) **104.8 Liability.** Delete section in its entirety.

(Del) **104.10 Fire investigations.** Delete section in its entirety.

(Del) **104.11 Authority at fires and other emergencies.** Delete section in its entirety.

SECTION 105 PERMITS

(Amd) **105.1 General.** A municipality or fire district, by ordinance, may establish requirements and a fee schedule for construction document review, *permits*, certificates, notices, approvals, and orders pertaining to fire control and fire hazards pursuant to Section 105 of this code. The *fire code official* shall issue such *permits*, certificates, notices, approvals and orders. *Permits* shall be issued in accordance with Sections 105.1.1 to 105.6.25 inclusive.

(Amd) **105.1.1 Permits required.** A property owner or the owner's authorized agent who intends to conduct an operation or business regulated by this code, shall first make application to the *fire code official* and obtain the required *permit*.

(Amd) **105.1.2 Types of permits.** The *permits* prescribed in Section 105.1.1 shall be operational *permits*. An operational *permit* allows the applicant to have an occupancy or conduct an operation or business for which a *permit* is required by Section 105.5 for either:

- a) A prescribed period as specified by the *fire code official*, or
- b) Until such *permit* is renewed or revoked.

(Del) **105.1.4 Emergency repairs.** Delete section.

(Del) **105.1.5 Repairs.** Delete section.

Justify text on this page

(Del) **105.1.6 Annual permit.** Delete section in its entirety.

(Del) **105.2.3 Time limitation of application.** Delete section.

(Del) **105.2.4 Action on application.** Delete section.

(Del) **105.3 Conditions of a permit.** Delete section in its entirety.

(Amd) **105.5 Required operational permits.** The *fire code official* is authorized to issue operational *permits* for the operations set forth in Sections 105.5.2 to 105.5.57, inclusive, where specified by ordinance.

(Amd) **105.5.16 Explosives.** See sections 29-343 to 29-355a, inclusive, of the Connecticut General Statutes.

(Del) **105.5.34 Mobile food preparation vehicles.** Delete section.

(Amd) **105.5.36 Open burning.** See section 23-48 of the Connecticut General Statutes.

(Amd) **105.5.44 Pyrotechnic special effects material.** See sections 29-356 to 29-366, inclusive, of the Connecticut General Statutes.

(Add) **105.5.58 Additional operational permits.** In addition to the requirements of Sections 105.5.2 to 105.5.57, inclusive, *permits* to operate an occupancy for a use for a building shall be required. ^{for}

(Del) **105.6 Required construction permits.** Delete section in its entirety.

(Amd) **106.1 Plan submittal and review.** Detailed plans and specifications for new buildings, structures and additions, renovations or alterations to *existing* structures, equipment, and systems regulated by this code shall be submitted by the applicant to the *fire code official* as applicable to demonstrate compliance with section 29-263 of the Connecticut General Statutes and this code. Pursuant to the requirements of section 29-263 of the Connecticut General Statutes, such documents shall be accompanied by evidence of licensure.

(Add) **106.1.1 Means of egress.** The *construction documents* shall show in sufficient detail the location, construction, size, and character of all portions of the *means of egress* including the path of the *exit discharge* to the *public way* in compliance with the provisions of this code. In other than occupancies in Groups R-2, R-3, and I-1, the *construction documents* shall designate the number of occupants to be accommodated on every floor, and in all rooms and spaces. For those occupancies utilizing the Small I-2 provisions, the *construction documents* shall designate the locations of the client areas and beds.

Changed from "shop" to "working" for statutory consistency.

(Add) **106.2.2.1 Fire sprinkler system ^{working}shop drawings.** ^{Working}Shop drawings for fire sprinkler system(s) shall be submitted to indicate conformance with this code and the construction documents and shall be *approved* prior to the start of system installation. ^{working}Shop drawings shall contain all information as required by the referenced installation standards in Chapter 80. Pursuant to section 29-263a of the Connecticut General Statutes, such ~~documents~~ shall be accompanied by evidence of licensure as a fire sprinkler system layout technician in accordance with section 20-304a of the Connecticut General Statutes, or a professional engineer licensed in accordance with chapter 391 of the Connecticut General Statutes.

(Add) **106.2.2.2 Fire alarm system ^{working}shop drawings.** ^{working}Shop drawings for fire alarm system(s) shall be submitted to indicate conformance with this code and the construction documents and shall be *approved* prior to the start of system installation. ^{working}Shop drawings shall contain all information as required by the referenced installation standards in Chapter 80. Pursuant to section 29-263a of the Connecticut General Statutes, such ~~documents~~ shall be accompanied by evidence of licensure, if applicable, in accordance with section 20-304a of the Connecticut General Statutes, as a professional engineer licensed in accordance with chapter 391 of the Connecticut General Statutes.

(Add) **106.2.5 Building permit approval.** The *fire code official* shall provide to the *building official* certification in writing prior to the issuance of a building *permit* that the construction documents for any building, structure or use subject to the requirements of this code are in substantial compliance with the requirements of this code. Because of the 30-day time limit imposed by section 29-263 of the Connecticut General Statutes, the *fire code official* shall notify the *building official* whether there is substantial compliance within that time period.

(Amd) **107.1 General.** The *fire code official* is authorized to issue ^{un-bold}a *permit* for temporary structures, uses, equipment ^{and} or systems as required in **Sections 105.5**. Such *permits* shall be limited as to time of service, but shall not be permitted for more than 180 days. The *fire code official* is authorized to grant extensions for demonstrated cause.

(Del) **107.3 Temporary service utilities.** Delete section.

(Del) **108.3 Permit valuations.** Delete section.

(Del) **108.4 Work commencing before permit issuance.** Delete section.

(Del) **108.5 Related fees.** Delete section.

(Amd) **109.1 Inspection authority.** Each *fire code official* or their respective designees, shall conduct inspections as prescribed in section 29-305 of the Connecticut General Statutes, of buildings and facilities regulated by this code within their jurisdictions. Each *fire code official* or their respective designees, may conduct inspections as often as may

Justify text on this page.

be necessary during the construction of new *buildings*, structures or additions, or processes, and during the course of renovations, alterations or modernizations for the purpose of satisfying themselves that all work is in accordance with the *approved* plans, specifications and this code.

(Amd) **109.2 Inspections.**

- (a) Each *fire code official* or their respective designees, shall conduct inspections as prescribed in section 29-305 of the Connecticut General Statutes, of buildings and facilities regulated by the Connecticut State Fire Safety Code within their jurisdictions.
- (b) Each *fire code official* or their respective designees, may conduct inspections as often as may be necessary during the construction of new *buildings*, structures or additions, and during the course of renovations, alterations or modernizations for the purpose of satisfying themselves that all work is in accordance with the *approved* plans, specifications and this code.
- (c) The minimum requirements for the frequency of inspections as prescribed in section 29-305 of the Connecticut General Statutes shall be as follows:
 - (1) Annual inspections for the occupancy classifications all R Residential, A-1, A-2, E, H-1, all Institutional including small I-2, M selling consumer fireworks [sparklers and fountains] (1.4G), H-3 containing consumer fireworks [sparklers and fountains] (1.4G).
 - (2) Inspections every two years for the occupancy classifications A-3, H-2, B-Medical, B-College, Ambulatory Health Care.
 - (3) Inspections every three years for occupancy classifications B, H-3, M, S-1, A-4, A-5.
 - (4) Inspections every four years for the occupancy classifications F-1, F-2, H-4, H-5, S-2, U.

Note: See Table 109.2(c) Frequency of Inspections. Occupancy Classifications IFC vs NFPA.

bold

(Add) Table 109.2(c) Frequency of Inspections. Occupancy Classifications IFC vs NFPA.

NFPA Occupancy Classification	ICC Occupancy Classification	Frequency
Assembly	A-1	Annual
	A-2	Annual
	A-3	Every 2 years
	A-4	Every 3 years
	A-5	Every 3 years

Ambulatory Health Care	Business (B)	Every 2 years
Educational	Educational (E)	Annual
Daycare	Educational (E)	Annual
	1-4	Annual
	R-3	Annual ^{ab}
Healthcare	I-2	Annual
Detention & Correctional	I-3	Annual
Residential Board & Care	I-1	Annual
	R-3	Annual
	R-4	Annual
One- & Two-Family Dwelling ^S	R-3	NR ^{ab}
Lodging or Rooming Houses or Bed & Breakfasts ^{and?}	R-1	Annual
	R-3	Annual
Hotels	R-1	Annual
	R-2	Annual
Apartments & Dormitories	R-2	Annual
Mercantile	Mercantile (M)	Every 3 years
	M - Selling Fireworks (1.4g)	Annual
Business	Business (B)	Every 3 years
	B - Medical	Every 2 years
	B - College	Every 2 years
	R-3 - In Home	NR ^{ab}
Industrial	F-1	Every 4 years
	F-2	Every 4 years
	R-3 - In Home	NR ^{ab}
Storage	S-1	Every 3 years
	S-2	Every 4 years
No separate occupancy, assigned to applicable occupancy	H-1	Annual
	H-2	Every 2 years
	H-3	Every 3 years
	H-3 - Selling Fireworks (1.4g)	Annual
	H-4	Every 4 years
	H-5	Every 4 years
No separate occupancy, assigned to applicable occupancy [✓]	Utility (U) - Miscellaneous	Every 4 years

em dashes should be en dashes for consistency

NR – Not required

a. If an R-3 occupancy is located in a mixed-use building, inspection is required annually.

b. Buildings that contain a maximum of two *dwelling units* and no other occupancies are specifically exempted by section 29-292 of the Connecticut General Statutes from the jurisdiction of this code, except for the specific smoke detection and warning equipment in accordance with section 29-305 of the Connecticut General Statutes.

Changes for statutory consistency

Private dwellings occupied by one or two families

requirements

with respect to

(Add) **109.2.3** ^{Catchline} The *fire code official* shall ~~be permitted to~~ conduct inspections and witness testing remotely and shall be in accordance with the policies and procedures indicated in Section 104.2.

(Amd) **109.3 Concealed work.** It shall be the duty of the *permit* applicant, or the applicant's authorized agent, to cause the work to remain visible and able to be accessed for inspection purposes. Where any installation subject to inspection prior to use is covered or concealed without having first been inspected, the *fire code official* shall have the authority to require that such work be made visible and able to be accessed for inspection. Neither the *fire code official* nor the jurisdiction shall be liable for expense entailed in the removal or replacement of any material required to allow inspection.

(Add) **109.5 Acceptance of building official reports.** The *fire code official* may accept the reports of the *building official* concerning a code compliance review or inspection in lieu of conducting the review or inspection himself or herself.

(Add) **109.6 Certificate of occupancy approval.** The *fire code official* shall provide to the *building official* certification in writing that prior to the occupancy of any building, structure or use subject to the requirements of this code, such *building*, structure or use is in substantial compliance with the requirements of this code.

(Add) **109.6.1 Notification of inspection results.** Notification as to the passage or failure, in whole or in part, of any required inspection shall be made in writing by the *fire code official* or his/her duly authorized representative and shall be left at the job site, electronically sent, or delivered to the building *permit* holder or their authorized agent. Any violations cited must contain the Connecticut State Fire Safety Code under which the permit was issued, the model code referenced, and the applicable section. It shall be the duty of the building *permit* holder to ascertain the results of the required inspection.

SECTION 110 MAINTENANCE

(Add) **110.5.1 Order to vacate.** An order to vacate all or part of a *building* may be issued by a local fire marshal or local police officer in accordance with section 29-306 of the Connecticut General Statutes, when there exists in a *building* a risk of death or injury from (1) blocked, insufficient or impeded egress, (2) failure to maintain or the shutting off of

any fire protection or fire warning system required by the ^{Connecticut State} Fire Safety Code or State Fire Prevention Code, (3) the storage of any flammable or explosive material without a ^{Connecticut} permit or in quantities in excess of any allowable limits pursuant to a permit, (4) the use of any firework or pyrotechnic device without a permit, or (5) exceeding the occupancy limit established by the State Fire Marshal or a local fire marshal. The penalty for the failure to remedy or abate such hazards shall be as described in section 29-291c of the Connecticut General Statutes as appropriate.

(Add) **110.6.1 Order to vacate.** An order to vacate all or part of a *building* may be issued by a local fire marshal or local police officer in accordance with section 29-306 of the Connecticut General Statutes, when there exists in a *building* a risk of death or injury from (1) blocked, insufficient or impeded egress, (2) failure to maintain or the shutting off of any fire protection or fire warning system required by the Fire Safety Code or State Fire Prevention Code, (3) the storage of any flammable or explosive material without a permit or in quantities in excess of any allowable limits pursuant to a permit, (4) the use of any firework or pyrotechnic device without a permit, or (5) exceeding the occupancy limit established by the State Fire Marshal or a local fire marshal. The penalty for the failure to remedy or abate such hazards shall be as described in section 29-291c of the Connecticut General Statutes as appropriate.

Identical to
Sec. 110.5.1

(Del) SECTION 111 SERVICE UTILITIES

(Del) 111.1 **Authority to disconnect service utilities.** Delete section.

bold

(Amd) **SECTION 112 APPEAL OF THE DECISION OF THE LOCAL OR STATE FIRE MARSHAL**

(Amd) **112.1 Appeal of the decision of the local or state fire marshal.** A decision of the *fire code official* may be appealed to the Codes and Standards Committee in accordance with section 29-309 of the Connecticut General Statutes.

(Del) **112.2 Limitations on authority.** Delete section.

(Del) **112.3 Qualifications.** Delete section.

(Del) **112.4 Administration.** Delete section.

(Amd) **SECTION 113 ABATEMENT OF FIRE HAZARDS VIOLATIONS OF THIS CODE AND**

(Amd) **113.1 Abatement of fire hazards.** The *fire code official* shall order conditions contrary to the provisions of this code to be remedied in accordance with section 29-306 of the Connecticut General Statutes.

(Add) **113.1.1 Unauthorized tampering.** Signs, tags or seals posted or affixed by the *fire code official* shall not be mutilated, destroyed or tampered with, or removed, without authorization from the *fire code official*.

(Del) **113.2 Owner/occupant responsibility.** Delete section.

(Del) **113.3 Notice of violation.** Delete section in its entirety.

(Amd) **113.4 Enforcement by citation.** Pursuant to section 29-291c of the Connecticut General Statutes, Section 113 of this code lists those sections of this code for which a citation may be issued.

un-bold

(Add) 113.4.1 Enforcement by citation. The following chapters or sections of this code may be enforced through the use of the citation process pursuant to section 29-291c of the Connecticut General Statutes. *described in*

Chapter/Section	Subject Matter
Section 105 See CSFPC, Section 1.13	Operating without a permit required by local ordinance
Section 806.1	Provisions for cut Christmas trees
Section 901.6	Failure to maintain or the shutting off of any fire protection or fire warning system required by the Connecticut State Fire Safety Code or the Connecticut State Fire Prevention Code
Section 1003.6	Blocked, insufficient or impeded egress
Section 3301	Safeguards during building construction, alteration, and demolition operations
Section 1004.9	Exceeding the established occupancy limit- assembly occupancies
Section 5609.1	Storage and display of sparklers and fountains
Chapter 35 See CSFPC, Chapter 41	Hot work operations

Should contents of this table be un-bolded for consistency w/ other tables? (See, eg, p. 11-12.)

Section 606.3	Procedures for use and maintenance of commercial cooking equipment
Section 308.2 See also CSFPC Sections 20.1.5.3 and 65.4	Flame effects before an audience
Chapter 56	Sale, handling, and storage of fireworks, sparklers, and fountains
See CSFPC, Section 69.3.13.1	Patio heaters
Section 6106 See CSFPC, Section 69.4.1.3	Filling, evacuation, or transporting a liquified petroleum (LP) cylinder or tank without the authorization of the owner of the tank

**(Del) SECTION 114
STOP WORK ORDER**

(Del) **114.1 Authority.** Delete section.

(Del) **114.2 Issuance.** Delete section.

(Del) **114.3 Emergencies.** Delete section.

(Del) **114.4 Failure to comply.** Delete section.

**SECTION 115
UNSAFE STRUCTURES OR EQUIPMENT**

(Amd) **115.1 General.** See sections 7-313e and 29-306 of the Connecticut General Statutes.

(Del) **115.1.1 Unsafe conditions.** Delete section.

(Del) **115.1.2 Structural hazards.** Delete section.

(Del) **115.2 Evacuation.** Delete section.

(Del) **115.3 Record.** Delete section.

(Del) **115.4 Notice.** Delete section.

(Del) **115.5 Method of service.** Delete section in its entirety.

(Del) **115.6 Restoration or abatement.** Delete section in its entirety.

(Del) **115.7 Summary abatement.** Delete section in its entirety.

**(Add) SECTION 116
OCCUPANCY CLASSIFICATION AND USE**

(Add) **116.1 Occupancy classification and use.** The requirements of Chapter 3 of the *International Building Code* portion of the Connecticut State Building Code shall also be considered requirements of this code and known as the *International Building Code*, Chapter 3 portion of the Connecticut State Fire Safety Code.

**(Add) SECTION 117
SPECIAL DETAILED REQUIREMENTS BASED UPON OCCUPANCY AND USE**

(Add) **117.1 Special detailed requirements based upon occupancy and use.** The requirements of Chapter 4 of the *International Building Code* portion of the Connecticut State Building Code shall also be considered requirements of this code and known as the *International Building Code*, Chapter 4 portion of the Connecticut State Fire Safety Code.

**(Add) SECTION 118
GROUP R-1 BED AND BREAKFAST ESTABLISHMENTS**

(Add) **118.1 Kitchens in Group R-1 bed and breakfast establishments.** Kitchens in *Group R-1 bed and breakfast establishments* shall be separated by ½-hour rated fire separation assemblies.

Exceptions:

1. If the kitchen is protected by a limited area sprinkler system.
2. If the kitchen is equipped with a listed residential range top extinguisher unit or an approved commercial kitchen hood with a listed, *approved* automatic fire suppression system.
3. The structural members supporting the rated assemblies shall not be required to be fire-resistance rated.

(Add) **118.2 Group R-1 bed and breakfast establishments.** The height limitation for existing unsprinklered *buildings* of Type VB construction undergoing a *change of occupancy* from detached *one- and two-family dwellings* to *Group R-1 bed and breakfast establishments* shall be increased by 5 feet (1,524 mm) from the value in Table 504.3 of the *International Building Code* portion of the Connecticut State Building Code and one *story* from the value in Table 504.4 of the *International Building Code* portion of the Connecticut State Building Code where 1-hour *fire-resistance* rated assemblies are constructed between the second and third floors. The structural members supporting the rated assemblies shall not be required to be *fire-resistance* rated.

(Add) SECTION 119 INCIDENTAL USES

(Add) **119.1 Incidental uses.** The requirements of Section 509 of the *International Building Code* portion of the Connecticut State Building Code shall ~~also~~ be considered requirements of this code and known as the *International Building Code*, Section 509 portion of the Connecticut State Fire Safety Code.

Exception: Incidental uses within and serving a *dwelling unit* are not required to comply with this section.

(Add) SECTION 120 MIXED USE AND OCCUPANCY

(Add) **120.1 Mixed Use and Occupancy.** The requirements of Section 508 of the *International Building Code* portion of the Connecticut State Building Code, except as noted below, shall ~~also~~ be considered requirements of this code and known as the *International Building Code*, Section 508 portion of the Connecticut State Fire Safety Code.

Exceptions:

1. Sections 508.5.9 and 508.5.11 addressing Accessibility and Plumbing Facilities respectively, are not adopted as part of the Connecticut State Fire Safety Code.
2. Any references to allowable building height, allowable building area, or the number of stories allowed in a *building* in Section 508 are not adopted as part of the Connecticut State Fire Safety Code and shall be determined by the *building official*.

(Add) SECTION 121
TRIPLEX AND QUADRUPLEX HOMES

(Add) **121.1 Triplex and Quadruplex homes.** Detached *three- or four-family dwellings (triplexes or quadruplexes)* shall comply with the applicable provisions of the *International Building Code* portion of the Connecticut State Building Code.

Exception: Detached *triplexes or quadruplexes*, that are not *townhouses*, ^{and} not more than three stories above grade plane in height with a separate means of egress shall be allowed to comply with the alternative requirements as specifically permitted in Appendix S. ^{and have?}

CHAPTER 2
DEFINITIONS

(Amd) **APPROVED AGENCY.** An established and recognized organization regularly engaged in conducting tests or furnishing inspection services or furnishing product evaluation or certification, where such organization has been *approved* by the *fire code official*. *Building officials* licensed in accordance with the provisions of section 29-262 of the Connecticut General Statutes and employed by the jurisdiction in which the building or structure is being constructed, shall be considered an *approved agency* for the portions of this code also regulated by the Connecticut State Building Code. Pursuant to subsection (e)(1) of section 29-276b of the Connecticut General Statutes, approved agencies conducting tests or furnishings inspection services of soils or concrete must maintain accreditation by the National Voluntary Laboratory Accreditation Program of the National Institute of Standards and Technology.

(Amd) **BUILDING.** Any structure used or intended for supporting or sheltering any use or occupancy. For application of this code, each portion of a building that is completely separated from other portions by *fire walls* designed and constructed in accordance with the Connecticut State Building Code and has been *approved* by the *building official* shall be considered a separate building.

(Add) **BULK MERCHANDISING RETAIL BUILDING.** A retail building exceeding 12,000 square feet (1,115 m²) in area in which the sales area includes the storage of combustible materials on pallets, in solid piles, or in racks in excess of 12 feet (3,658 mm) in storage height.

(Add) **CHILD CARE CENTER.** A facility that offers or provides a program of supplementary care for more than twelve related or unrelated children outside their own homes on a regular basis, as described in subsection (a)(1) of section 19a-77 of the Connecticut General Statutes and operates in accordance with the licensing requirements

and regulations adopted by the Commissioner of Early Childhood ^{in accordance with} ~~under authority of~~ section 19a-79.

of the Connecticut General Statutes

(Add) **DWELLING, FOUR-FAMILY (QUADRUPLEX)**. A detached structure ~~(on a single lot)~~, other than a *townhouse*, with common walls or ^a common floor/ceiling between ~~the~~ units, designed for and occupied exclusively as the residence of ~~not more than four (4) dwelling units~~ ^{not more than four dwelling} with not more than six lodgers or boarders per *dwelling unit*.

(Add) **DWELLING, ONE-AND-TWO FAMILY**. A building that contains ~~not more than two dwelling units~~, each *dwelling unit* is occupied by ~~members of a single family~~ with not more than six lodgers or boarders per *dwelling unit*.

(Add) **DWELLING, ONE-FAMILY**. A building containing one *dwelling unit* with not more than six lodgers or boarders. Also known as a single-family *dwelling*.

(Add) **DWELLING, THREE-FAMILY (TRIPLEX)**. A detached structure ~~(on a single lot)~~, other than a *townhouse*, with common walls or ^a common floor/ceiling between ~~the~~ units, ^{not more than three dwelling} designed for and occupied exclusively as the residence of ~~not more than three (3) dwelling units~~ ^{dwelling} with not more than six lodgers or boarders per *dwelling unit*.

(Amd) **FIRE CODE OFFICIAL**. The local fire marshal or State Fire Marshal charged with the enforcement of this code, or his or her duly authorized representative.

(Amd) **FIREWORKS**. Fireworks has the same meaning as provided in section 29-356 of the Connecticut General Statutes and includes any device that meets the definition of 1.3G fireworks and 1.4G fireworks, but excludes sparklers and fountains, as defined in section 29-356 of the Connecticut General Statutes.

Fireworks, 1.3G. Large fireworks devices, which are *explosive materials*, intended for use in fireworks displays and designed to produce audible or visible effects by combustion, *deflagration* or *detonation*. Such 1.3G fireworks include, but are not limited to, firecrackers containing more than 130 milligrams (2 grains) of explosive composition, aerial shells containing more than 40 grams of pyrotechnic composition and other display pieces which exceed the limits for classification as 1.4G fireworks. Such 1.3G fireworks are also identified as Fireworks, UN0335 pursuant to 49.CFR 172.101.

Fireworks, 1.4G. Small fireworks devices containing restricted amounts of pyrotechnic composition designed primarily to produce visible or audible effects by combustion or *deflagration* which comply with the construction, chemical composition and labeling requirements for Fireworks, UN0336 pursuant to 49 CFR 172.101 and those set forth in 16 CFR Parts 1500 and 1507.

Sparklers and Fountains. See definition under Sparklers and Fountains.

(Add) **FAMILY CHILD CARE HOME.** A private family home or residence providing care for up to nine related or unrelated children on a regularly recurring basis, as described in subsection (a)(3) of section 19a-77 of the Connecticut General Statutes, that operates in accordance with the licensing requirements and regulations adopted by the Commissioner of Early Childhood under authority of subsection (f) of section 19a-97b.

(Amd) **FOSTER CARE FACILITIES.** Facilities that provide foster care to more than three children, 3 years of age or younger.

(Add) **GROUP CHILD CARE HOME.** A facility that offers or provides a program of supplementary care for up to twelve related or unrelated children on a regular basis that operates in either a commercial or residential facility, as described in subsection (a)(2) of section 19a-77 of the Connecticut General Statutes, and operates in accordance with the licensing requirements and regulations adopted by the Commissioner of Early Childhood under authority of section 19a-79.

(Add) **GUEST SUITE.** An accommodation with two or more contiguous rooms comprising a compartment, with or without doors between such rooms, that provides living, sleeping, sanitary, and storage facilities.

(Amd) **HIGH-RISE BUILDING.** A building with an occupiable floor located more than 75 feet (22 860 mm) above the lowest level of fire department vehicle access.

(Add) **HOTEL.** A building containing six or more guest rooms, intended or designed to be used, or which are used, rented or hired out to be occupied or which are occupied for sleeping purposes by guests.

(Amd) **LODGING HOUSE.** A building that does not qualify as a *one- or two-family dwelling* in accordance with Section 102.5 or an *R-1 Bed and Breakfast Establishment*, and that contains only the owner's *dwelling unit* and guest rooms without permanent provisions for cooking, with a total building occupant load of not more than 16 persons.

(Add) **LODGING OR ROOMING HOUSE.** An *existing* building or portion thereof that does not qualify as a *one- or two-family dwelling*, that provides sleeping accommodations for a total of 16 or fewer people on a transient or permanent basis, without personal care services, with or without meals, but without separate cooking facilities for individual occupants. This definition only applies to an *existing* lodging or rooming house *existing* prior to January 1, 2006.

Justify text on this page.

(Add) **NIGHT CLUB/DISCOTHEQUE/DANCE HALL.** A commercial establishment that is open at night, has music, dancing, or a show, for a fee, and may serve alcoholic drinks and food.

(Add) **PLANS AND SPECIFICATIONS.** See "Construction Documents"

bold, capitalize

(Add) **PLATFORM.** A raised area within a building used for worship, the presentation of music, plays or other entertainment; a head table for special guests; a raised area for lecturers or speakers; a boxing or wrestling ring; a theatre-in-the-round stage; or an area used for similar purposes wherein, other than horizontal sliding curtains, there are no overhead hanging curtains, drops, scenery or stage effects other than lighting and sound. A temporary platform is one installed for not more than 30 days.

Exception: Curtains suspended from overhead that open and close in a horizontal manner shall be permitted at platforms.

(Add) **QUADRUPLEX.** See "Dwelling, four-family"

capitalize

(Add) **RESIDENTIAL BOARD AND CARE.** An *existing* occupancy used for lodging and boarding of four or more residents, not related by blood or marriage to the owners or operators, for the purpose of providing personal care services. This definition only applies to an *existing* residential board and care *existing* prior to January 1, 2006.

(Add) **SPARKLERS AND FOUNTAINS.** "Sparklers" and "fountains" have the same meanings as provided in section 29-356 of the Connecticut General Statutes.

(Amd) **SPECIAL AMUSEMENT AREA.** A temporary or permanent *building* or portion thereof that is occupied for amusement, entertainment or educational purposes and is arranged in a manner that meets one or more of the following descriptions:

1. Makes the *means of egress* path not readily apparent due to visual or audio distractions.
2. Intentionally confounds identification of the *means of egress* path.
3. Otherwise makes the *means of egress* path not readily available because of the nature of the attraction or mode of conveyance through the building or structure.

Exception: Children's play structures that do not exceed 10 feet (0.93m) in height and do not have an aggregate horizontal projection in excess of 300 square feet (27.9m).

(Add) TRIPLEX. See "Dwelling, three-family"

Capitalize

SECTION 203 OCCUPANCY CLASSIFICATION AND USE

(Add) **203.3.4 GROUP B COLLEGE OCCUPANCIES.** A *building*, structure, or portion thereof that is of a Group B Business occupancy classification and associated with a facility of higher education above the twelfth grade. This definition does not include training or skill development facilities.

(Add) **203.3.5 GROUP B MEDICAL AND DENTAL OCCUPANCIES.** Shall apply to Group B medical and dental occupancies that provide services or treatment for four or more patients who may simultaneously be rendered incapable of taking action for self-preservation under emergency conditions. The occupancy shall include, but not be limited to, the following:

- Outpatient clinics with general anesthesia or life-support equipment;
- Dental centers providing treatment under general anesthesia;
- One-day surgical centers; and
- Physicians' offices providing treatment under general anesthesia.

Facilities such as the above that do not provide general anesthesia or life support equipment simultaneously to four or more patients shall be classified as Group B Business occupancies.

(Add) **203.3.6 IN-HOME GROUP B OCCUPANCY (Live-Work Unit).** Customary in-home business occupancies located within a single-family *dwelling unit* that provides professional services and employ a maximum of one employee within the *dwelling* in addition to the residents of the *dwelling unit* shall be classified as a single-family *dwelling*.

(Amd) **203.4.2 Group E, day care facilities, more than six children.** This group includes *buildings*, structures, or portions thereof occupied by more than six children 3 years of age or older who receive educational, supervision or personal care services for fewer than 24 hours per day.

(Amd) **203.4.2.2 Group E, day care facilities, six or fewer children.** A *building*, structure, or portion thereof having six or fewer children who receive educational, supervision or personal care services shall be classified as part of the primary occupancy.

for fewer than 24 hours per day?

(Amd) **203.4.2.3 Group E, day care facilities, nine or fewer children in a dwelling unit.** A *family child care home* as described in subsection (a)(3) of section 19a-77 of the

* Catchlines should have initial capitals, then lowercase, for consistency.

repeating defined term

Connecticut General Statutes, that operates in dwelling unit within a one-family or two-family residence in accordance with the licensing and regulatory requirements of the Office of Early Childhood shall be classified as Group R-3 or shall comply with the International Residential Code portion of the Connecticut State Building Code in accordance with Section 101.2.

Statutory section does not contemplate this
Exception: Pursuant to section 19a-87b of the Connecticut General Statutes, a family child care home that operates within a dwelling unit in a Group R-2 occupancy shall be classified as part of the primary occupancy.

Note: Residential Group R-4, Four to sixteen persons receiving care and Residential Group R-3, Three or fewer persons receiving care, are located under the Institutional Group I-1 heading.

Initial Capital, then lowercase
(Add) 203.5.3 IN-HOME INDUSTRIAL OCCUPANCIES, OTHER THAN HIGH HAZARD INDUSTRIAL OCCUPANCIES. (Live-Work Unit) Customary in-home industrial occupancies located within a single-family dwelling unit, in which processing, assembling, mixing, packaging, finishing, decorating, or repair operations are conducted, that employ a maximum of one employee within the dwelling in addition to the residents of the dwelling unit, shall be classified as single-family residential occupancies.

(Amd) 203.7.1.3 Residential Group R-4, Four to sixteen persons receiving care. A facility housing not fewer than four and not more than sixteen persons receiving custodial care shall be classified as R-4 occupancies.

(Amd) 203.7.1.4 Residential Group R-3, Three or fewer persons receiving care. A facility with three or fewer persons receiving custodial care shall be classified as Group R-3 occupancies or shall comply with the International Residential Code portion of the Connecticut State Building Code.

(Amd) 203.7.2 Institutional Group I-2. Institutional Group I-2 occupancy shall include buildings and structures used for medical care on a 24-hour basis for more than three persons who are incapable of self-preservation. This group shall include, but not be limited to, the following:

- Foster care facilities
- Detoxification facilities
- Hospitals
- Nursing homes
- Psychiatric hospitals

occupancy
(Amd) **203.7.2.2 Institutional Group I-2, Three or fewer persons receiving care.** A facility with three or fewer persons simultaneously receiving medical care shall be classified as Group R-3 or shall comply with the *International Residential Code* portion of the Connecticut State Building Code provided an *automatic sprinkler system* is installed in accordance with Section 903.3.1.3 or Section P2904 of the *International Residential Code* portion of the Connecticut State Building Code. *occupancies*

(Add) **203.7.2.3 Small I-2 Home, Alternative compliance for small I-2 homes.** See Section 116 for alternative compliance provisions for Group I-2 homes serving four to six persons who are incapable of self-preservation.

An institutional?
(Amd) **203.7.3 Institutional Group I-3.** Institutional Group I-3 occupancy shall include buildings that are inhabited by more than three persons who are under restraint or security. A Group I-3 facility is occupied by persons who are generally incapable of self-preservation due to security measures not under such persons' control. This group shall include, but not be limited to, the following:

- Correctional centers
- Detention centers
- Jails
- Prerelease centers
- Prisons
- Reformatories

Institutional? *to* *inclusive,*
Buildings of Group I-3 shall be classified as one of the occupancy conditions specified in Sections 203.7.3.1 through 203.7.3.5 and shall comply with Section 408 of the *International Building Code* portion of the Connecticut State Building Code. *||* *←*

(Amd) **203.7.4 Institutional Group I-4, day care facilities.** Institutional Group I-4 occupancy shall include *buildings* and structures occupied by more than six persons of any age who receive custodial care for fewer than 24 hours per day by persons other than parents or guardians or relatives by blood, marriage or adoption, and in a place other than the home of the person cared for. This group shall include, but not be limited to, the following:

- Adult day care
- Child day care

occupancies
(Amd) **203.7.4.1 Institutional Group I-4, Classification as Group E.** A child day care facility that provides care for more than six but not more than one hundred children 3

years or less of age, where the rooms in which the children are cared for are located on the level of exit discharge serving such rooms and each of these child care rooms has an exit door directly to the exterior, shall be classified as Group E. *occupancies*

(Amd) **203.7.4.3 Institutional Group I-4** *day care facilities*, six or fewer persons receiving care. A facility having six or fewer persons receiving custodial care shall be classified as part of the primary occupancy.

(Amd) **203.7.4.4 Institutional Group I-4, Family child care home**. A family child care home, as described in subsection (a)(3) of section 19a-77 of the Connecticut General Statutes, that operates in *dwelling unit* within a one-family or two-family residence in accordance with the licensing and regulatory requirements of the Office of Early Childhood shall be classified as Group R-3, or shall comply with the *International Residential Code*. *dwelling*
occupancy

Exception: Pursuant to section 19a-87b of the Connecticut General Statutes, a family child care home that operates within a *dwelling unit* in a Group R-2 occupancy shall be classified as part of the primary occupancy.

(Add) **203.7.4.5 Institutional Group I-4, Group child day care**. A group child care home, as described in subsection (a)(2) of section 19a-77 of the Connecticut General Statutes, that operates in *dwelling unit* within a one-family or two-family residence in accordance with the licensing and regulatory requirements of the Office of Early Childhood shall be classified as Group R-3, or shall comply with the *International Residential Code* portion of the Connecticut State Building Code. *dwelling*
occupancies

(Amd) **203.9.1 Residential Group R-1**. Residential occupancies containing *sleeping units* or more than two *dwelling units* in which the occupants are primarily transient in nature, including:

Bed and breakfast establishments

Boarding houses with more than six occupants

Congregate living facilities with more than six occupants

Hotels

Motels

** Initial Capital, then lowercase.*
(Add) **203.9.1.1 Group R-1** **BED and BREAKFAST** or **BED and BREAKFAST ESTABLISHMENT**. A building.

- (1) That provides sleeping accommodations to the public for a fee for no more than sixteen persons with guest rooms limited to the first and second floor of the structure, and

- (2) Where the owner occupies the *building* or an adjacent property as his or her primary place of residence, ~~and~~
- (3) Where cooking or food warming of any type is not allowed in guest rooms, and
- (4) That is a maximum of three stories in height and does not contain a mixed occupancy.

(Amd) **203.9.2 Residential Group R-2** ^{occupancies} Residential Group R-2 occupancies containing *sleeping units* or more than two *dwelling units* where the occupants are primarily permanent in nature, including:

- Apartment houses
- Boarding houses with more than six occupants
- Congregate living facilities with more than six occupants
- Convents
- Dormitories
- Fraternities and sororities
- Hotels
- Live/work units
- Monasteries
- Motels
- Vacation timeshare properties

(Add) **203.9.2.1 Residential Group R-2 triplexes and quadruplexes**. Buildings that do not contain more than four *dwelling units*, with not more than six lodgers or boarders per *dwelling unit* and that are designed in accordance with Appendix S.

(Amd) **203.9.3 Residential Group R-3** ^{occupancies} Residential Group R-3 occupancies where the occupants are primarily permanent in nature and not classified as Group R-1, R-2, R-4 or I, including:

^{occupancies}

Buildings that do not contain more than two *dwelling units*, with not more than six lodgers or boarders per *dwelling unit*.

Care facilities that provide accommodations for five or fewer persons receiving care.

- * Congregate living facilities (nontransient) with six or fewer occupants where personal care services are not provided.

Boarding houses (nontransient)

* Are the items listed below congregate living facilities examples of facilities w/in that category? If so, language should be added to indicate that. If not, the listed items should be left justified w/ periods at the end of each.

- Convents
- Dormitories
- Emergency services living quarters
- Fraternities and Sororities
- Monasteries

Congregate living facilities (transient) with six or fewer occupants where personal care services are not provided.

Boarding houses (transient) with six or fewer occupants where personal care services are not provided.

(Amd) **203.9.4 Residential Group R-4** Residential Group R-4 occupancy shall include buildings, structures or portions thereof for more than 3 but not more than 16 occupants, excluding staff, who reside on a 24-hour basis in a supervised residential environment and receive custodial care. Buildings of Group R-4 shall be classified as one of the occupancy conditions specified in Section 203.9.4.1, 203.9.4.2, or 203.9.4.3. Group R-4 occupancies shall meet the requirements for construction as defined for Group R-3, except as otherwise provided for in the *International Building Code* portion of the Connecticut State Building Code. This group shall include, but not be limited to, the following:

- Alcohol and drug centers
- Assisted living facilities
- Congregate care facilities
- Group homes
- Halfway houses
- Residential board and care facilities
- Social rehabilitation facilities

CHAPTER 3 GENERAL REQUIREMENTS

(Amd) **301.2 Permits.** *Permits* shall be required as set forth in Section 105.5 for the activities or uses regulated by Sections 303, 306, 308, 315, and 320.

(Amd) **304.1.1 Valet trash.** *Valet trash* collection shall be permitted in accordance with Appendix O only where *approved*. The owner and valet trash collection service provider shall comply with the rules and limitations established by the jurisdiction.

(Amd) **304.3.5 Capacity exceeding 1.5 cubic yards.** Dumpsters and containers with an individual capacity of 1.5 cubic yards [40.5 cubic feet (1.15 m³)] or more shall not be stored in buildings or placed within 10 feet (3048 mm) of combustible walls, openings or combustible roof eave lines.

Exceptions:

1. Dumpsters or containers that are placed inside buildings in areas protected by an *approved automatic sprinkler system* installed throughout in accordance with Section 903.3.1.1, 903.3.1.2, or 903.3.1.3.2.
2. Storage in a structure shall not be prohibited where the structure is of Type I or IIA construction, located not less than 10 feet (3048 mm) from other buildings and used exclusively for dumpster or container storage. Type
3. Dumpsters or containers that are located adjacent to buildings where the exterior area is protected by an *approved automatic sprinkler system*.

**(Del) SECTION 307
OPEN BURNING, RECREATIONAL FIRES AND PORTABLE OUTDOOR
FIREPLACES**

Delete section in its entirety. See section 23-48 of the Connecticut General Statutes.

(Amd) **308.1 General.** Open flame, fire and burning shall be in accordance with Sections 308.1.1 to 308.4.1, inclusive, and with other applicable sections of this code.

(Amd) **308.2 Permits required.** *Permits* shall be obtained from the *fire code official* in accordance with Section 105.5 prior to engaging in the following activities involving open flame, fire and burning:

1. Use of a torch or flame-producing device to remove paint from a structure.
2. Except for theatrical performance open flame devices as specified in Section 308.3.2, the use of open flame, fire or burning in connection with Group A or E occupancies.
3. Use or operation of torches and other devices, machines or processes liable to start or cause fire in or on wildfire risk areas.

Note: See section 29-357a of the Connecticut General Statutes for permit

requirements for displays of special effects produced by pyrotechnics or flame producing devices.

(Amd) **308.3.2 Theatrical performances, flame effects before an audience.** Where *approved* by the State Fire Marshal, open flame devices or effects used in conjunction with theatrical performances or flame effects before an audience shall be in conformance with and governed by the requirements of the Connecticut State Fire Prevention Code.

(Add) **308.3.2.1 Approval.** The use of flame effect materials, devices or components governed by NFPA 140 ^{and} ~~or~~ NFPA 160, and the device(s), their arrangement, location(s), and fuel(s), shall be *approved* by the State Fire Marshal and shall be in conformance with the requirements of the Connecticut State Fire Prevention Code.

(Del) SECTION 310 SMOKING

center
Delete section in its entirety.

(Add) **315.3.5 Fuel-fired appliances.** A minimum distance of 3 feet (914 mm) shall be maintained at all times between combustible storage and fuel-fired appliances.

Exception: Clearances of ~~less~~ ^{fewer} than 3 feet (914 mm) shall be permitted where *approved* by the specific appliance manufacturer.

CHAPTER 4 EMERGENCY PLANNING AND PREPAREDNESS

(Amd) **401.1 Scope.** Reporting of emergencies, coordination with emergency response forces, emergency plans and procedures for managing or responding to emergencies shall comply with the provisions of this section.

(Amd) **403.2.2 Announcements.** As required by subsection (b) of section 29-381 of the Connecticut General Statutes, before any performance or event at any theater, concert or music hall or assembly hall or at any *building*, auditorium or room used for public gatherings of more than one hundred persons, the owner, proprietor, manager or agent of such theater, hall, *building*, auditorium or room shall make a public announcement that describes the location of emergency exits.

(Amd) **403.4.1 Fire drills & Crisis response drills.** (a) Each local and regional board of education shall provide for a fire drill to be held in the schools of such board not later than thirty days after the first day of each school year and at least once each month thereafter, except as provided in subsection (b) of this section.

(b) Each such board shall substitute a crisis response drill for a fire drill once every three months and shall develop the format of such crisis response drill in consultation with the appropriate local law enforcement agency. A representative of such agency may supervise and participate in any such crisis response drill.

(Amd) **403.7.2 Group I-2 occupancies.** Group I-2 occupancies shall comply with Sections 401, 403.7.2.1 to 403.7.2.4.1, inclusive, and 404 to 406, inclusive.

(Amd) **403.7.2.4 Emergency evacuation drills not including small I-2 homes.** Emergency evacuation drills shall comply with Section 405.

Exceptions:

1. The movement of patients to safe areas or to the exterior of the building is not required.
2. Where emergency evacuation drills are conducted after visiting hours or where patients or residents are expected to be asleep, a coded announcement shall be an acceptable alternative to audible alarms.

(Add) **403.7.2.4.1 Emergency evacuation drills for small I-2 homes.** Emergency evacuation drills shall involve the actual evacuation of all residents to an assembly point, as specified in the emergency action plan required by the Connecticut State Fire Prevention Code, and shall provide residents with experience in egressing through all exits and means of escape required by the code.

(Amd) **403.9.2.1 College and university buildings, Residential boarding and high school buildings.** An *approved* fire safety and evacuation plan in accordance with Section 404 shall be prepared and maintained for Group R-2 college and university buildings, and R-2 Residential boarding and high school buildings. Group R-2 college and university buildings, and R-2 Residential boarding and high school buildings shall comply with Sections 403.9.2.1.1 and 403.9.2.1.2.

(Amd) **403.9.2.1.1 First emergency evacuation drill.** The first emergency evacuation drill of each school year shall be conducted within 30 days of the beginning of classes.

(Amd) **403.9.2.2.1 Guide contents.** A fire emergency guide shall describe the location, function and use of fire protection equipment and appliances available for use by residents, including *fire alarm systems, smoke alarms* and portable fire extinguishers. Guides shall include an emergency evacuation plan for each sleeping unit or *dwelling unit*.

(Amd) **403.9.3.1.1 Fire safety plan.** A copy of the fire safety plan shall be maintained at the facility at all times. The plan shall include the following in addition to the requirements

Justify text on this page.

of Section 404.2.2:

1. Location and number of resident sleeping rooms.
2. Location of special locking or egress control arrangements.
3. Location of all points of safety.

(Add) **403.10.7 Road tunnels.** Newly-constructed road tunnels shall comply with Chapter 7 of NFPA 502. Renovations to existing road tunnels are not required to comply with Chapter 7 of NFPA 502.

(Amd) **403.11.3 Crowd managers.** Where facilities or events involve a gathering of more than 250 people, crowd managers shall be provided in accordance with Sections 403.11.3.1 to 403.11.3.3, inclusive.

(Amd) **403.11.3.1 Number of crowd managers.** Not fewer than one trained crowd manager for each 250 persons or portion thereof, shall be provided for the gathering.

Exceptions:

1. Outdoor events with fewer than 1,000 persons in attendance shall not require crowd managers.
2. Assembly occupancies used exclusively for religious worship with an *occupant load* not exceeding 500 shall not require crowd managers.
3. The number of crowd managers shall be reduced where, in the opinion of the *fire code official*, the fire protection provided by the facility and the nature of the event warrant a reduction.

(Amd) **404.2.3.2 Drills.** Lockdown plan drills shall be conducted in accordance with the *approved* plan. Except as provided for in Section 403.4.1, such drills shall not be substituted for fire and evacuation drills required by Section 405.3.

^{bold}
(Amd) **Table 405.3**

FIRE AND EVACUATION DRILL FREQUENCY AND PARTICIPATION

Group or Occupancy	Frequency	Participation
Group A	Quarterly	Staff
Group B ^b	Annually	All occupants
Group B ^c (Ambulatory care facilities)	Quarterly on each shift ^a	Staff
Group B ^b (Clinic,	Annually	Staff

outpatient)		
Group E	Monthly ^{a,e}	All occupants
Group F	Annually	Staff
Group I-1	Semiannually on each shift ^b	All occupants
Group I-2	Quarterly on each shift ^a	Staff
Small I-2 Group Homes	Quarterly on each shift	All occupants, See Section 403.7.2.4
Group I-3	Quarterly on each shift ^a	Staff
Group I-4	Monthly on each shift ^a	All occupants
Group R-1	Quarterly on each shift	Staff
Group R-2 ^d	Four annually	All occupants
Group R-4	Semiannually on each shift ^{a,f}	All occupants ^f

a. In severe weather conditions, the *fire code official* shall have the authority to modify the emergency evacuation drill frequency.

b. Emergency evacuation drills are required in Group B buildings having an occupant load of 500 or more persons or more than 100 persons above or below the lowest level of exit discharge.

c. Emergency evacuation drills are required in ambulatory care facilities in accordance with Section 403.3.

d. Emergency evacuation drills in Group R-2 college and university buildings shall be in accordance with Section 403.9.2.1. Other Group R2 occupancies shall be in accordance with Section 403.9.2.2.

e. See Section 403.4.1 for crisis response drills.

f. See Section 403.9.3.4.

CHAPTER 5 FIRE SERVICE FEATURES

(Amd) **501.1 Scope** The fire chief in conjunction with the *fire code official* shall assure fire service features for *buildings*, structures, operations, and premises shall comply with this chapter.

(Amd) **501.2 Permits.** A *permit* shall be required as set forth in Section 105.5.

(Amd) **503.1.1 Buildings and facilities.** *Approved fire apparatus access roads* shall be provided for every facility, *building* or portion of a *building* hereafter constructed or moved into or within the jurisdiction. The *fire apparatus access road* shall comply with the requirements of this section, Appendix D, and shall extend to within 150 feet (45 720

|| Justify

Justify text on this page.

mm) of all portions of the facility and all portions of the *exterior walls* of the first story of the *building* as measured by an *approved* route around the exterior of the building or facility, and within 50 feet (15240 mm) of at least one exterior door.

Exceptions:

1. The *fire code official* is authorized to increase the dimension of 150 feet (45 720mm) where any of the following conditions occur:

1.1. The building is equipped throughout with an *approved automatic sprinkler system* installed in accordance with Section 903.3.1.1, 903.3.1.2 or 903.3.1.3.

1.2. *Fire apparatus access roads* cannot be installed because of location on property, topography, waterways, nonnegotiable grades or other similar conditions, and an *approved* alternative means of fire protection is provided.

1.3. There are not more than two Group R-3 or Group U occupancies having an area not exceeding 400 ft².

2. Where *approved* by the *fire code official*, *fire apparatus access roads* shall be permitted to be exempted or modified for solar photovoltaic power generation facilities.

(Amd) **503.1.2 Additional access.** The *fire code official* in conjunction with the *fire chief* is authorized to require more than one *fire apparatus access road* based on the potential for impairment of a single road by vehicle congestion, condition of terrain, climate conditions or other factors that could limit access.

(Add) **503.1.4 Existing fire department access roads.** *Existing, previously approved fire department access roads* shall be permitted to remain where the *existing* fire department access is *approved* by the *fire code official*.

(Add) **505.3 Building Sign Information.** Where required by the *fire code official*, *buildings* and structures shall have building sign information installed per the criteria in Appendix J.

in accordance with

(Del) **507.1 Required water supply.** Delete section in its entirety.

(Del) **507.2 Type of water supply.** Delete section in its entirety.

(Del) **507.3 Fire flow.** Delete section in its entirety.

(Del) **507.4 Water supply test.** Delete section in its entirety.

(Amd) **507.5 Fire hydrant systems.** Fire hydrant systems shall comply with Sections 507.5.1.1 to 507.5.6, inclusive.

(Del) **507.5.1 Where required.** Delete section.

(Amd) **510.1 Emergency responder communications enhancement systems in new buildings.** *Approved* in-building emergency responder communications enhancement system (ERCES) for emergency responders shall be provided in all new buildings. In-building ERCES within the *building* shall be based on the *existing* coverage levels of the public safety communications systems utilized by the jurisdiction, measured at the exterior of the *building*. The ERCES, where required, shall be of a type determined by the *fire code official* and the *frequency license holder(s)*. This section shall not require improvement of the *existing* public safety communications systems.

Exceptions:

1. Where *approved* by the *building official* and the *fire code official*, a wired communications system in accordance with Section 907.2.13.2 shall be permitted to be installed or maintained instead of an *approved communications coverage system*.
↳ in-building ERCES?
2. Where it is determined by the *fire code official* in conjunction with the fire chief that the in-building emergency responder communications enhancement system is not needed.
3. In facilities where emergency responder communications coverage is required and such systems, components or equipment required could have a negative impact on the normal operations of that facility, the *fire code official* shall have the authority to accept an automatically activated emergency responder communications coverage system.
approve
4. One-story buildings not exceeding 12,000 square feet (1115 m²) with no below-ground area(s).

CHAPTER 6
BUILDING SERVICES AND SYSTEMS

(Add) **601.3 Gas.** The *International Fuel Gas Code* is not adopted by the state of Connecticut. Any references to the *International Fuel Gas Code* within the ~~body~~ ⁱⁿ of this code shall be considered references to the requirements of NFPA 54, *National Fuel Gas Code*; NFPA 2, *Hydrogen Technologies Code*; and NFPA 58, *Liquefied Petroleum Gas Code*. These requirements apply to gas piping systems extending from the point of

delivery to the inlet connections of appliances, the installation and operation of residential and commercial gas appliances and related accessories as covered by this code.

(Amd) **603.9 Abandoned wiring.** Abandoned cables that are able to be accessed without causing damage, or requiring demolition to the building, shall be tagged for future use or removed.

(Amd) **604.1 State Elevator Code.** All elevators, dumbwaiters, material lifts, vertical and inclined platform lifts, inclined stairway chairlifts, limited-use/limited application elevators and escalators, including *existing* systems, shall comply with the regulations of the Department of Administrative Services adopted pursuant to chapter 538 of the Connecticut General Statutes as enforced by the State Elevator Inspector and the requirements of this section.

(Del) **604.2 Emergency operations.** Delete section in its entirety.

(Del) **604.3 Standby power.** Delete section in its entirety.

(Del) **604.5 Maintenance of elevators.** Delete section in its entirety.

(Del) **604.6 Elevator keys.** Delete section in its entirety.

(Amd) **605.4 Fuel oil storage systems.** Fuel oil storage systems shall be installed and maintained in accordance with the requirements of NFPA 31 and this Code. Tanks and fuel-oil piping systems shall be installed in accordance with NFPA 31 and Chapter 13 of the *International Mechanical Code* portion of the Connecticut State Building Code.

(Amd) **606.1 General.** Commercial kitchen exhaust hoods shall comply with the requirements of the *International Mechanical Code* portion of the Connecticut State Building Code.

(Amd) **606.3 Operations and maintenance.** Commercial cooking systems shall be operated, inspected and maintained in accordance with Sections 606.3.1 through 606.3.4 and NFPA 96, *Standard for Ventilation Control and Fire Protection of Commercial Cooking Operations*.

inclusive,

|| justify

Amd → **CHAPTER 7**
(AMD) INSPECTION AND MAINTENANCE OF FIRE AND SMOKE PROTECTION FEATURES

(Amd) **701.1 Scope.** The provisions of this Chapter shall govern the inspection and

maintenance of the materials, systems and assemblies used for structural *fire resistance*, *fire-resistance-rated* construction separation of adjacent space and construction installed to resist the passage of smoke to safeguard against the spread of fire and smoke within a *building* and the spread of fire to or from *buildings*. New *buildings* shall comply with the *International Building Code* portion of the Connecticut State Building Code and Section 701.1.1.

(Add) **701.1.1 Additional requirements.** In addition to the requirements of this Chapter, the requirements of Chapter 7 of the *International Building Code* portion of the Connecticut State Building Code shall also be considered requirements of this Code and known as the *International Building Code*, Chapter 7 portion of the Connecticut State Fire Safety Code.

(Amd) **701.6 Owner's responsibility.** The *owner* shall maintain an inventory of all required *fire-resistance-rated* construction, construction installed to resist the passage of smoke and the construction included in Sections 703 to 707, inclusive, and Sections 602.4.1 and 602.4.2 of the *International Building Code* portion of the Connecticut State Building Code. Such construction shall be visually inspected by the *owner* annually and properly repaired, restored or replaced when damaged, altered, breached or penetrated. Where concealed, such elements shall not be required to be visually inspected by the *owner* unless the concealed space is accessible by the removal or movement of a panel, access door, ceiling tile or similar movable entry to the space.

(Amd) **705.2 Inspection and maintenance.** *Opening protectives* in *fire-resistance-rated* assemblies shall be inspected and maintained in accordance with NFPA 80. *Opening protectives* in *smoke barriers* shall be inspected and maintained in accordance with NFPA 80 and NFPA 105. Openings in *smoke partitions* shall be inspected and maintained in accordance with NFPA 105. Fire doors and smoke and draft control doors shall not be blocked, obstructed, or otherwise made inoperable. Fusible links shall be replaced promptly whenever fused or damaged. *Opening protectives* and smoke and draft control doors shall not be modified.

Exception: Where a door or door frame is not required to be fire protection rated and is equipped with a fire protection label, the door and the door frame shall not be required to comply with NFPA 80.

(Add) **705.2.8 Inspection and Testing of Door Assemblies.** Doors, other than those covered under NFPA 80 and NFPA 105 that are required to be self-closing or automatic closing shall comply with all of the following:

1. Door assemblies shall be inspected annually.
2. Doors shall be operated to confirm full closure.
3. Parts found to be damaged or inoperative shall be replaced.
4. Door openings and the surrounding areas shall be kept clear of anything that could

- obstruct or interfere with the free operation of the door.
5. Blocking or wedging of doors in the open position shall be prohibited.
 6. Self-closing and automatic-closing devices shall be kept in working condition at all times.

CHAPTER 8 INTERIOR FINISH, DECORATIVE MATERIALS AND FURNISHINGS

(Add) **801.1.1 Additional requirements.** In addition to the requirements of this chapter, the requirements of Chapter 8 of the *International Building Code* portion of the Connecticut State Building Code shall also be considered requirements of this code and known as the *International Building Code*, Chapter 8 portion of the Connecticut State Fire Safety Code.

(Amd) SECTION 803 WALL AND CEILING FINISHES

(Amd) SECTION 804 INTERIOR WALL AND CEILING TRIM AND INTERIOR FINISH IN BUILDINGS

(Amd) **804.1 Interior trim.** Combustible trim in *buildings*, excluding *handrails* and guards, shall not exceed 10 percent of the specific wall or ceiling areas to which it is attached. Other than foam plastic, material used as interior trim shall comply with Section 804.1.1 or 804.1.2. Foam plastic used as interior trim shall comply with Section 804.2.

(Amd) SECTION 805 UPHOLSTERED FURNITURE AND MATTRESSES IN BUILDINGS

(Amd) SECTION 806 NATURAL DECORATIVE VEGETATION IN BUILDINGS

(Amd) **806.1.1** Where permitted by the *fire code official*, Christmas trees shall be permitted in accordance with Table 806.1.1.

(Add) Table 806.1.1 Provisions for Christmas Trees by Occupancy

Occupancy	No Trees Permitted	Cut Tree Permitted With Automatic Sprinkler System	Cut Tree Permitted Without Automatic Sprinkler System	Balled Tree Permitted
Ambulatory health care				X
Apartment buildings		Within unit	Within unit	X
Assembly				X
Board and care				X
Business		X		X
Day-care		X		X
Detention and correctional	X			
Dormitories			X**	X
Educational				X
Health care				X
Hotels				X
Industrial		X	X	X
Lodging and rooming		X		X
Mercantile		X		X
Storage		X	X	X

** Cut trees in dwelling units that are associated with supervisory personnel in dormitory occupancies are permitted subject to the approval of the *fire code official*.

(Add) **806.5** Limited quantities of decorative vegetation shall be permitted where the *fire code official* determines that adequate safeguards are provided based on use group, as well as quantity and nature of decorative vegetation.

**(Amd) SECTION 807
DECORATIVE MATERIALS AND TRIM AND ARTIFICIAL DECORATIVE
VEGETATION IN BUILDINGS**

**(Amd) SECTION 808
FURNISHINGS AND OTHER UPHOLSTERED FURNITURE AND MATTRESSES OR
DECORATIVE MATERIALS IN BUILDINGS**

**CHAPTER 9
FIRE PROTECTION AND LIFE SAFETY SYSTEMS**

(Amd) **901.3 Permits.** A *permit* shall be required as set forth in Section 105.5.

(Amd) **901.5 Administration of installation acceptance testing.** Fire detection and alarm systems, emergency alarm systems, gas detection systems, fire-extinguishing systems, fire hydrant systems, fire standpipe systems, fire pump systems, private fire service mains and all other *fire protection systems* and appurtenances thereto shall be subject to acceptance tests as contained in the installation standards and as *approved* by the *fire code official*. The *fire code official* shall be notified before any required acceptance testing. Testing shall be conducted in the presence of the *fire code official* or his or her representative at the expense of the owner or owner's representative.

(Amd) **901.6 Inspection, testing and maintenance.** Fire detection and alarm systems, emergency alarm systems, gas detection systems, fire-extinguishing systems, mechanical smoke exhaust systems and smoke and heat vents shall be maintained in an operative condition at all times and shall be replaced or repaired where defective. Non-required *fire protection systems* and equipment shall be inspected, tested and maintained or removed. The responsible person conducting an inspection, testing, or maintenance shall make records of all inspections, tests, and maintenance of the systems and its components and make the records available to the *fire code official* upon request. In the event of a system deficiency discovered during a required inspection or other event, the system shall be immediately tagged by such responsible person conducting the inspection noting the issue and date. The discovered deficiency(cies) shall be noted on the inspection report and a copy of such report shall be immediately forwarded to the *fire code official*. Contact information for the responsible person shall be included in the report.

(Add) **901.6.1.1 Maintenance of NFPA 13D systems.**

(Add) **901.6.1.1.1 Monthly maintenance.** A minimum monthly maintenance program shall include:

- (1) Visually inspecting all sprinklers to ensure against obstruction of spray.
- (2) Inspecting all valves to ensure they are open.
- (3) Checking the pressure of air used with dry systems.
- (4) Checking the water level in storage tanks.

(Add) **901.6.1.1.2 Quarterly maintenance.** A minimum quarterly maintenance program shall include:

- (1) Testing of all water flow alarms.
- (2) Testing of the alarm system.

(Add) **901.6.1.1.3 Sprinkler Replacement.** Operated or damaged sprinklers shall be replaced with sprinklers having the same performance characteristics as the original equipment.

(Add) **901.6.1.1.4 Painted Sprinklers.** Any sprinklers that have been painted outside the factory shall be replaced with a new listed sprinkler.

(Amd) **901.7 Systems out of service.** Where a required *fire protection system* is out of service for more than 4 hours in a 24-hour period, the fire department and the *fire code official* shall be notified immediately and, where required by the *fire code official*, the building shall be either evacuated or an *approved* fire watch shall be provided for all occupants left unprotected by the shut down until the *fire protection system* has been returned to service. Where utilized, fire watches shall be provided with not less than one *approved* means for notification of the fire department. The only duty of the fire watch shall be to perform constant patrols of the building and keep watch for fires.

Exception: Facilities with an *approved* notification and impairment management program. The notification and impairment program for water-based *fire protection systems* shall comply with NFPA 25.

(Add) **901.11 Ceiling tiles and ceiling assemblies.** Where automatic sprinklers or automatic fire detection devices are installed, ceiling tiles and ceiling assemblies necessary for the proper actuation of the fire protection devices shall be maintained.

(Amd) **903.1.1 Alternative protection.** In any occupancy where the character of fuel for fire is such that extinguishment or control of fire is accomplished by a type of alternative automatic extinguishing system complying with Section 904, such alternative system shall be permitted in lieu of an automatic sprinkler system and shall be installed in accordance with the applicable standard and *approved* by the *fire code official*.

occupancies

(Amd) **903.2.1.2 Group A-2.** An *automatic sprinkler system* shall be provided for *fire areas* containing Group A-2 *occupancies* and throughout all stories from the Group A-2 occupancy to and including the levels of exit discharge serving that occupancy where one of the following conditions exists:

1. The *fire area* exceeds 5,000 square feet (464.5 m²).

Exception: Existing restaurants in existing non-sprinklered buildings that were designated Use Group A-3 under a previous edition of the Connecticut State Building Code that undergo addition, alteration or change of occupancy that results in an increase in the restaurant's fire area, provided the proposed fire area does not exceed 12,000 square feet (1,115 m²).

2. The *fire area* has an *occupant load* of 300 or more or where the occupant load exceeds 100 or more in the following assembly occupancies:
 - a. *Dance halls*
 - b. *Discotheques*
 - c. *Night clubs*
 - d. Assembly occupancies with festival seating.
3. The *fire area* is located on a floor other than a *level of exit discharge* serving such occupancies.

(Amd) **903.2.1.6 Assembly occupancies on roofs.** Where an occupiable roof has an assembly occupancy with an *occupant load* exceeding 100 for Group A-2 and 300 for other Group A occupancies, all floors between the occupiable roof and the *level of exit discharge* shall be equipped with an *automatic sprinkler system* in accordance with Section 903.3.1.1 or 903.3.1.2.

Exception: Open parking garages of Type I or Type II construction.

(Add) **903.2.3.1. Statutory requirements.** An *automatic sprinkler system* shall be provided in Group E occupancies pursuant to section 29-315 of the Connecticut General Statutes.

occupancies

(Amd) **903.2.7 Group M.** An *automatic sprinkler system* shall be provided throughout buildings containing a Group M occupancy where one or more of the following conditions exists:

1. A Group M *fire area* exceeds 12,000 square feet (1,115 m²).
2. A Group M *fire area* is located more than three stories above grade plane.

Does this modify "rooms" or "fireworks"?

3. The combined area of all Group M *fire areas* on all floors, including any mezzanines, exceeds 24,000 square feet (2,230 m²).
4. Throughout stories below the *level of exit discharge* where such stories have an area exceeding 2,500 square feet (232 m²) and are used for the sale, storage or handling of combustible goods or merchandise.
5. In Group M occupancies storage rooms containing consumer fireworks, regardless of size, in a new or existing permanent store shall be protected with an *automatic sprinkler system* installed in accordance with NFPA 13 or separated from the retail sales area by a fire barrier having a fire resistance rating of not less than 1 hour. The quantity of fireworks permitted in storage shall not exceed 3,600 cubic feet, including packaging. Such storage shall be segregated into areas of 1,200 cubic feet or less and separated by a minimum of 4 feet of clear space.
6. In Group M occupancies, the total quantity of sparklers and fountains on hand either displayed or in storage, shall not exceed 227.2 lb. (gross) [103 kg (gross)], including packaging or 1,000 lb. (gross) [454 kg (gross)] in a building protected throughout with an approved *automatic sprinkler system* installed in accordance with NFPA 13. A quantity in excess of these amounts is subject to approval by the State Fire Marshal.

include metric conversions

occupancies

(Amd) **903.2.8 Group R.** An automatic sprinkler system installed in accordance with Section 903.3 shall be provided throughout all newly constructed *buildings* with a Group R *fire area* or in existing *buildings* that have a Group R *fire area* newly introduced by *change of occupancy*, occupancy group designation or by an *addition*. The use of any exceptions in this section shall also comply with the means of egress requirements of Chapter 10.

Exceptions:

1. *Group R-1 bed and breakfast establishments.*
2. In existing buildings four stories or less in height containing not more than four dwelling units where dwelling units are added to an existing Group R use that does not involve a physical increase in the height or *building area* and where each dwelling unit has two means of egress that meets at least any of the following:
 - 2.1. An *exit door* directly to the exterior at a *level of exit discharge*.
 - 2.2. Access to an exterior egress *stair* serving a maximum of two *dwelling units*.
 - 2.3. Direct access to an interior *stair* serving a maximum of two *dwelling units* and separated from all other portions of the *building* with 1-hour fire-resistance-rated *fire barriers*.
3. *Existing buildings* converted prior to June 15, 1994, from a one- or two-family building or Group R-3 to Group R-2 containing not more than four *dwelling units*.

4. Horizontal additions containing newly introduced Group R occupancies that are added to *existing* buildings shall have an *automatic sprinkler system* installed in the addition only if the addition is completely separated from the existing building by fire barriers with a minimum 1-hour fire-resistance rating.

5. In a *building* with a maximum of two *dwelling units* where:

5.1. The exit(s) and *dwelling units* are separated from any non-residential occupancy in accordance with Section 508 of the *International Building Code* portion of the Connecticut State Building Code.

5.2. The non-residential occupancy is protected by an automatic fire detection and alarm system with notification in each *dwelling unit(s)*.

5.3. Each *dwelling unit* has *two means of egress* that meets any of the following:

at least

5.3.1. An *exit door* to the exterior at the *level of exit discharge*.

5.3.2. Access to an exterior egress *stair* serving a maximum of two *dwelling units*.

5.3.3. Direct independent access to an interior *stair* serving a maximum of two *dwelling units* and separated from all other portions of the *building* with 1-hour fire resistance rated *fire barriers*.

completely

a minimum

(Amd) **903.2.8.3 Care facilities.** An *automatic sprinkler system* installed in accordance with Section 903.3.1.3 shall be permitted in Group R-4 care facilities with sixteen or fewer residents when all of the following conditions are met:

1. The facility is not in a building containing mixed occupancies,
2. The building in which the facility is located is limited to two stories above grade plane and 40 feet (12.2 m) in height,
3. The *automatic sprinkler system* has a minimum 30-minute water supply,
4. All habitable, enclosed, usable areas and closets shall be sprinklered,
5. Facilities with more than eight residents shall be treated as two-family dwellings with regard to water supply, and
6. The *automatic sprinkler system* is provided with valve supervision by one of the following methods:
 - 6.1. A single listed control valve that shuts off both domestic and *automatic sprinkler system* water supply and a separate valve that shuts off the domestic system only.
 - 6.2. Electrical supervision connected to the facility's fire alarm system.

6.3. Valve closure that causes the sounding of an audible alarm throughout the premises.

(Amd) **903.2.11 Specific building areas and hazards.** In all occupancies other than Group U, an *automatic sprinkler system* shall be installed for building design or hazards in the locations set forth in Sections 903.2.11.1 to 903.2.11.7, inclusive.

a.v. (Add) **903.2.11.7 Additional statutory requirements.** Pursuant to section 29-315 of the Connecticut General Statutes, automatic fire extinguishing systems shall be installed on each floor of any building or structure to be built more than four stories tall and to be used for human occupancy and in other occupancies as required by the State Fire Marshal in the interest of safety because of special occupancy hazards.

(Amd) **903.3.1.1.1 Exempt locations.** Automatic sprinklers shall not be required in the following rooms or areas where such rooms or areas are protected with an *approved* automatic fire detection system in accordance with Section 907.2 that will respond to visible or invisible particles of combustion. Sprinklers shall not be omitted from any room merely because it is damp, of *fire-resistance-rated construction* or contains electrical equipment.

1. Generator and transformer rooms separated from the remainder of the building by walls and floor/ceiling or roof/ceiling assemblies having a *fire-resistance-rating* of not less than 2 hours.
2. Fire service access elevator machine rooms and machinery spaces.
3. Machine rooms, machinery spaces, control rooms and control spaces associated with occupant evacuation elevators designed in accordance with Section 3008 of the *International Building Code* portion of the Connecticut State Building Code.

(Add) **903.3.1.1.4 Vertical openings.** Closely spaced sprinklers and draft stops are not required around floor openings permitted to be unenclosed ~~by this code~~ unless the closely spaced sprinklers and draft stops are being utilized in lieu of an enclosure, as specified by Section 712.1.3.1 of the *International Building Code* portion of the Connecticut State Building Code.

(Add) **903.3.5.3 Water authority approval.** Unless served by a private well of sufficient capacity or other approved source, domestic service shall be permitted to provide the water supply for the *automatic sprinkler system* only upon written approval of the water authority supplying such domestic service.

(Amd) **903.6 Where required in existing buildings and structures.** An automatic sprinkler system shall be provided in existing buildings and structures where required.

(Amd) **904.1 General.** Automatic fire-extinguishing systems, other than *automatic sprinkler systems*, shall be designed, installed, inspected, tested and maintained in accordance with the provisions of this section and the applicable referenced standards listed in Chapter 80. Where other fire protection systems are required to be installed by the provisions of this code or are installed with the approval of the *fire code official* as an alternative or equivalency or by a condition of a modification, the design and installation of the system shall comply with the appropriate standards listed in Chapter 80. The responsible person conducting an inspection, testing, or maintenance shall make records of all inspections, tests, and maintenance of a system and its components and make the records available to the *fire code official* upon request. In the event of a system deficiency discovered during a required inspection or other event, the system shall be immediately tagged by such responsible person conducting the inspection noting the issue and date. The discovered deficiency shall be noted on the inspection report and a copy of such report shall be immediately forwarded to the *fire code official*. Contact information for the responsible person shall be included in the report.

(Add) **905.2.1 Piping design.** The riser piping, supply piping and the water service piping shall be sized to maintain a residual pressure of at least 100 pounds per square inch (psi) (690 kPa) at the topmost outlet of each riser while flowing the minimum quantities of water specified based upon a pressure of 150 psi (1035 kPa) available at the fire department connection.

Exception: In buildings equipped throughout with an *automatic sprinkler system* in accordance with Section 903.3.1.1 or Section 903.3.1.2 and where the highest floor level is not more than 75 feet (22,860 mm) above the lowest level of fire department vehicle access, Class I standpipes shall have an automatic or manual-wet supply.

(Amd) **905.12 Existing buildings.** Where required, buildings or structures shall be equipped with standpipes installed in accordance with Section 905.

SECTION 906 PORTABLE FIRE EXTINGUISHERS

(Amd) **906.1 Where required.** Portable fire extinguishers shall be installed and maintained in accordance with NFPA 10 and in ~~all of the following~~ locations specified in Section 906.1.1.

(Amd) **TABLE 906.1**

ADDITIONAL REQUIRED PORTABLE FIRE EXTINGUISHERS

Amend

Amd fifth row as follows:

309.5	Powered industrial trucks
--------------	---------------------------

(Add) **906.1.1 Portable Fire Extinguishers Required.** Portable fire extinguishers shall be provided where required in the following locations:

1. Where required for new and *existing* occupancies in accordance with Table 906.1.1.
2. Within 30 feet (9,144 mm) distance of travel from commercial cooking equipment and from domestic cooking equipment in Group I-1 and Group I-2, Condition 1.
3. In areas where *flammable* or *combustible liquids* are stored, used or dispensed.
4. On each floor of structures under construction, except Group R-3 occupancies, in accordance with Section 3316.1. *of the International Building Code*
5. Where required by the sections indicated in Table 906.1. *portion of the Connecticut State Building Code*
6. Special-hazard areas, including, but not limited to, laboratories, computer rooms and generator rooms, where required by the *fire code official*.
7. In all occupancies, outside and immediately adjacent to the entrance to all special hazardous areas except general storage areas. If the only entrance to a special hazardous area is from the exterior of the building, the fire extinguisher may be located just inside the entrance door.
8. New and *existing* mercantile occupancies selling sparklers and fountains shall have a minimum of two dedicated 2-A water fire extinguishers at the location of the sparklers and fountains.

add space

indent as in 1-7

Exception: Portable fire extinguishers are not required at normally unmanned Group U occupancy buildings or structures where a portable fire extinguisher suitable to the hazard of the location is provided on the vehicle of visiting personnel.

bold

(Add) Table 906.1.1 Portable Fire Extinguishers Required

Occupancy / Use	Where Required After 10/01/2018	Where Required Before 10/01/2018
Ambulatory health care group B medical occupancies	Yes	Yes
Apartment and dormitory group R-2 occupancies ^a	No	No
Assembly group A occupancies ^b	Yes	No

Bed and Breakfast Establishments Group R-1 occupancies ^f	Yes	Yes
Business group B occupancies, including Group B medical, Group B college.	Yes	No
Day-care group I-4 & E occupancies	Yes	No
Detention and correctional group I-3 occupancies ^{c, d}	Yes	Yes
Educational group E occupancies	Yes	No
Health care group I-1 and I-2 occupancies	Yes	Yes
Hotel group R-1 occupancies	Yes	No
Industrial group F occupancies	Yes	No
Industrial group H occupancies	Yes	Yes
Lodging and rooming house group R-1 and R-2 occupancies	Yes	No
Mercantile group M occupancies	Yes ^g	No ^g
One- and two-family dwelling occupancies	No	No
Residential board and care, group R-4 & small I-2 occupancies	Yes	No
Storage group S and H occupancies ^e	Yes	No

^a Portable fire extinguishers shall be permitted to be located at exterior locations or interior locations so that all portions of the buildings are within 75 ft. (22.8 m) of travel distance to an extinguishing unit.

^b Portable fire extinguishers are not required in seating or outdoor performance areas.

^c Access to portable fire extinguishers shall be permitted to be locked.

^d Portable fire extinguishers shall be permitted to be located at staff locations only.

^e In storage areas where forklift, powered industrial truck, or cart operators are the primary occupants, fixed extinguishers, as specified in NFPA 10, need not be provided when all of the following requirements are met:

- (1) Use of vehicle-mounted extinguishers is *approved* by the *fire code official*.
- (2) Each vehicle is equipped with a 10 lb., 4A:80-B:C extinguisher affixed to the vehicle using a mounting bracket *approved* by the extinguisher manufacturer or the *fire code official* for vehicular use.
- (3) Not less than two spare extinguishers of equal or greater rating are available onsite to replace a discharged extinguisher.
- (4) Vehicle operators are trained in the proper operation and use of the extinguisher.

No fewer

(5) Inspections of vehicle-mounted extinguishers are performed daily.

^f Portable fire extinguishers shall be provided in bed and breakfast establishments as required by this code.

^g New and existing mercantile occupancies selling sparklers and fountains shall have a minimum of two (2) dedicated 2-A water fire extinguishers at the location of the sparklers and fountains.

(Del) **906.2.1 Certification of service personnel for portable fire extinguishers.**
Delete section.

(Amd) **907.2.7.1.1 Occupant notification.** During times that the building is occupied, the initiation of a signal from a manual fire alarm box shall not be required to activate the alarm notification appliances when an alarm signal is activated at a constantly attended location from which evacuation instructions shall be initiated over an emergency voice/alarm communication system installed in accordance with Section 907.5.2.2.

(Add) **907.2.7.1.2 Staged evacuation/selective occupant notification.** Where *approved* by the authority having jurisdiction and where total evacuation of occupants is impractical due to building configuration, only occupants in the affected zones shall be ~~initially~~ notified, and provisions shall be made to selectively notify occupants in other zones to afford orderly evacuation of the entire building. When selective occupant notification is utilized, the portion of the building that does not receive the initial notification of alarm shall be separated from areas of immediate emergency and initial evacuation by construction having a fire resistance rating of at least 1 hour or other features approved by the authority having jurisdiction.

(Amd) **907.2.8.1 Manual fire alarm system.** A manual *fire alarm system* that activates the occupant notification system in accordance with Section 907.5 shall be installed in Group R-1 occupancies.

Exceptions:

1. A manual *fire alarm system* is not required in buildings not more than two stories in height where all individual *dwelling units, sleeping units,* and contiguous attic and crawl spaces to those units are separated from each other and public or common areas by not less than 1-hour *fire partitions* and each individual dwelling unit and *sleeping unit* has an *exit* directly to a *public way, egress court* or yard.
2. Manual fire alarm boxes are not required throughout the building where all of the following conditions are met:

2.1. The building is equipped throughout with an *automatic sprinkler system* installed in accordance with Section 903.3.1.1 or 903.3.1.2.

2.2. The notification appliances will activate upon sprinkler water flow.

2.3. Not fewer than one manual fire alarm box is installed at an *approved* location.

(Amd) **907.2.8.2 Automatic smoke detection system.** An automatic smoke detection system that activates the occupant notification system in accordance with Section 907.5 shall be installed throughout all interior *corridors* serving *dwelling units* or *sleeping units*.

Exceptions:

1. In buildings that do not have interior *corridors* serving *dwelling units* or *sleeping units* and where each *dwelling unit* or *sleeping unit* has a means of egress door opening directly to an exit or to an exterior exit access that leads directly to an exit.
2. In *Group R-1 bed and breakfast establishments*. (See Section 907.2.11.1.1.)

(Amd) **907.2.9.1 Manual fire alarm system.** A manual fire alarm system that activates the occupant notification system in accordance with Section 907.5 shall be installed in *Group R-2 occupancies* where:

1. Any *dwelling unit* or *sleeping unit* is located three or more stories above the lowest *level of exit discharge*;
2. Any *dwelling unit* or *sleeping unit* is located more than one story below the *highest level of exit discharge* of exits serving the *dwelling unit* or *sleeping unit*; or
3. The building contains more than 11 *dwelling units* or *sleeping units*.

Exceptions:

1. In buildings not over two stories in height where all *dwelling units* or *sleeping units* and contiguous attic and crawl spaces are separated from each other and public or common areas by at least 1-hour fire partitions and each *dwelling unit* or *sleeping unit* has an exit directly to a *public way*, egress court or yard.
2. Manual fire alarm boxes are not required in buildings equipped throughout with an *automatic sprinkler system* in accordance with Section 903.3.1.1 or 903.3.1.2 where the occupant notification appliances will automatically activate throughout the notification zones upon a sprinkler water flow.
3. In buildings that do not have interior *corridors* serving *dwelling units* or *sleeping units* and are protected by an *approved automatic sprinkler system* installed in accordance with Section 903.3.1.1 or 903.3.1.2, provided *dwelling units* or *sleeping units* either have a means of egress door opening directly to an exterior *exit access* that leads directly to ~~the exits~~ or are served by open-ended *corridors* designed in accordance with Section 1027.6, Exception 3. an exit

(Amd) **907.2.9.3 Group R-2 college and university buildings and primary or secondary school buildings.** An automatic smoke detection system that activates the

occupant notification system in accordance with Section 907.5 shall be installed in Group R-2 occupancies operated by a college or university, or primary or secondary schools for student or staff housing in all of the following locations:

1. Common spaces outside of dwelling units and sleeping units.
2. Laundry rooms, mechanical equipment rooms and storage rooms.
3. All interior *corridors* serving *sleeping units* or *dwelling units*.

Exception: An automatic smoke detection system is not required in buildings that do not have interior *corridors* serving *sleeping units* or *dwelling units* and where each *sleeping unit* or *dwelling unit* either has a *means of egress* door opening directly to an exterior *exit access* that leads directly to an *exit* or a *means of egress* door opening directly to an *exit*. Required smoke alarms in *dwelling units* and *sleeping units* in Group R-2 occupancies operated by a college or university for student or staff housing shall be interconnected with the fire alarm system in accordance with NFPA 72.

or a primary
or secondary
school?

(Amd) **907.2.11.1 Group R-1.** *Single- or multiple-station smoke alarms* shall be installed in all of the following locations in Group R-1:

1. In sleeping areas.
2. In every room in the path of the *means of egress* from the sleeping area to the door leading from the *dwelling unit* or *sleeping unit*.
3. In each story within the *dwelling unit* or *sleeping unit*, including *basements*. For *dwelling units* or *sleeping units* with split levels and without an intervening door between the adjacent levels, a *smoke alarm* installed on the upper level shall suffice for the adjacent lower level provided that the lower level is less than one full story below the upper level.

(Add) **907.2.11.1.1 Group R-1 bed and breakfast establishments.** An *approved* household fire warning system in accordance with the requirements of NFPA 72, consisting of a control unit with smoke detectors, a manual fire alarm box on each floor and occupant notification shall be installed in all *Group R-1 bed and breakfast establishments*. A heat detector shall be installed in the kitchen.

(Amd) **907.2.11.2 Groups R-2, R-3, R-4 and I-1.** *Single- or multiple-station smoke alarms* shall be installed and maintained in Groups R-2, R-3, R-4 and I-1 at all of the following locations:

1. On the ceiling or wall outside of each separate sleeping area in the immediate vicinity of bedrooms.

2. In each room used for sleeping purposes.
3. In each story within a dwelling unit, including basements but not including crawl spaces and uninhabitable attics. In dwellings or dwelling units with split levels and without an intervening door between the adjacent levels, a smoke alarm installed on the upper level shall suffice for the adjacent lower level provided that the lower level is less than one full story below the upper level.
4. In Group R-2 multistory buildings see 907.2.11.2.1.

(Add) **907.2.11.2.1 Group R-2.** ^{occupancies} Where devices are required and a separate building fire alarm system is installed meeting the requirements of NFPA 72, all initiation and notification devices including capability for future visible alarm notification shall be part of the fire alarm system and installed in accordance with Section 907.5.2.3.3.

(Add) **907.2.11.2.2 Group R-4.** ^{occupancies} In Group R-4 occupancies, single or multiple-station smoke alarms shall be installed in living rooms, dens, day rooms and similar spaces, in addition to the locations required by Section 907.2.11.2.

(Add) **907.2.11.2.3 Alterations and additions.** Alterations or additions requiring a permit in Group E and I-4 day care facilities, Group I-1 or R occupancies, or when one or more sleeping rooms are added or created in existing *dwelling units*, the entire *dwelling unit* shall be provided with smoke detectors located as required for new *dwelling units*. Such smoke detectors within existing spaces may be battery operated and are not required to be dual-powered or interconnected unless other remodeling considerations require removal of wall and ceiling coverings which would facilitate concealed interconnected wiring.

(Add) **907.2.11.2.3.1 During construction Group R occupancies.** Whenever a *dwelling, dwelling unit, or sleeping unit* in a Group R occupancy is occupied during interior alterations or additions requiring a building permit, the temporary installation of battery-operated smoke alarms shall be required in the vicinity of such alterations or additions for the duration of construction activities. A combined smoke and carbon monoxide alarm may be installed to comply with Section 915.8 and this section. Pursuant to section 29-315b of the Connecticut General Statutes, a single-family or two-family dwelling shall also comply with this section.

(Add) **907.2.11.2.4 Group I-4 and Group E day care facilities.** Single- or multiple-station smoke detectors shall be installed and maintained in all day care facilities in the following locations:

1. In each story in front of doors to the stairways;
2. In the *corridors* of all floors occupied by the day care occupancy; and

3. In lounges, recreation areas and sleeping rooms in the day care occupancy.

Exception: Day care facilities housed in one room.

(Amd) **907.2.16 Aerosol storage uses.** Aerosol product rooms and general-purpose warehouses containing aerosol products, aerosol cooking spray products or plastic aerosol 3 products shall be provided with an *approved manual fire alarm system* where required by this code.

(Add) **907.4.3.2 Ceiling tiles and ceiling assemblies.** Where automatic fire detectors are installed, ceiling tiles and ceiling assemblies necessary for the proper actuation of the fire protection device in accordance with NFPA 72 shall be maintained.

held
(Amd) **TABLE 907.5.2.3.2 VISIBLE ALARMS**

AGGREGATE NUMBER OF DWELLING UNITS AND SLEEPING UNITS	SLEEPING ACCOMMODATIONS WITH VISIBLE ALARMS
6 to 25	2
26 to 50	4
51 to 75	7
76 to 100	9
101 to 150	12
151 to 200	14
201 to 300	17
301 to 400	20
401 to 500	22
501 to 1,000	5% of total
1,001 and over	50 plus 3 for each 100 over 1,000

(Add) **907.6.6.1.1 Automatic telephone-dialing devices.** Automatic telephone-dialing devices used to transmit an emergency alarm shall comply with the requirements of subsection (c) of section 28-25b of the Connecticut General Statutes.

(Amd) **907.9 Where required in existing buildings and structures.** An *approved fire alarm system* shall be provided in buildings and structures where required.

(Amd) **907.10.1 Smoke alarm replacement.** *Smoke alarms* shall be replaced when any of the following apply:

1. The *smoke alarm* fails to respond to operability tests.
2. The *smoke alarm* exceeds 10 years from the date of manufacture marked on the unit, unless otherwise specified in the manufacturer's instructions.

3. The *smoke alarm* end-of-life signal is sounded.

4. The *smoke alarm* date of manufacture cannot be determined.

Where the replacement of *smoke alarms* is required by this section, *smoke alarms* shall not be required to include the 520-Hz signal unless the *smoke alarms* to be replaced include that signal.

(Amd) **912.2 Location.** With respect to hydrants, driveways, *buildings* and landscaping, fire department connections shall be so located that fire apparatus and hoses connected to supply the system will not obstruct access to the *buildings* for other fire apparatus. The location of fire department connections shall be *approved* by the *fire code official* in conjunction with the fire chief.

(Amd) **912.2.1 Visible location.** Fire department connections shall be located on the street side of *buildings* or facing *approved fire apparatus access roads*, fully visible and recognizable from the street, *fire apparatus access road* or nearest point of *fire department vehicle access* or as otherwise *approved* by the *fire code official* in conjunction with the fire chief.

(Amd) **912.2.2 Location signage.** On buildings, wherever the fire department connection is not visible to approaching fire apparatus, the fire department connection shall be indicated by an *approved* sign mounted on the street front or on the side of the building. Such sign shall have the letters "FDC" not less than 6 inches (152 mm) high and words in letters not less than 2 inches (51 mm) high or an arrow to indicate the location. Such signs shall be subject to the approval of the *fire code official* in conjunction with the fire chief.

(Add) **913.2.3 Electric fire pumps.** Buildings provided with standby electrical power for the purpose of continuing operations or occupancy shall provide standby power in accordance with Article 701 of the NFPA 70, *National Electrical Code*, portion of the Connecticut State Building Code for any electric fire pump installed to provide an adequate water supply or minimum operating pressure to a required automatic sprinkler system. Such system shall be in accordance with Section 1203.

(Amd) **915.1 General.** Carbon monoxide detection and warning equipment shall be installed in new buildings and occupancies in accordance with Sections 915.1.1. *Existing* buildings and occupancies in accordance with Section 1103.9. When alterations or additions requiring a permit occur in *existing* buildings, carbon monoxide detection and warning equipment shall be provided in accordance with Section 915.7.

Exception: Carbon monoxide detection is not required in Group S, Group F, and Group U occupancies that are not normally occupied.

(Amd) **915.2.3 Group E occupancies.** Carbon monoxide detection and warning equipment shall be provided in the locations specified in Sections 915.2.3.1 and 915.2.3.2.

Exception: Group E rooms with cooking appliances, laboratories and maintenance spaces.

(Add) **915.2.3.1. Locations.** Carbon monoxide detectors shall be located as follows:

1. On the ceilings of rooms containing permanently installed fuel-burning heating equipment.
2. Centrally located within the first room or area served by the first air supply register by each main duct leaving a fuel-burning, forced-air furnace.

(Add) **915.2.3.2 Signage.** A sign shall be provided at all entrances to such rooms indicating that carbon monoxide detectors are located within the space.

(Amd) **915.2.4 CO-producing forced-air furnace.** Carbon monoxide detection and warning equipment shall be provided in *dwelling units* and *sleeping units* served by a fuel-burning, forced-air furnace.

Exception: Carbon monoxide detection and warning equipment shall not be required in *dwelling units* and *sleeping units* where carbon monoxide detection is provided in the first room or area served by each main duct leaving the furnace, and the carbon monoxide alarm signals are automatically transmitted to an *approved* location.

(Amd) **915.2.5 Private garages.** Carbon monoxide detection and warning equipment shall be provided in *dwelling units* and *sleeping units* in buildings with attached private garages.

Exceptions:

1. Where there are no communicating openings between the private garage and the *dwelling unit* or *sleeping unit*.
2. In *dwelling units* and *sleeping units* located more than one story above or below a private garage.
3. Where the private garage connects to the building through an *open-ended corridor*.
4. Where carbon monoxide detection and warning equipment is provided in an *approved* location between openings to a private garage and *dwelling units* or *sleeping units*.

(Add) **915.2.7 CO-producing appliances** ^{or Fireplaces} **outside of dwelling units and sleeping units.** Carbon monoxide detection and warning equipment shall be provided in *dwelling units* and *sleeping units* located in buildings that contain CO-producing appliances or fireplaces.

Exceptions:

1. Carbon monoxide detection and warning equipment shall not be required in *dwelling units* and *sleeping units* without communicating openings between the CO-producing appliance or fireplace and the *dwelling unit* or *sleeping unit*.
2. Carbon monoxide detection and warning equipment shall not be required in *dwelling units* and *sleeping units* where a carbon monoxide detection and warning equipment is provided in one of the following locations:
 - 2.1. In an *approved* location between the CO-producing appliance or fireplace and the *dwelling unit* or *sleeping unit*.
 - 2.2. On the ceiling of the room containing the CO-producing appliance or fireplace.

(Add) **915.5.6 Group E alarm notification.** Carbon monoxide detectors shall be connected to the building fire alarm signaling system as a separate zone or zones. Such alarms shall activate a supervisory signal at the main control unit and any remote annunciators. Such alarms shall not activate the building evacuation alarm.

(Amd) **915.6 Maintenance.** Carbon monoxide alarms and carbon monoxide detection systems shall be maintained in accordance with NFPA 72. Carbon monoxide alarms and carbon monoxide detectors that become inoperable, begin producing end-of-life signals or have reached the manufacturer's replacement date shall be replaced.

(Add) **915.7 Alterations and additions.** When *alterations* or *additions* requiring a *permit* occur to *buildings* with Group R-3 and R-4 occupancies and to Group R-1 bed and breakfast establishments, or when one or more sleeping rooms are added or created in such occupancies, the entire occupancy shall be provided with carbon monoxide detectors located as required for new construction. The carbon monoxide detectors shall have a power source in accordance with Section 915.4.1.

When *alterations* or *additions* requiring a *permit* occur to *buildings* with Group I-1, I-2, I-4, R-1 other than bed and breakfast establishments, R-2 and E occupancies, or when one or more sleeping rooms are added or created in such occupancies, only the work area shall be provided with carbon monoxide detectors located as required for new construction. The carbon monoxide detectors shall have a power source in accordance with Section 915.4.1. For the purpose of this section, "work area" is defined as that portion or portions of a *building* consisting of all reconfigured spaces as indicated on the *construction documents*. "Work area" excludes other portions of the *building* where

incidental work entailed by the intended work must be performed and portions of the *building* where work not initially intended by the *owner* is specifically required by this code.

Exceptions:

1. The carbon monoxide detectors may be battery operated or plug-in and are not required to be interconnected when other remodeling considerations do not require the removal of the appropriate wall or ceiling coverings to facilitate concealed interconnected wiring.
2. Alterations to the exterior surfaces of *existing* buildings including, but not limited to, reroofing, re-siding, window replacement and the construction of decks without roofs, are exempt from the requirements of this section.
3. Carbon monoxide detectors shall not be required in buildings not containing a fuel-burning appliance, fireplace or attached garage.

(Add) **915.8 During construction.** Pursuant to section 29-315b of the Connecticut General Statutes, whenever a single-family or two-family *dwelling* is occupied during interior alterations or additions requiring a *building permit* where a fuel-burning appliance, fireplace or attached garage exists, the temporary installation of battery-operated carbon monoxide alarms shall be required in the vicinity of such alterations or additions for the duration of construction activities. Combined smoke and carbon monoxide alarms may be installed to comply with Section 907.2.11.2.3.1 and this section.

**CHAPTER 10
MEANS OF EGRESS**

(Amd) **1001.1 General.** *Buildings* or portions thereof shall be provided with a *means of egress* system as required by this chapter. The provisions of this chapter shall control the design, construction and arrangement of *means of egress* components required to provide an approved *means of egress* from structures and portions thereof.

Exception: Pursuant to section 29-292 of the Connecticut General Statutes, detached *one- and two-family dwellings* and multiple single-family *dwellings* (townhouses) not more than three stories above grade plane in height with a separate *means of egress* and their accessory structures shall comply with the *International Residential Code* portion of the Connecticut State Building Code.

(Add) **1003.8 Security device.** Any security device or system that emits any medium that could obscure a *means of egress* in any *building*, structure or premises shall be prohibited.

(Amd) **1004.5 Areas without fixed seating.** The number of occupants shall be computed at the rate of one occupant per unit of area as prescribed in Table 1004.5. For areas without *fixed seating*, the *occupant load* shall not be less than the number determined by dividing the floor area under consideration by the *occupant load* factor assigned to the function of the space as set forth in Table 1004.5. Where an intended function is not listed in Table 1004.5, the *fire code official* in conjunction with the *building official* shall establish a function based on a listed function that most nearly resembles the intended function.

(Amd) **1005.3.1 Stairways.** The capacity, in inches (mm), of *means of egress stairways* shall be calculated by multiplying the *occupant load* served by such *stairway* by a *means of egress* capacity factor of 0.3 inch (7.6 mm) per occupant. Where *stairways* serve more than one story, only the *occupant load* of each story considered individually shall be used in calculating the required capacity of the *stairways* serving that story.

Exceptions:

1. Facilities with *smoke-protected assembly seating* shall be permitted to use the capacity factors in Table 1030.6.2 indicated for stepped *aisles* for *exit access* or *exit stairways* where the entire path for *means of egress* from the seating to the *exit discharge* is provided with a smoke control system complying with Section 909.
2. Facilities with *open-air assembly seating* shall be permitted to the capacity factors in Section 1030.6.3 indicated for stepped *aisles* for *exit access* or *exit stairways* where the entire path for *means of egress* from the seating to the *exit discharge* is open to the outdoors.

(Amd) **1005.3.2 Other egress components.** The capacity, in inches (mm), of *means of egress* components other than *stairways* shall be calculated by multiplying the *occupant load* served by such component by a *means of egress* capacity factor of 0.2 inch (5.1 mm) per occupant.

Exceptions:

1. Facilities with *smoke-protected assembly seating* shall be permitted to use the capacity factors in Table 1030.6.2 indicated for level or ramped *aisles* for *means of egress* components other than *stairways* where the entire path for *means of egress* from the seating to the *exit discharge* is provided with a smoke control system complying with Section 909.
2. Facilities with *open-air assembly seating* shall be permitted to the capacity factors in Section 1030.6.3 indicated for level or ramped *aisles* for *means of egress* components other than *stairways* where the entire path for *means of egress* from the seating to the *exit discharge* is open to the outdoors.

(Add) **1006.2.2.7 Group I-4 Day care means of egress.** Group I-4 facilities, rooms or spaces where care is provided for more than 10 children who are 3 years of age or younger shall have access to not less than two *exits* or *exit access doorways*.

(Amd) **1006.3.4 Single exits.** A single *exit* or access to a single *exit* shall be permitted from any *story* or *occupiable* roof where one of the following conditions exists:

1. The *occupant load*, number *dwelling units* and *exit access* travel distance do not exceed the values in Table 1006.3.4(1) or 1006.3.4(2).
2. Rooms, areas and spaces complying with Section 1006.2.1 with *exits* that discharge directly to the exterior at the *level of exit discharge*, are permitted to have one *exit* or access to a single *exit*.
3. Parking garages where vehicles are mechanically parked shall be permitted to have one *exit* or access to a single *exit*.
4. Buildings of *Group R-1 bed and breakfast establishments*, or Group R-3 and R-4 occupancies shall be permitted to have one *exit* or access to a single *exit*.
5. Individual single-story or multistory *dwelling units* shall be permitted to have a single *exit* or access to a single *exit* from the *dwelling unit* provided that both of the following criteria are met:
 1. The *dwelling unit* complies with Section 1006.2.1 as a space with one *means of egress*.
 2. Either the *exit* from the *dwelling unit* discharges directly to the exterior at the *level of exit discharge*, or the *exit access* outside the *dwelling unit's* entrance door provides access to not less than two *approved independent exits*.

bold

(Amd) **TABLE 1006.3.4(1) STORIES AND OCCUPIABLE ROOFS WITH ONE EXIT OR ACCESS TO ONE EXIT FOR R-2 OCCUPANCIES**

STORY OR OCCUPIABLE ROOF	OCCUPANCY	MAXIMUM NUMBER OF DWELLING UNITS	MAXIMUM EXIT ACCESS TRAVEL DISTANCE
Basement, first, second, third, or fourth story above grade plane and occupiable roofs over the first, second, or third story above grade plane	R-2 ^{a, b, c, d}	4 dwelling units	125 feet

Metric reference?

Fifth story above grade plane and higher	NP	NA	NA
--	----	----	----

For SI: 1 foot = 304.8 mm.

NP = Not Permitted.

NA = Not Applicable.

- a. Buildings classified as Group R-2 equipped throughout with an *automatic sprinkler system* in accordance with Section 903.3.1.1 or 903.3.1.2 and provided with *emergency escape and rescue openings* in accordance with Section 1031.
- b. This table is used for Group R-2 occupancies consisting of *dwelling units*. For Group R-2 occupancies consisting of *sleeping units*, use Table 1006.3.4(2).
- c. This table is for *occupiable roofs* accessed through and serving individual *dwelling units* in Group R-2 occupancies. For Group R-2 occupancies with *occupiable roofs* that are not accessed through and serving individual units, use Table 1006.3.4(2).
- d. ^{Four} 4-story buildings and ^{three} 3-story buildings with an *occupiable roof* above the third story shall also comply with Section 1006.3.4.2.

(Add) **1006.3.4.2 Single exit four-story buildings with Group R-2 dwelling units.** Four-story buildings with a single *exit* for Group R-2 *dwelling units* shall comply with Table 1006.3.4(1) and all of the following:

1. The net floor area of each floor shall not exceed 4,000 square feet (4185m²). 371.6
2. Openings to the *interior exit stairway* enclosure shall be limited to those required for *exit access* into the enclosure from normally occupied spaces, those required for egress from the enclosure, and openings to the exterior. Elevators shall not open into the *interior exit stairway* enclosure.
3. A manual *fire alarm system* and *automatic smoke detection system* that activates the occupant notification system in accordance with Section 907.5 shall be provided. *Smoke detectors* shall be located in common spaces outside of dwelling units, including, but not limited to, gathering areas, laundry rooms, mechanical equipment rooms, storage rooms, interior corridors, *interior exit stairways*, and *exit passageways*.
4. Regardless of the *stairway* construction type, automatic sprinkler locations in *interior exit stairways* shall comply with the requirements of NFPA 13 for combustible *stairways*.
5. Electrical receptacles shall be prohibited in an *interior exit stairway*.

6. *Stairways* shall have a clear width of 48 inches (1219 mm) minimum between handrails.

(Amd) **1008.1 Means of egress illumination.** Illumination shall be provided in the *means of egress* in accordance with Section 1008.2. In the event of power supply failure, *means of egress* illumination shall comply with Section 1008.3.

(Amd) **1008.2 Illumination required.** The *means of egress serving a room or space*, including the *exit discharge*, shall be illuminated at all times the building space served by the *means of egress* is occupied.

Exceptions:

1. Occupancies in Group U.
2. Self-service storage units 400 square feet (37.2 m²) or less in area and accessed directly from the exterior of the building.
3. *Aisle accessways* in Group A.
4. Within *dwelling units* and *sleeping units* in Groups R-1, R-2 and R-3.
5. Within *sleeping units* of Group I occupancies.
6. In *Group R-1 bed and breakfast establishments* when illumination of the *means of egress* is initiated upon initiation of a fire alarm.

(Add) **1008.2.5 Arrangement of illumination.** Required illumination shall be arranged so that the failure of any single lamp does not result in an illumination level of less than 0.2 foot-candle (2.15 lux) at the floor level.

(Amd) **1008.3 Illumination required by an emergency electrical system.** An emergency electrical system shall be provided to automatically illuminate the following areas in the event of a power supply failure:

1. In rooms or spaces that require two or more exits or access to exits:
 - 1.1. Aisles.
 - 1.2. Corridors.
 - 1.3 *Exit access stairways and ramps.*
2. In buildings that require two or more exits or access to exits:
 - 2.1. *Interior exit access stairways and ramps.*
 - 2.2. *Interior and exterior exit stairways and ramps.*

2.3. *Exit passageways.*

2.4. Vestibules and areas on the level of discharge used for *exit discharge* in accordance with Section 1028.2.

2.5. Exterior landings as required by Section 1010.1.5 for *exit* doorways that lead directly to the *exit discharge*.

3. In other rooms and spaces:

3.1. Electrical equipment rooms.

3.2. Fire command centers.

3.3. Fire pump rooms.

3.4. Generator rooms.

3.5. Public restrooms with an area greater than 300 square feet (27.87 m²).

3.6. *Means of egress* components, other than those within sleeping rooms, of *Group R-1 Bed and breakfast establishments*.

(Add) **1008.3.3 Activation.** The emergency *means of egress* illumination system shall be arranged to provide the required illumination automatically in the event of any interruption of normal lighting due to any of the following:

1. Failure of a public utility or other outside electrical power supply.
2. Opening of a circuit breaker or fuse.
3. Manual acts including accidental opening of a switch controlling normal lighting facilities.

(Add) **1010.1.1.2 Bed and breakfast establishments.** Doors within and accessing *Group R-1 bed and breakfast establishments* shall have a minimum clear width of 28 inches (711 mm). Doors within and accessing bathrooms shall have a minimum clear width of 24 inches (610 mm).

(Amd) **1010.1.2.1 Direction of swing.** Side-hinged swinging doors, pivoted doors, or balanced doors shall swing in the direction of egress travel where serving a room or area containing an occupant load of 50 or more persons, an *exit* enclosure (unless the door serves an individual living/*dwelling unit* that opens directly into an *exit* enclosure) or a Group H occupancy.

(Add) **1010.2.1.1 Bathroom doors.** In Group R-4 occupancies, Group I-2 child care facilities, and Group I-4 day care facilities, bathroom doors that latch in the closed position

shall be openable from inside the bathroom and capable of being unlocked from the ingress side.

(Amd) **1010.2.4 Locks and latches.** Locks and latches shall be permitted to prevent operation of doors where any of the following exist:

1. Places of detention or restraint.
2. In Group I-1, Condition 2 and Group I-2 occupancies where the clinical needs of persons receiving care require containment or where persons receiving care pose a security threat, provided that all clinical staff can readily unlock doors at all times, and all such locks are keyed to keys carried by all clinical staff at all times or all clinical staff have the codes or other means necessary to operate the locks at all times.
3. In buildings in occupancy Group A having an *occupant load* of 300 or less, Groups B, F, M and S, and in *places of religious worship*, the main door or doors are permitted to be equipped with key-operated locking devices from the egress side provided that:
 - 3.1. The doors are the main exterior doors to the *building*, or the doors are the main doors to the tenant space.
 - 3.2. The locking device is readily distinguishable as locked.
 - 3.3. A readily visible durable sign is posted on the egress side on or adjacent to the door stating: "THIS DOOR TO REMAIN UNLOCKED WHEN THIS SPACE IS OCCUPIED." The sign shall be in letters 1 inch (25 mm) high on a contrasting background.
 - 3.4. The use of the key-operated locking device is revocable by the *fire code official* for due cause.
4. Manual bolts, automatic flush bolts and constant latching bolts on the inactive leaf of a pair of doors in accordance with Table 1010.2.4, provided that the inactive leaf does not have a doorknob, panic hardware, or similar operating hardware.
5. Single *exit* doors complying with Section 1006.2.1 or 1006.3.4 from individual *dwelling* or sleeping units of Group R occupancies and equipped with a night latch, dead bolt, *manual bolt*, or security chain that requires a second releasing motion, provided that such devices are openable from the inside without the use of a key or tool.
6. Fire doors after the minimum elevated temperature has disabled the unlatching mechanism in accordance with *listed* fire door test procedures.

7. Doors serving roofs not intended to be occupied shall be permitted to be locked, preventing entry to the building from the roof.

8. Other than *egress courts*, where occupants must egress from an exterior space through the building for *means of egress*, *exit access* doors shall be permitted to be equipped with an approved locking device where installed and operated in accordance with all of the following:

8.1. The maximum *occupant load* shall be posted where required by Section 1004.9. Such sign shall be permanently affixed inside the building and shall be posted in a conspicuous space near all the *exit access doorways*.

8.2. A weatherproof telephone or two-way communication system installed in accordance with Sections 1009.8.1 and 1009.8.2 shall be located adjacent to not less than one required *exit access door* on the exterior side.

8.3. The egress door locking device is readily distinguishable as locked and shall be a key-operated locking device.

8.4. A clear window or glazed door opening, not less than 5 square feet (0.46 m²) in area, shall be provided at each *exit access door* to determine if there are occupants using the outdoor area.

8.5. A readily visible durable sign shall be posted on the interior side on or adjacent to each locked required *exit access door* serving the exterior area stating: "THIS DOOR TO REMAIN UNLOCKED WHEN THE OUTDOOR AREA IS OCCUPIED." The letters on the sign shall be not less than 1 inch (25.4 mm) high on a contrasting background.

8.6. The *occupant load* of the occupied exterior area shall not exceed 300 occupants in accordance with Section 1004.

9. Locking devices are permitted on doors to balconies, decks or other exterior spaces serving individual *dwelling* or *sleeping units*.

10. Locking devices are permitted on doors to balconies, decks or other exterior spaces of 250 square feet (23.23 m²) or less, serving a private office space.

(Amd) **1010.2.6 Stairway doors.** Interior *stairway means of egress* doors shall be openable from both sides without the use of a key or special knowledge or effort.

Exceptions:

1. *Stairway* discharge doors shall be openable from the egress side and shall only be locked from the opposite side.

2. This section shall not apply to doors arranged in accordance with Section 403.5.3 of the *International Building Code* portion of the Connecticut State Building Code.

3. *Stairway* exit doors shall not be locked from the side opposite the egress side, unless they are openable from the egress side and capable of being unlocked simultaneously without unlatching by all of the following methods:

3.1. Shall be capable of being unlocked individually or simultaneously upon a signal from the *fire command center*, where present, or a signal by emergency personnel from a single location inside the main entrance to the building.

3.2. Shall unlock simultaneously upon activation of a fire alarm signal when a *fire alarm system* is present in an area served by the stairway.

3.3. Shall unlock upon failure of the power supply to the electric lock or the locking system.

4. *Stairway* exit doors shall be openable from the egress side and shall only be locked from the opposite side in Group B, F, M and S occupancies where the only interior access to the tenant space is from a single *exit stairway* where permitted in Section 1006.3.4.

5. *Stairway* exit doors shall be openable from the egress side and shall only be locked from the opposite side in Group R-2 occupancies where the only interior access to the *dwelling unit* is from a single *exit stairway* where permitted in Section 1006.3.4.

(Amd) **1010.2.14 Elevator lobby exit access doors.** Electrically locked *exit access* doors providing egress from elevator lobbies shall the following conditions:

Note: 1016.2 Egress through intervening spaces also addresses elevator lobby locking.

1. For all occupants of the floor, the path of *exit access* travel to not less than two *exits* is not required to pass through the elevator lobby.
2. The building is equipped throughout with an *automatic sprinkler system* in accordance with Section 903.3.1.1, and a *fire alarm system* in accordance with Section 907. Elevator lobbies shall be provided with an *approved automatic smoke detection system* in accordance with Section 907.
3. Upon activation of either the *automatic sprinkler system* or automatic smoke detection system, the building *fire alarm system* by means other than a manual fire alarm box shall automatically unlock the electric locks providing exit access from

Comply with

Move to after #8.

the elevator lobbies, and the electric locks shall remain unlocked until the *fire alarm system* is reset.

4. The electric locks shall unlock on loss of power to the electric locks or electrical locking system.
5. The electric locks shall have the capability of being unlocked by a switch located at the *fire command center*, security station or other *approved* location.
6. A two-way communication system complying with Sections 1009.8.1 and 1009.8.2, shall be located in the elevator lobby adjacent to the electrically locked *exit access* door and connected to an *approved* constantly attended station. This constantly attended station shall have the capability of unlocking the electric locks of the elevator lobby *exit access* doors.
7. Emergency lighting shall be provided in the elevator lobby on both sides of the electrically locked door.
8. The electro-mechanical or electromagnetic locking device shall be listed in accordance with either UL 294 or UL 1034.

(Amd) **1011.5.2 Riser height and tread depth.** *Stair* riser heights shall be 7 inches (178 mm) maximum and 4 inches (102 mm) minimum. The *stair* riser height shall be measured vertically between the *nosings* of adjacent treads or between the *stairway* landing and the adjacent tread. Rectangular tread depth shall be 11 inches (279 mm) minimum measured horizontally between the vertical planes of the foremost projection of adjacent treads and at a right angle to the tread's *nosing*. *Winder* treads shall have a minimum tread depth of 11 inches (279 mm) between the vertical planes of the foremost projection of adjacent treads at the intersections with the walkline and a minimum tread depth of 10 inches (254 mm) within the clear width of the *stair*.

Exceptions:

1. *Alternating tread devices* in accordance with Section 1011.14.
2. Ships' ladders in accordance with Section 1011.15.
3. *Spiral stairways* in accordance with Section 1011.10.
4. Aisle stairs in assembly seating areas where the *stair* pitch or slope is set, for sightline reasons, by the slope of the adjacent seating area in accordance with Section 1030.14.2.
5. In *Group R-1 bed and breakfast establishments*; Group R-3 occupancies; within *dwelling units* in Group R-2 occupancies not required by Chapter 11 to be *Accessible* or *Type A* dwelling or sleeping units; and in Group U occupancies that are accessory to Group R-3 occupancies, or accessory to individual *dwelling units* in Group R-2 occupancies; the maximum riser height shall be 8-1/4 inches (210 mm) and the minimum tread depth shall be 9 inches (229 mm); the minimum *winder* tread depth at the walkline shall

be 10 inches (254 mm); and the minimum *winder* tread depth shall be 6 inches (152 mm). A *nosing* not less than $\frac{3}{4}$ inch (19.1 mm) but not more than 1- $\frac{1}{4}$ inches (32 mm) shall be provided on *stairways* with solid risers where the tread depth is less than 11 inches (279 mm).

6. The riser height and tread depth of existing *stairways* in buildings undergoing addition, alteration, repair, relocation or change of occupancy that involve the existing *stairways* shall be permitted to remain, provided the greatest riser height within any flight of *stairs* shall not exceed the smallest by $\frac{3}{8}$ inch (9.5 mm) and the greatest tread depth within any flight of stairs shall not exceed the smallest by $\frac{3}{8}$ inch (9.5mm).
7. See Section 503.1 of the *International Existing Building Code* portion of the Connecticut State Building Code for the replacement of existing *stairways*.
8. In Group I-3 facilities, *stairways* providing access to guard towers, observation stations and control rooms, not more than 250 square feet (23 m²) in area, shall be permitted to have a maximum riser height of 8 inches (203 mm) and a minimum tread depth of 9 inches (229 mm).

(Amd) **1011.5.3 Winder treads.** *Winder* treads are not permitted in *means of egress stairways* except within a *dwelling unit* and within existing detached one- and two-family dwellings undergoing a change of occupancy to *Group R-1 bed and breakfast establishments*.

Exceptions:

1. Curved *stairways* in accordance with Section 1011.9.
2. *Spiral stairways* in accordance with Section 1011.10.

(Amd) **1011.7.2 Outdoor conditions.** Outdoor *stairways* and outdoor approaches to *stairways* shall be designed so that water will not accumulate on walking surfaces. In other than occupancies in Group R-3, and occupancies in Group U that are accessory to an occupancy in Group R-3, treads, platforms and landings that are part of exterior *stairways* shall be protected to prevent the accumulation of snow and ice.

(Amd) **1011.11 Handrails.** *Flights of stairways* shall have *handrails* on each side and shall comply with Section 1014. Where glass is used to provide the *handrail*, the *handrail* shall also comply with Section 2407 of the *International Building Code* portion of the Connecticut State Building Code.

Exceptions:

1. *Flights of stairways* within *dwelling units* and *Group R-1 bed and breakfast establishments* and *spiral stairways* are permitted to have a *handrail* on one side only.


2. Decks, patios and walkways that have a single change in elevation where the landing depth on each side of the change in elevation is greater than what is required for a landing do not require *handrails*.
3. In Group R-3 occupancies, a change in elevation consisting of a single riser at an entrance or egress door does not require *handrails*.
4. Changes in room elevations of three or fewer risers within *dwelling units* and *sleeping units* in *Group R-1 bed and breakfast establishments* and Groups R-2 and R-3 occupancies do not require *handrails*.
5. Where a platform lift is in a stationary position and the floor of the platform lift serves as the upper landing of a *stairway*, *handrails* shall not be required on the *stairway*, provided that all of the following criteria are met:
 - 5.1. The *stairway* contains not more than two risers.
 - 5.2. A handhold, positioned horizontally or vertically, is located on one side of the *stairway* adjacent to the top landing.
 - 5.3. The handhold is located not less than 34 inches (864 mm) and not more than 42 inches (1067 mm) above the bottom landing of the *stairway*.
 - 5.4. The handhold gripping surface complies with Section 1014.3 and is not less than 4.5 inches (114 mm) in length.

(Add) **1013.1.1 Accessible exits.** Where *exit* signs are required by Section 1013.1 of this code, *accessible exit* doors at the *level of exit discharge* that lead directly to *accessible paths of exit discharge* shall additionally be marked by the International Symbol of Accessibility. Such symbol shall be not less than 6 inches (152 mm) high and shall be incorporated into the required *exit* sign or shall be located directly adjacent to it. Such symbol shall meet the requirements of Section 1013.

(Amd) **1013.2 Low-level exit signs.** Where *exit* signs are required from a room or space in Group R-1 occupancies, Group I-2 occupancies, and Group R-2 dormitories by Section 1013.1, additional low-level *exit* signs shall be provided at *exit* doors within *exit access corridors* serving *guest rooms* in Group R-1 occupancies, patient and client sleeping areas of Group I-2 occupancies, and sleeping areas in Group R-2 dormitories and shall comply with Section 1013.5.

The bottom of the sign shall be not less than 10 inches (254 mm) nor more than 12 inches (305 mm) above the floor level. The sign shall be flush mounted to the door or wall on the same plane as the door. Where mounted on the wall, the edge of the sign shall be within 4 inches (102 mm) of the door frame on the latch side.

Exceptions:

- 1) Low-level *exit* signs are not required in Group R-1 occupancies, Group 1-2 occupancies, and Group R-2 dormitories when the building is equipped throughout with an *automatic sprinkler system* installed in accordance with Section 903.3.1.1 or 903.3.1.2.
- 2) *Group R-1 bed and breakfast establishments* 

(Amd) **1014.10 Intermediate handrails.** *Stairways* shall have intermediate *handrails* located in such a manner that all portions of the *stairway* width exceeding 75 inches (1,905 mm) required for *egress* capacity are within 30 inches (762 mm) of a *handrail*. On monumental *stairs*, *handrails* shall be located along the most direct path of *egress* travel.

(Amd) **1015.3 Height.** Required *guards* shall not be less than 42 inches (1,067 mm) high, measured vertically as follows:

1. From the adjacent walking surfaces.
2. On *stairways*, and stepped *aisles*, from the line connecting the *nosings*.
3. On *ramps* and ramped *aisles*, from the *ramp* surface at the *guard*.

Exceptions:

1. For occupancies in Group R-3 not more than three stories above grade in height, and within individual *dwelling units* in occupancies in Group R-2 not more than three stories above grade in height with separate *means of egress*, required *guards* shall not be less than 36 inches (914 mm) in height measured vertically above the adjacent walking surfaces.
2. For occupancies in Groups R-2 and R-3, within the interior conditioned space of individual *dwelling units*, where the open-sided walking surface is located not more than 25 feet (7.62 meters) measured vertically to the floor or walking surface below, required *guards* shall not be less than 36 inches (914 mm) in height measured vertically above the adjacent walking surface.
3. For occupancies in Group R-3, and within individual *dwelling units* in occupancies in Group R-2, *guards* on the open sides of *stairs* shall have a height not less than 34 inches (864 mm) measured vertically from a line connecting the *nosings*.
4. For occupancies in *Group R-1 bed and breakfast establishments*, Group R-3, and within individual *dwelling units* in occupancies in Group R-2, where the top of the *guard* also serves as a *handrail* on the open sides of *stairs*, the top of the *guard* shall not be less than 34 inches (864 mm) and not more than 38 inches (965 mm) measured vertically from a line connecting the *nosings*.

5. The *guard* height in assembly seating areas shall be in accordance with Section 1030.17 as applicable.
6. Along *alternating tread devices* and ship ladders, *guards* whose top rail also serves as a *handrail* shall have a height not less than 30 inches (762 mm) and not more than 34 inches (864 mm) measured vertically from a line connecting the leading edge of the treads.
7. In group F occupancies where *exit access stairways* serve fewer than three stories and such stairways are not open to the public, and where the top of the *guard* also serves as a *handrail*, the top of the *guard* shall be not less than 34 inches (864 mm) and not more than 38 inches (965 mm) measured vertically from the nosings.
8. For occupancies in *Group R-1 bed and breakfast establishments*, level *guards* shall be not less than 36 inches (914 mm) high, measured vertically above the adjacent walking surface.

(Amd) **1015.4 Opening limitations.** Required *guards* shall not have openings which allow passage of a sphere 4 inches (102 mm) in diameter from the walking surface to the required *guard* height.

Exceptions:

1. From a height of 36 inches (914 mm) to 42 inches (1067 mm), *guards* shall not have openings which allow passage of a sphere 4³/₈ inches (111 mm) in diameter.
2. The triangular openings at the open side of a *stair*, formed by the riser, tread and bottom rail shall not allow passage of a sphere 6 inches (152 mm) in diameter.
3. At elevated walking surfaces for access to and use of electrical, mechanical or plumbing systems or equipment, *guards* shall not have openings which allow passage of a sphere 21 inches (533 mm) in diameter.
4. In areas that are not open to the public within occupancies in Group I-3, F, H or S, and for *alternating tread devices* and ship ladders, *guards* shall not have openings which allow passage of a sphere 21 inches (533 mm) in diameter.
5. In assembly seating areas, *guards* required at the end of aisles in accordance with Section 1030.17.4 shall not have openings which allow passage of a sphere 4 inches (102 mm) in diameter up to a height of 26 inches (660 mm) above adjacent walking surfaces. From a height of 26 inches (660 mm) to 42 inches (1067 mm) above the adjacent walking surfaces, *guards* shall not have openings which allow passage of a sphere 8 inches (203 mm) in diameter.
6. Within individual *dwelling units* and *sleeping units* in Group R-2 and R-3 occupancies, *guards* on the open sides of *stairs* shall not have openings which allow passage of a sphere 4³/₈ inches (111 mm) in diameter.

7. In *Group R-1 bed and breakfast establishments*, guards shall have balusters or ornamental patterns such that a sphere 6 inches (152mm) in diameter cannot pass through any opening.

(Amd) **1015.8 Window openings.** Windows in *Group R-2 and R-3 buildings including dwelling units*, where the bottom of the clear opening of an operable window is located less than 36 inches (914 mm) above the finished floor and more than 72 inches (1829 mm) above the finished grade or other surface below on the exterior of the *building*, shall comply with the following:

1. Where the bottom of the clear opening of the window is located more than 72 inches (1829 mm) and less than 75 feet (22,860 mm) above the finished grade or other surface below on the exterior of the *building*, the window shall comply with one of the following:

- 1.1. Operable windows where the openings will not allow a ~~4-inch-diameter~~ (102 mm) ~~sphere~~ to pass through the opening when the window is in its largest opened position, provided that the opening is not required for emergency escape or rescue.

in diameter

sphere that is 4 inches

- 1.2. Operable windows where the openings are provided with window fall prevention devices that comply with ASTM F2090.

- 1.3. Operable windows where the openings are provided with window opening control devices that comply with ASTM F2090. The window opening control device, after operation to release the control device allowing the window to fully open, shall not reduce the minimum net clear opening area of the window unit to less than the area required by Section 1031.3.1 for *emergency escape and rescue openings*.

2. Where the bottom of the clear opening of the window is located 75 feet (22,860 mm) or more above the finished grade or other surface below on the exterior of the *building*, the window shall comply with one of the following:

- 2.1. Operable windows where the openings are provided with window fall prevention devices that comply with ASTM F2090.

- 2.2. Operable windows where the openings will not allow a ~~4-inch-diameter~~ (102 mm) ~~sphere~~ to pass through the opening when the window is in its largest opened position.

in diameter

sphere that is 4 inches

- 2.3. Window fall prevention devices that comply with ASTM F2006.

(Add) **1015.9 Retaining walls.** Retaining walls where the difference in height between the finished grade at the top of the wall and the finished grade at the bottom of the wall is

greater than 4 feet (1,219 mm) shall be provided with *guards* complying with Sections 1015.3, 1015.4 and 1607.9 when a walking surface, parking lot or driveway is located closer than 2 feet (610 mm) from the edge of the top of the retaining wall. For the purpose of this section, grass, planting beds or landscaped areas shall not be considered a walking surface.

Justify text, below

(Amd) **1019.3 Occupancies other than Groups I-2 and I-3.** In other than Group I-2 and I-3 occupancies, floor openings containing *exit access stairways* or *ramps* that do not comply with one of the exceptions listed in this section shall be enclosed with a shaft enclosure constructed in accordance with Section 713 of the *International Building Code* portion of the Connecticut State Building Code.

Exceptions:

1. *Exit access stairways* and *ramps* ^{are} in buildings equipped throughout with an *automatic sprinkler system* in accordance with Section 903.3 and within a two-story opening complying with Section 712.1.9 of the *International Building Code* portion of the Connecticut State Building Code. If the *exit access stairways* or *ramps* are open to corridors, the opening shall be protected in accordance with the method detailed for protection of *vertical openings* in NFPA 13.
2. In Group E occupancies, *exit access stairways* and *ramps* within a two-story opening shall comply with all of the following:

- The access stairway or ramp
- 2.1 ^{is in a} The building is equipped throughout with an *automatic sprinkler system* in accordance with Section 903.3.1.1.
 - 2.2 ^{is} protected in accordance with Section 712.1.9 of the *International Building Code* portion of the Connecticut State Building Code.
 - 2.3 ^{is} not open to a corridor.

3. In Group R-1, R-2 and R-3 occupancies, *exit access stairways* and *ramps* connecting ~~four~~ stories ~~or less~~ serving and contained within a single residential *dwelling unit* or *sleeping unit* or *live/work unit*.

or fewer

4. *Exit access stairways* connecting the first and second floors of *Group R-1 bed and breakfast establishments*. *Stairways* connecting the second and third floors in such occupancies shall be enclosed with fire separation assemblies having a fire-resistance rating of not less than 1 hour. *Stairways* connecting the basement and the first floor occupancies shall be enclosed with fire partitions having a fire-resistance rating of not less than 1/2 hour with 20-minute fire-resistance rated door assemblies. Fire-resistance assemblies at stairways in *Group R-1 bed and breakfast establishments* shall not be required to be supported by fire-resistance rated construction.

Justify text

5. *Exit access stairways* serving and contained within a Group R-3 congregate residence or a Group R-4 facility are not required to be enclosed.
6. *Exit access stairways* and *ramps* within an *atrium* complying with the provisions of Section 404 of the *International Building Code* portion of the Connecticut State Building Code.
7. *Exit access stairways* and *ramps* in open parking garages that serve only the open parking garage.
8. *Exit access stairways* and *ramps* serving smoke-protected or open-air assembly seating complying with the *exit access* travel distance requirements of Section 1030.7.
9. *Exit access stairways* and *ramps* between the balcony, gallery or press box and the main assembly floor in occupancies such as theaters, *places of religious worship*, auditoriums and sport facilities.
10. *Stairways* serving outdoor facilities where all portions of the means of egress are significantly open to the outside or exterior *exit access stairways* or *ramps* between *occupiable* roofs.
11. *Exit access stairways* serving mezzanines complying with the provisions of Section 505 of the *International Building Code* portion of the Connecticut State Building Code.

(Add) **1020.1.1 Group R-1 bed and breakfast establishments.** A fire-resistance rating is not required for *corridors* in *Group R-1 bed and breakfast establishments*. Doors leading from guest rooms into *corridors* or hallways in Group R-1 bed and breakfast establishments shall be equipped with self-closing devices.

(Amd) **1020.2 Construction.** *Corridors* shall be *fire-resistance rated* in accordance with Table 1020.2. The *corridor* walls required to be *fire-resistance rated* shall comply with Section 708 of the *International Building Code* portion of the Connecticut State Building Code for *fire partitions*.

Exceptions:

1. A *fire-resistance rating* is not required for *corridors* in an occupancy in Group E where each room that is used for instruction has not less than one door opening directly to the exterior and rooms for assembly purposes have not less than one-half of the required *means of egress* doors opening directly to the exterior. Exterior doors specified in this exception are required to be at ground level.

2. A *fire-resistance rating* is not required for *corridors* contained within a *dwelling unit* or *sleeping unit* in an occupancy in Groups I-1 and R.

3. A *fire-resistance rating* is not required for *corridors* in open parking garages.

4. A *fire-resistance rating* is not required for *corridors* in an occupancy in Group B that is a space requiring only a single *means of egress* complying with Section 1006.2.

5. *Corridors* adjacent to the *exterior walls* of buildings shall be permitted to have unprotected openings on unrated *exterior walls* where unrated walls are permitted by Table 705.5 of the *International Building Code* portion of the Connecticut State Building Code and unprotected openings are permitted by Table 705.9 of the *International Building Code* portion of the Connecticut State Building Code.

bold
(Amd) **TABLE 1020.2**
CORRIDOR FIRE-RESISTANCE RATING

OCCUPANCY	OCCUPANT LOAD SERVED BY CORRIDOR	REQUIRED FIRE-RESISTANCE RATING (hours)	
		WITHOUT automatic SPRINKLER SYSTEM	WITH automatic SPRINKLER SYSTEM ^c
H-1, H-2, H-3	All	Not Permitted	1
H-4, H-5	Greater than 30	Not Permitted	1
A, B, E, F, M, S, U	Greater than 30	1	0
R	Greater than 10	Not Permitted	0.5 ^c / 1 ^d
I-2 ^a	All	Not Permitted	0
I-1, I-3	All	Not Permitted	1 ^{b, c}
I-4	All	1 ^e	0

a. For requirements for occupancies in Group I-2, see Sections 407.2 and 407.3 of the International Building Code portion of the Connecticut State Building Code.

b. For a reduction in the *fire-resistance rating* for occupancies in Group I-3, see Section 408.8 of the International Building Code portion of the Connecticut State Building Code.

c. *Buildings* equipped throughout with an *automatic sprinkler system* in accordance with Section 903.3.1.1 or 903.3.1.2 where allowed.

d. Group R-3 and R-4 *buildings* equipped throughout with an *automatic sprinkler system* in accordance with Section 903.3.1.3. See Section 903.2.8 for occupancies where *automatic sprinkler systems* are permitted in accordance with Section 903.3.1.3.

e. For Group I-4 day care facilities that satisfy Section 903.2.6, Exception 2, a *corridor fire-resistance rating* of zero (~~0~~) shall be permitted.

(Add) **1022.3 Group M occupancies.** In mercantile occupancies other than bulk merchandising retail buildings, if the only means of customer entrance is through one exterior wall of a *building*, one-half of the required egress width from the street floor shall be located in such wall. For the purpose of this section, bulk merchandising retail *building* is defined as a *building* exceeding 12,000 square feet (1,115 m²) in area in which the sales area includes the storage of combustible materials on pallets, in solid piles, or in racks in excess of 12 feet (3,658 mm) in storage height.

(Add) **1028.4.1 Remoteness.** Where two or more doors leading to *exit discharge* are required, a minimum of two such doors shall be placed a distance apart equal to not less than one-third of the length of the maximum overall diagonal dimension of the building served, measured in a straight line between doors. Additional doors leading to *exit discharge* shall be arranged a reasonable distance apart so that if one becomes blocked, the others will be available.

(Amd) **1030.2 Assembly main exit.** Pursuant to section 29-381a of the Connecticut General Statutes, in a *building*, room or space used for assembly purposes and provided with a single main entrance/*exit*, the main *exit* shall be of sufficient width to accommodate not less than two-thirds of the occupant load, but such width shall not be less than the total required width of all *means of egress* leading to the *exit*. This applies to Group A occupancies that are newly constructed, have an increase in the number of occupants by addition or alteration or are created by change of occupancy. Where the building is classified as a Group A occupancy, the main *exit* shall front on at least one street or an unoccupied space of not less than 10 feet (3,048 mm) in width that adjoins a street or *public way*. In a *building*, room or space used for assembly purposes where there is no well-defined main entrance/*exit* or where multiple main entrances/*exits* are provided, *exits* shall be permitted to be distributed around the perimeter of the building provided the total width of egress is not less than 100 percent of the required width.

(Amd) **1031.2 Where required.** In addition to the *means of egress* required by this chapter, *emergency escape and rescue openings* shall be provided in the locations described in Sections 1031.2.1 through 1031.2.6. Such openings shall open directly into a *public way* or to a *yard* or *court* that opens to a *public way*, or to an egress balcony that leads to a public way.

Exception: Storm shelters are not required to comply with this section where the shelter is constructed in accordance with ICC 500.

(Add) (Amd) **1031.2.2 Basements.** *Basements* and *sleeping rooms* below the fourth story above grade plane shall have not fewer than one *emergency escape and rescue opening* in accordance with this section. Where *basements* contain one or more sleeping rooms,

an *emergency escape and rescue opening* shall be required in each sleeping room but shall not be required in adjoining areas of the *basement*.

Exceptions:

1. *Basements* with a ceiling height of less than 80 inches (2032 mm) shall not be required to have *emergency escape and rescue openings*.
2. *Emergency escape and rescue openings* are not required from *basements* or sleeping rooms that have an *exit door* or *exit access door* that opens directly into a *public way* or to a *yard, court* or exterior egress balcony that leads to a *public way*.
3. *Basements* without *habitable spaces* and having not more than 200 square feet (18.6 m²) in floor area shall not be required to have *emergency escape and rescue openings*.
4. Within individual *dwelling and sleeping units* in Groups R-2 and R-3, where the building is equipped throughout with an *automatic sprinkler system* installed in accordance with Section 903.3.1.1, 903.3.1.2 or 903.3.1.3, *sleeping rooms in basements* shall not be required to have *emergency escape and rescue openings* provided that the basement has one of the following:
 - 4.1. One *means of egress* and one *emergency escape and rescue opening*.
 - 4.2. Two *means of egress*.

(Add) **1031.2.3 Group E.** *Emergency escape and rescue openings* shall be provided in every room or space greater than 250 square feet (23.23 m²) used for classroom or educational purposes or normally subject to student occupancy.

Exceptions:

1. *Buildings* protected throughout by an *approved automatic sprinkler system* in accordance with Section 903.3.1.1.
2. Rooms or spaces that have a door leading directly to the outside of the *building*.

(Add) **1031.2.4 Group R-2.** *Emergency escape and rescue openings* shall be provided in *stories* with only one *exit* or access to only one *exit* as permitted by Tables 1006.3.4(1) and 1006.3.4(2) or utilizing an exception to 903.2.8.

(Add) **1031.2.5 Group R-3 and R-4.** *Emergency escape and rescue openings* shall be provided in all Group R-3 and R-4 occupancies.

occupancies
(Add) **1031.2.6 Group I-4.** *Emergency escape and rescue openings* shall be provided in every room or space greater than 250 square feet (23.23 m²) normally subject to client occupancy.

Exceptions:

1. *Buildings* protected throughout by an *approved automatic sprinkler system* in accordance with Section 903.3.1.1.
2. Rooms or spaces that have a door leading directly to the outside of the *building*.

(Amd) **1031.3.2 Minimum dimensions.** The minimum net clear opening height dimension shall be 24 inches (610 mm). The minimum net clear opening width dimension shall be 20 inches (508 mm). The net clear opening dimensions shall be the result of normal operation of the opening.

Exception: In *existing* buildings undergoing a change of occupancy to *Group R-1 bed and breakfast establishments*, the net clear opening dimensions may be obtained by removal of the sash without the use of a key or tool provided the instructions for the removal of the sash are clearly posted on the inside of the guest room door.

(Amd) **1031.3.3 Maximum height from floor.** *Emergency escape and rescue openings* shall have the bottom of the clear opening not greater than 44 inches (1,118 mm) measured from the floor.

Exception: In an *existing* building undergoing a change of use, the 44-inch (1,118 mm) maximum height may be measured vertically above a fixed, permanent platform, step or steps whose minimum width shall equal or exceed the operable width of the opening and shall be centered on such opening. Any stairs or steps shall comply with Section 1011.5.

(Add) **1032.2.4 Inspection of door openings.** Door openings shall be inspected in accordance with the requirements of NFPA 80.

bold

CHAPTER 11

(Amd) CODE REQUIREMENTS FOR EXISTING BUILDINGS

justify text

(Amd) **1101.2 Intent.** The intent of this chapter is to provide a minimum degree of fire and life safety to persons occupying *existing buildings* by providing minimum code requirements where such *existing buildings* do not comply with the minimum requirements found elsewhere in this code.

Justify text

(Amd) **1101.3 Construction Feature Conflicts** Conflicts with construction features within *existing buildings* shall comply with Sections 1101.3.1 and 1101.3.2.

(Add) **1101.3.1 On or after January 1, 2006**. Where a conflict exists between a provision in this Chapter and a code requirement in effect at the time of construction for buildings built on or after January 1, 2006, the state codes at the time of construction shall prevail.

(Add) **1101.3.2 Prior to January 1, 2006**. Where this Chapter does not address a specific construction feature that is permitted within Part IV of the 2022 Connecticut State Fire Safety Code for buildings built prior to January 1, 2006, Part IV of the 2022 Connecticut State Fire Safety Code shall prevail.

Note: All previous editions of the Connecticut State Fire Safety Code are listed under Appendix A.

(Del) **1101.4 Owner notification**. Delete section in its entirety.

(Amd) **1103.1 Required construction**. *Existing buildings* shall comply with not less than the minimum provisions specified in Table 1103.1 and as further enumerated in Sections 1103.2 through 1103.10.

The provisions of this chapter shall not be construed to allow the elimination of *fire protection systems* or a reduction in the level of fire safety provided in *buildings* constructed in accordance with previously adopted codes. No *existing* life safety feature shall be removed or reduced where such feature is a requirement for new construction.

Exceptions:

1. Where a change in *fire-resistance rating* has been *approved* in accordance with Section 501.2 or 802.6 of the *International Existing Building Code* portion of the Connecticut State Building Code.
2. Group U occupancies.

(Amd) **1103.1.1 Historic buildings**. Historic buildings shall be evaluated on a case-by-case basis with use of the code modification process in accordance with section 29-296 of the Connecticut General Statutes.

(Amd) **1103.2 Emergency responder communications enhancement in existing buildings**. *Existing buildings* other than Group R-3 that do not have *approved* in-building emergency response communications enhancement for emergency responders

Justify text

in the *building* based on *existing* coverage levels of the public safety communication systems, shall be equipped with such coverage according to one of the following:

1. Where an *existing* wired communication system cannot be repaired or is being replaced, or where not *approved* in accordance with Section 510.1, Exception 1.
2. Within a time frame established by the adopting authority.

Exception: Where it is determined by the *fire code official* in conjunction with the fire chief that the in-building emergency responder communications enhancement system is not needed.

(Amd) **1103.3 Existing elevators.** Existing elevators shall comply with Section 604.1.

(Del) **1103.3.1 Elevators, escalators and moving walks.** Delete section.

(Del) **1103.3.2 Elevator emergency operation.** Delete section.

(Amd) **1103.4.1 Group I and R occupancies.** In Group I and R occupancies, interior vertical openings connecting two or more stories shall be protected with 1-hour *fire-resistance-rated* construction.

Exceptions:

1. In Group I-2, unenclosed vertical openings not exceeding two connected stories and not concealed within the building construction shall be permitted as follows:

1.1. The unenclosed vertical openings shall be separated from other unenclosed vertical openings serving other floors by a *smoke barrier*.

1.2. The unenclosed vertical openings shall be separated from corridors by *smoke partitions*.

1.3. The unenclosed vertical openings shall be separated from other fire or *smoke compartments* on the same floors by a *smoke barrier*.

1.4. On other than the lowest level, the unenclosed vertical openings shall not serve as a required *means of egress*.

2. In Group I-2, atriums connecting three or more stories shall not require 1-hour *fire-resistance-rated* construction where the building is equipped throughout with an *automatic sprinkler system* installed in accordance with Section 903.3, and all of the following conditions are met:

Justify text

2.1. For other than *existing approved atriums* with a smoke control system, where the *atrium* was constructed and is maintained in accordance with the code in effect at the time the *atrium* was created, the atrium shall have a smoke control system that is in compliance with Section 909.

2.2. Glass walls forming a *smoke partition* or a glass-block wall assembly shall be permitted when in compliance with Condition 2.2.1 or 2.2.2.

2.2.1. Glass walls forming a *smoke partition* shall be permitted where all of the following conditions are met:

2.2.1.1. Automatic sprinklers are provided along both sides of the separation wall and doors, or on the room side only if there is not a walkway or occupied space on the atrium side.

2.2.1.2. The sprinklers shall be not more than 12 inches (305 mm) away from the face of the glass and at intervals along the glass of not greater than 72 inches (1829 mm).

2.2.1.3. Windows in the glass wall shall be non-operating type.

2.2.1.4. The glass wall and windows shall be installed in a gasketed frame in a manner that the framing system deflects without breaking (loading) the glass before the sprinkler system operates.

2.2.1.5. The sprinkler system shall be designed so that the entire surface of the glass is wet upon activation of the sprinkler system without obstruction.

2.2.2. A *fire barrier* is not required where a glass-block wall assembly complying with Section 2110 of the *International Building Code* portion of the Connecticut State Building Code and having $\frac{3}{4}$ -hour *fire protection rating* is provided.

2.3. Where doors are provided in the glass wall, they shall be either self-closing or automatic-closing and shall be constructed to resist the passage of smoke.

3. In Group I-3 occupancies, *exit stairways* or *ramps* and *exit access stairways* or *ramps* constructed in accordance with Section 408 in the

Justify text

International Building Code portion of the Connecticut State Building Code.

(Amd) **1103.4.2 Three to five stories.** In other than Group I-2 and I-3 occupancies, interior vertical openings connecting three to five stories shall be protected by 1-hour fire-resistance-rated construction.

Exceptions:

1. Vertical opening protection is not required for Group R-3 occupancies.
2. Vertical opening protection is not required for open parking garages.
3. Vertical opening protection for escalators shall be in accordance with Section 1103.4.5, 1103.4.6 or 1103.4.7.
4. *Exit access stairways and ramps* shall be in accordance with Section 1103.4.8.

(Amd) **1103.4.3 More than five stories.** In other than Group I-2 and I-3 occupancies, interior vertical openings connecting more than five stories shall be protected by 2 hour fire-resistance-rated construction.

Exceptions:

1. Vertical opening protection is not required for Group R-3 occupancies.
2. Vertical opening protection is not required for open parking garages.
3. Vertical opening protection for escalators shall be in accordance with Section 1103.4.5, 1103.4.6 or 1103.4.7.
4. *Exit access stairways and ramps* shall be in accordance with Section 1103.4.8.

(Amd) **1103.4.4 Atriums and covered malls.** In other than Group I-2 and I-3 occupancies, interior vertical openings in a covered mall building or a *building* with an *atrium* shall be protected by 1-hour fire-resistance-rated construction.

Exceptions:

1. Vertical opening protection is not required for Group R-3 occupancies.
2. Vertical opening protection is not required for open parking garages.
3. *Exit access stairways and ramps* shall be in accordance with Section 1103.4.8.

Justify text

(Amd) **1103.4.8 Occupancies other than Group I-2 and I-3.** In other than Group I-2 and I-3 occupancies, floor openings containing *exit access stairways* or *ramps* that do not comply with one of the conditions listed in this section shall be protected by 1-hour *fire-resistance-rated* construction.

1. *Exit access stairways* and *ramps* within a two-story opening in accordance with Section 1019.3 Exception 1 or 2.
2. In Group R-1, R-2 or R-3 occupancies, *exit access stairways* and *ramps* connecting four stories or less serving and contained within an individual *dwelling unit* or sleeping unit or live/work unit.
3. *Exit access stairways* and *ramps* within an *atrium* complying with the provisions of Section 404 of the *International Building Code* portion of the Connecticut State Building Code.
4. *Exit access stairways* and *ramps* in open parking garages that serve only the parking garage.
5. *Exit access stairways* and *ramps* serving open-air seating complying with the *exit access* travel distance requirements of Section 1030.7 of the *International Building Code* portion of the Connecticut State Building Code.
6. *Exit access stairways* and *ramps* serving the balcony, gallery or press box and the main assembly floor in occupancies such as theaters, places of religious worship, auditoriums and sports facilities.

(Add) **1103.4.8.1 Two-story openings not required for egress.** In other than Groups I-2 and I-3, unprotected openings connecting not more than two stories and not used as a component of the *means of egress* system shall be permitted in accordance with Section 712.1.9 of the *International Building Code* portion of the Connecticut State Building Code.

(Amd) **1103.4.9 Waste and linen chutes.** In Group I and R occupancies, *existing* waste and linen chutes shall comply with Sections 1103.4.9.1 ^{to} through 1103.4.9.5. ^{inclusive}

(Amd) **1103.5 Sprinkler systems.** An *automatic sprinkler system* shall be provided in *existing* buildings in accordance with Connecticut General Statute ~~29-315~~ and Sections 1103.5.1 through 1103.5.6. ^{to} ^{inclusive} ^{section 29-315 of the}

(Amd) **1103.5.1 Group A-2.** An *automatic sprinkler system* shall be installed in accordance with Section 903.3.1.1 throughout *existing* buildings or portions thereof used as Group A-2 occupancies with an occupant load of 300 or more for which a building permit for new occupancy was issued on or after April 15, 1987. The sprinkler system shall be installed throughout the story containing the assembly occupancy and

Justify text

any story below the assembly occupancy. In the case of an assembly occupancy located below the *level of exit discharge*, the sprinkler system shall be installed throughout the story containing the assembly occupancy, any story intervening between this story and the *level of exit discharge*, and the *level of exit discharge* story.

(Add) **1103.5.6 Group E.** In Group E occupancies built prior to January 1, 2006, where student occupancy exists below the *level of exit discharge*, every portion of such floor shall be protected throughout by an *approved automatic sprinkler system*.

Exceptions:

1. Where every classroom has at least one exterior *exit* door at ground level.
2. *Emergency Escape and Rescue* windows for rescue and ventilation are provided in accordance with Section 1104.27.1.

(Amd) **1103.7.1 Group A.** Assembly occupancies built prior to January 1, 2006, with occupant loads of more than 300 and all theaters with more than one viewing room shall be provided with an *approved fire alarm system* in accordance with Section 907.2.1.

(Amd) **1103.7.2 Group B.** A fire alarm system in accordance with Section 907.2.2 shall be installed in all business occupancies built prior to January 1, 2006, where any one of the following conditions exists:

1. The building is three or more stories in height.
2. The occupancy is subject to 100 or more occupants above or below the level of exit discharge.
3. The occupancy is subject to 1000 or more total occupants.

(Amd) **1103.7.3 Group E.** A *fire alarm system* shall be installed in *existing* Group E occupancies in accordance with Section 907.2.3.

Exceptions:

1. A manual *fire alarm system* is not required in a *building* with a maximum area of 1,000 square feet (93 m²) that contains a single classroom and is located not closer than 50 feet (15 m) from another building.
2. A manual *fire alarm system* is not required in Group E occupancies with an occupant load less than 50.

(Amd) **1103.7.4 Group F.** A fire alarm system shall be installed in Group F occupancies built prior to January 1, 2006, unless the total occupant load of the building is less than

Justify text

100 persons, and unless, of these, fewer than 25 persons are above or below the *level of exit discharge*.

(Amd) **1103.7.5 Group I-1.** An automatic *fire alarm system* shall be installed in *existing* Group I-1 facilities in accordance with Section 907.2.6.1.

Exception: Where each sleeping room has a *means of egress* door opening directly to an exterior egress balcony that leads directly to the *exits* in accordance with Section 1021, and the building is not more than three stories in height.

(Amd) **1103.7.6 Group I-2.** In Group I-2, an automatic *fire alarm system* shall be installed in accordance with Section 1105.10.

(Add) **1103.7.7 Group I-3.** An automatic and manual *fire alarm system* shall be installed in *existing* Group I-3 occupancies in accordance with Section 907.2.6.3.

(Add) **1103.7.8 Group I-4.** An automatic and manual *fire alarm system* shall be installed in *existing* day-care occupancies built prior to January 1, 2006, other than day-care occupancies housed in one room, in accordance with Section 907.2.3.

(Add) **1103.7.9 Group M.** A *fire alarm system* shall be installed in *existing* Group M occupancies built prior to January 1, 2006, having an aggregate gross area of more than 30,000 square feet (2,787 m²) or occupying more than three stories for sales purposes.

(Add) **1103.7.10 Group R-1.** A *fire alarm system* and *smoke alarms* shall be installed in *existing* Group R-1 occupancies in accordance with Sections 1103.7.10.1 through ~~to~~ 1103.7.10.2.1. *inclusive*

(Add) **1103.7.10.1 Group R-1 hotel and motel manual fire alarm system.** A manual fire alarm system that activates the occupant notification system in accordance with Section 907.5 shall be installed in existing Group R-1 hotels and motels more than three stories or with more than 20 *sleeping units*. *of*

Exceptions:

1. Buildings *fewer* than two stories in height where all *sleeping units*, attics and crawl spaces are separated by 1-hour *fire-resistance-rated* construction and each *sleeping unit* has direct access to a public way, egress court or yard.
2. *Manual fire alarm boxes* are not required throughout the building where the following conditions are met:

justify text

2.1. The building is equipped throughout with an *automatic sprinkler system* installed in accordance with Section 903.3.1.1 or 903.3.1.2.

2.2. The notification appliances will activate upon sprinkler water flow.

2.3. Not less than one *manual fire alarm box* is installed at an *approved* location.

(Add) **1103.7.10.1.1 Group R-1 hotel and motel automatic smoke detection system.**

An automatic smoke detection system that activates the occupant notification system in accordance with Section 907.5 shall be installed in existing Group R-1 hotels and motels throughout all interior *corridors* serving sleeping rooms not equipped with an *approved, supervised automatic sprinkler system* installed in accordance with Section 903.

Exception: An automatic smoke detection system is not required in buildings that do not have interior *corridors* serving sleeping units and where each sleeping unit has a *means of egress* door opening directly to an *exit* or to an exterior *exit access* that leads directly to an *exit*.

(Add) **1103.7.10.2 Group R-1 boarding and rooming houses manual fire alarm system.** A manual *fire alarm system* that activates the occupant notification system in accordance with Section 907.5 shall be installed in *existing* Group R-1 boarding and rooming houses.

Exception: Buildings less than two stories in height where all *sleeping units*, attics and crawl spaces are separated by 1-hour *fire-resistance-rated* construction and each *sleeping unit* has direct access to a *public way, egress court* or yard.

(Add) **1103.7.10.2.1 Group R-1 boarding and rooming houses automatic smoke detection system.** An automatic smoke detection system that activates the occupant notification system in accordance with Section 907.5 shall be installed in *existing* Group R-1 boarding and rooming houses throughout all interior *corridors* serving *sleeping units* not equipped with an *approved, supervised automatic sprinkler system* installed in accordance with Section 903.

Exception: Buildings equipped with *single-station smoke alarms* meeting or exceeding the requirements of Section 907.2.11.1 and where the *fire alarm system* includes not less than one *manual fire alarm box* per floor arranged to initiate the alarm.

Justify text

(Add) **1103.7.11 Group R-2.** A manual *fire alarm system* that activates the occupant notification system in accordance with Section 907.5 shall be installed in existing Group R-2 occupancies more than three stories in height or with more than 11 *dwelling or sleeping units*.

Exceptions:

1. Where each *living* unit is separated from other contiguous *living* units by *fire barriers* having a *fire-resistance rating* of not less than $\frac{3}{4}$ -hour, and where each *living* unit has either its own independent *exit* or its own independent *stairway* or *ramp* discharging at grade.

2. A separate *fire alarm system* is not required in buildings that are equipped throughout with an *approved supervised automatic sprinkler system* installed in accordance with Section 903.3.1.1 or 903.3.1.2 and having a local alarm to notify all occupants.

3. A *fire alarm system* is not required in buildings that do not have interior corridors serving *dwelling units* and are protected by an *approved automatic sprinkler system* installed in accordance with Section 903.3.1.1 or 903.3.1.2, provided that *dwelling units* either have a *means of egress* door opening directly to an exterior *exit access* that leads directly to the *exits* or are served by open-ended *corridors* designed in accordance with Section 1027.6, Exception 3.

4. A *fire alarm system* is not required in buildings that do not have interior corridors serving *dwelling units*, do not exceed three stories in height and comply with both of the following:

4.1. Each *dwelling unit* is separated from other contiguous *dwelling units* by *fire barriers* having a *fire-resistance rating* of not less than $\frac{3}{4}$ -hour.

4.2. Each *dwelling unit* is provided with hard-wired, interconnected *smoke alarms* as required for new construction in Section 907.2.11.

(Add) **1103.7.12 Group R-4.** A manual *fire alarm system* that activates the occupant notification system in accordance with Section 907.5 shall be installed in existing Group R-4 residential care/assisted living facilities built prior to January 1, 2006, in accordance with Section 907.2.8.1.

Exceptions:

1. Where there are interconnected *smoke alarms* meeting the requirements of Section 907.2.11 and there is not less than one *manual fire alarm box* per floor arranged to continuously sound the smoke alarms.

Just
dwelling
or dwelling
or sleeping

justify text

Where there are

2) Other manually activated, continuously sounding alarms approved by the fire code official.

(Amd) **1103.8.1 Where required.** Existing Group I-1 and R occupancies shall be provided with *single-station smoke alarms* in accordance with Section 907.2.11. Interconnection and power sources shall be in accordance with Sections 1103.8.2 and 1103.8.3, respectively.

Exceptions:

1. Where the code that was in effect at the time of construction required smoke alarms and *smoke alarms* complying with those requirements are already provided.
2. Where *smoke alarms* have been installed in occupancies and *dwellings* that were not required to have them at the time of construction, additional *smoke alarms* shall not be required provided that the *existing smoke alarms* comply with requirements that were in effect at the time of installation.
3. Where smoke detectors connected to a *fire alarm system* have been installed as a substitute for *smoke alarms*.
4. For *existing* Group R-2 occupancies built prior to June 15, 1994 and *existing one- and two-family dwellings* built prior to April 25, 1997, *smoke alarms* are not required in sleeping rooms.

(Add) **1103.8.1.1 Visible Notification.** In Group R-1 occupancies built prior to January 1, 2006, having 100 or more units or rooms shall install such equipment which, when activated, shall provide an *approved* visible alarm suitable to warn occupants, in at least one percent of the units or rooms in such establishments. In establishments having less than 100 units or rooms, at least one unit or room shall have such an alarm.

(Amd) **1103.8.2 Interconnection.** Where more than one *smoke alarm* is required to be installed within an individual *dwelling* or *sleeping unit*, the *smoke alarms* shall be interconnected in such a manner that the activation of one alarm will activate all of the alarms in the individual unit. Physical interconnection of *smoke alarms* shall not be required where *listed* wireless alarms are installed and all alarms sound upon activation of one alarm. The alarm shall be clearly audible in all bedrooms over background noise levels with all intervening doors closed.

Exception: Interconnection is not required in *existing* buildings where an *installation* existed prior to October 16, 1989. *before January 1, 1990.* *(see 29-453 cc) (a) (2) (c) (3)*

(Amd) **1103.8.3 Power source.** Where a building permit for new occupancy was issued on or after October 1, 1976, *single-station smoke alarms* shall receive their primary

Justify text

power from the building wiring provided that such wiring is served from a commercial source. Where a building permit for new occupancy was issued on or after October 1, 1985, *smoke alarms* shall receive their primary power from the building wiring provided that such wiring is served from a commercial source and shall be equipped with a battery backup. *Smoke alarms* with integral strobes that are not equipped with battery backup shall be connected to an emergency electrical system. *Smoke alarms* shall emit a signal when the batteries are low. Wiring shall be permanent and without a disconnecting switch other than as required for overcurrent protection.

Exception:

- 1) Where a building permit was issued prior to October 1, 1976, *smoke alarms* are permitted to be solely battery operated in *existing* buildings and areas of *existing* buildings undergoing *alterations* or repairs that do not result in the removal of interior walls or ceiling finishes exposing the structure, unless there is an attic, crawl space or *basement* available that could provide access for building wiring without the removal of interior finishes where construction is not taking place.
- 2) Where a building permit was issued prior to October 1, 1978, *smoke alarms* are permitted to be solely battery operated in *existing one- and two-family dwellings*.

(Amd) **1103.10 Protection from hazards.** Designated hazardous areas shall be protected in accordance with Section 1103.10.1 through 1103.10.3 and Section 509 of the *International Building Code* portion of the Connecticut State Building Code.

(Add) **1103.10.1 Group A.** In Group A occupancies built prior to January 1, 2006, rooms containing high-pressure boilers, refrigerating machinery of other than the domestic type, large transformers, or other service equipment subject to explosion shall be separated from the other parts of the building by minimum 1-hour rated *fire barriers* or protected by an automatic extinguishing system. Such rooms shall not be located directly under or abutting required *exits*.

(Add) **1103.10.2 Group E and I.** In occupancies in Group E and I built prior to January 1, 2006, rooms or spaces containing maintenance shops, including woodworking and painting areas, or combustible or flammable supplies or processes deemed hazardous by the *fire code official*, shall be provided with 1-hour fire-rated separation and protection by an automatic extinguishing system.

(Add) **1103.10.3 Protection from hazards and incidental uses.** Incidental uses shall be ~~protected~~ in accordance with Section 509 of the *International Building Code*. In

portion of the Connecticut State Building Code

Justify text

Connecticut State Fire Safety Code

existing building built prior to January 1, 2006, the 2022 CSFSC Part IV protection, of hazards occupancy requirements shall be permitted.

DoF apply

From

(Add) **1103.11. Residential Occupancy Separation.** In existing buildings built prior to January 1, 2006, Multiple dwelling units may be located above a nonresidential occupancy only where one of the following conditions exists:

1. Where the dwelling units of the residential occupancy and exits therefrom are separated from the nonresidential occupancy by construction having a fire resistance rating of not less than 1 hour.
2. Where the nonresidential occupancy is protected throughout by an approved, supervised automatic sprinkler system in accordance with Section 903.
3. Where the dwelling units are located above a nonresidential occupancy that is protected by an automatic fire detection system, with detection in the nonresidential occupancy and occupant notification throughout the building in accordance with Section 907.

(Amd) **1104.1 General.** Means of egress in existing buildings shall comply with the minimum egress requirements where specified in Table 1103.1 as further enumerated in Sections 1104.2 through 1104.28, inclusive

(Amd) **1104.5 Illumination emergency power.** Where means of egress illumination is provided, the power supply for means of egress illumination shall normally be provided by the premises' electrical supply. In the event of power supply failure, illumination shall be automatically provided from an emergency system for the following occupancies where such occupancies require two or more means of egress:

1. Group A having 50 or more occupants.

Exception: Assembly occupancies used exclusively as a place of worship and having an occupant load of less than 300.

2. Group B buildings three or more stories in height, buildings with 100 or more occupants above or below a level of exit discharge serving the occupants or buildings with 1,000 or more total occupants.

3. Group E in interior exit access and exit stairways and ramps, corridors, windowless areas with student occupancy, shops and laboratories.

4. Group F having more than 100 occupants.

Exception: Buildings used only during daylight hours and that are provided with windows for natural light in accordance with the International Building Code portion of the Connecticut State Building Code.

Justify text

2. The nosing of each winder tread shall^{is} be made readily visible by the application of a 2-inch (51-mm) wide stripe for the full width of the tread that is of distinctive or contrasting color.
3. The area of the winder shall^{is} be provided with both normal illumination and emergency lighting in accordance with Section 1008.
4. A handrail shall^{is} be provided for the full length of the *stair* travel at the side of the *stair* having the widest tread portion.

(Amd) **1104.17 Corridor construction.** Corridors serving an occupant load greater than 30 and the openings therein shall provide an effective barrier to resist the movement of smoke. Transoms, louvers, doors and other openings shall be kept closed or be self-closing. In Group I-2, corridors in areas housing patient sleeping or care rooms shall comply with Section 1105.5.

Exceptions:

1. In Group A occupancies built prior to January 1, 2006, interior *corridors* and lobbies shall be separated from use areas by *fire barriers* having a *fire-resistance-rating* of not less than 1 hour, except under the following conditions:
 - 1.1 ~~Where~~[#] assembly rooms served by the *corridor* or lobby have at least 50 percent of their *exit* capacity discharging directly to the outside, independent of *corridors* and lobbies.
 - 1.2 ~~When~~[#] the building is protected throughout by an *approved supervised automatic sprinkler system*.
 - 1.3 Where lobbies serve only one assembly area that meet the requirements of intervening rooms, such lobbies need not have a *fire resistance rating*.
 - 1.4 ~~Construction~~^{where} for which a building permit was issued prior to April 15, 1987, ^{for construction}
2. In Group B occupancies built prior to January 1, 2006, where access to *exits* is limited to *corridors*, such *corridors* shall be separated from use areas by *fire barriers* having a *fire resistance rating* of not less than 1 hour, except under any of the following conditions:
 - 2.1 Where *exits* are available from an open floor area.
 - 2.2 Within a space occupied by a single tenant.
 - 2.3 When the building is protected throughout by an *approved supervised automatic sprinkler system*.

Justify text

where

for construction

2.4 Building construction for which a building permit was issued prior to September 1, 1981.

3. Corridors in occupancies in Group E and I-4 built prior to January 1, 2006 shall be separated from other parts of the story by walls having a ½-hour fire-resistance-rating.

Exceptions:

1. Corridor protection shall not be required where all spaces normally subject to student occupancy have not less than one door opening directly to the outside or to an exterior exit balcony.
2. Corridor protection shall not be required in buildings protected throughout by an approved automatic sprinkler system.
3. Lavatories shall not be required to be separated from corridors, provided that they are separated from all other spaces by walls having not less than a ½-hour fire-resistance-rating.
4. In Group R-2 occupancies built prior to January 1, 2006, exit access corridor walls shall have a fire-resistance-rating of not less than 30 minutes. Doors that open onto exit access corridors shall have a minimum 20-minute fire protection rating and be self-closing and self-latching.
5. Corridors that are in accordance with the International Building Code portion of the Connecticut State Building Code.
6. Corridors in occupancies other than in Group H and where not specifically addressed in items 1 through 5, that are equipped throughout with an approved automatic sprinkler system.

exceptions

than

-resistance

to (inclusive)

(Add) **1104.17.2 Classroom Doors.** In Group E and I-4 Day-care occupancies built prior to January 1, 2006, self-closing devices may be omitted on doors between corridors and normally occupied classrooms, except rooms or areas used as shops or laboratories, where the facility has a written and practiced fire exit drill policy which provides for the closing of all corridor doors upon evacuation, and where said policy provides for doors to classrooms not in use to be kept closed. This provision may be revoked by the fire code official for cause.

that

(Amd) **1104.22 Exit stairway protection.** Interior and exterior exit stairways shall be protected in accordance with Sections 1104.22.1 and 1104.22.2, as applicable.

(Add) **1104.22.1 Interior exit stairway protection.** Enclosures of interior exit stairways shall be constructed as fire barriers in accordance with Section 707 of the International

Justify text

Building Code portion of the Connecticut State Building Code or horizontal assemblies constructed in accordance with Section 711 of the *International Building Code* portion of the Connecticut State Building Code, or both. Interior *exit stairway* enclosures shall have a *fire-resistance rating* of not less than 1 hour. Interior *exit stairways* shall comply with Sections 1023.3 through 1023.8, *inclusive*

(Add) **1104.22.2 Exterior stairway protection.** *Exterior exit stairways* shall be separated from the interior of the building as required in Section 1027.6. Openings shall be limited to those necessary for egress from normally occupied spaces.

Exceptions:

1. In existing buildings built prior to January 1, 2006, *Existing* outside stairs serving not in excess of four adjacent stories, including the story of *exit discharge*, maybe unprotected where there is a remotely located second *exit*. #
2. Separation from the interior of the building is not required where the exterior *stairway* is served by an exterior balcony that connects two remote exterior *stairways* or other *approved exits*, with a perimeter that is not less than 50 percent open. To be considered open, the opening shall be not less than 50 percent of the height of the enclosing wall, with the top of the opening not less than 7 feet (2,134 mm) above the top of the balcony.
3. Separation from the interior of the building is not required for an exterior *stairway* located in a building or structure that is permitted to have unenclosed interior *stairways* in accordance with Section 1023.
4. Separation from the *open-ended corridors* of the building is not required for exterior *stairways* provided that:
 - 4.1. The *open-ended corridors* comply with Section 1020.
 - 4.2. The *open-ended corridors* are connected on each end to an exterior *exit stairway* complying with Section 1027.
 - 4.3. At any location in an *open-ended corridor* where a change of direction exceeding 45 degrees (0.79 rad) occurs, a clear opening of not less than 35 square feet (3 m²) or an exterior *stairway* shall be provided. Where clear openings are provided, they shall be located to minimize the accumulation of smoke or toxic gases.
5. In *existing* buildings built prior to January 1, 2006, Outside stairs in *existing* buildings protected throughout by an *approved supervised automatic sprinkler system* may be unprotected.

Justify text

(Add) **1104.26 Single exit occupancies.** The minimum number of *exits* in *existing* occupancies shall comply with Section 1006, except that a single *exit* may be permitted in an *existing* occupancy built prior to January 1, 2006, in compliance with Section 1104.26.1 through 1104.26.7, *inclusive*

(Add) **1104.26.1 Group B.** In Group B occupancies built prior to January 1, 2006, a single *exit* is permitted for a maximum two-story single tenant space or *building* that is protected throughout by an *approved automatic sprinkler system* and where the total travel distance to the outside does not exceed 100 feet.

(Add) **1104.26.2 Group B.** In Group B occupancies built prior to January 1, 2006, a single *exit* is permitted for a maximum two-story single tenant space or *building* that has a maximum area per floor of 1,500 square feet (139.35 m²) and is protected throughout by an automatic fire detection system that includes smoke detection in all occupied spaces and heat detection in hazardous and unoccupied areas. Each occupied room on the second floor of the space or *building* shall be provided with a secondary means of escape in accordance with Section 1104.27. The total travel distance to the outside shall not exceed 75 feet (22,860 mm).

(Add) **1104.26.3 Group B.** In Group B occupancies built prior to January 1, 2006, a single *exit* is permitted for a maximum three-story building not exceeding an occupant load of 30 persons per floor and where the total travel distance to the outside of the *building* does not exceed 100 feet (30,480 mm). The *exit* shall be enclosed by 1-hour *fire-resistance-rated* construction, shall serve no other levels, and discharge directly to the outside. A communicating door shall be permitted in the *exit stair* enclosure at the *level of exit discharge* if the floor level of the communicating opening is protected throughout by either an *automatic sprinkler system* or fire detection system consisting of smoke detection that provides an alarm on the floor level served by the single *exit*. A single outside *stair* in accordance with Section 1104.22 may serve all floors.

(Add) **1104.26.4 Group M.** In Group M occupancies built prior to January 1, 2006, a *single exit* is permitted for a maximum two-story single tenant space or *building* that has a maximum area per floor of 1,500 square feet (139.35 m²) and is protected throughout by an automatic fire detection system that includes smoke detection in all occupied spaces and heat detection in hazardous and unoccupied areas. Each occupied room on the second floor of the space or *building* shall be provided with a secondary means of escape in accordance with Section 1104.27. The total travel distance to the outside shall not exceed 75 feet (22,860 mm).

(Add) **1104.26.5 Group R-1.** Buildings of four stories or less protected throughout by an *approved, supervised automatic sprinkler system*, with not more than four guest rooms

Justify text

or *guest suites* per floor built prior to January 1, 2006, shall be permitted to have a single exit under the following conditions:

1. The *stairway* is completely enclosed or separated by *fire barriers* having a *fire resistance rating* of not less than 1 hour.
2. The *stairway* does not serve more than one-half of a story below the *level of exit discharge*.
3. All *corridors* serving as access to *exits* have not less than a 1-hour fire resistance rating.
4. The travel distance from the entrance door of any guest room or *guest suite* to an exit does not exceed 35 feet (10,668 mm).
5. Horizontal and vertical separation with a fire rating of not less than ~~1~~ ^{not less than} 1/2 hour is provided between guest rooms or guest suites. ~~1~~ ^{res is lower}

(Add) **1104.26.6 Group R-2.** Any *dwelling unit* built prior to January 1, 2006, shall be permitted to have a single *exit*, provided that one of the following criteria is met:

1. The *dwelling unit* has an *exit* door opening directly to the street or yard at ground level.
2. The *dwelling unit* has direct access to an outside *stair* complying with 1104.22. ^{way}
3. The *dwelling unit* has direct access to an interior *stair* that serves only that unit and is separated from all other portions of the building by *fire barriers* having not less than a 1-hour *fire-resistance rating* with no opening therein. ^{way}

(Add) **1104.26.7 Group R-2.** Any building of three stories or less in its entirety built prior to January 1, 2006, shall be permitted to have a single *exit*, provided the following conditions are met:

1. The *stairway* is separated from the rest of the building by *fire barriers* having not less than a 1-hour *fire resistance rating*.
2. The *stairway* does not serve more than one-half of a *story* below the *level of exit discharge*.
3. All *corridors* serving as access to *exits* have not less than a 1/2-hour *fire resistance rating*.
4. There is not more than 50 feet (15,240 mm) of travel distance from the entrance door of any *dwelling unit* to an *exit*.

Justify text

- resistance

5. Horizontal and vertical separation with a fire rating of not less than ½ hour is provided between *dwelling units*.

Note: The building may include a fourth *story* if the entire building is additionally protected throughout by an *approved automatic sprinkler system*.

(Add) **1104.26.8 Group F and S.** In Group F and S occupancies built prior to January 1, 2006, a single *means of egress* shall be permitted by one of the following for the occupancy:

1. From any *story* or section in low and ordinary hazard industrial and storage occupancies, provided the following limits are not exceeded:
 - 1.1. One story, 30 occupants and 100 feet (30 m) maximum travel distance.
 - 1.2. Two story, 30 occupants and 75 feet (23 m) maximum travel distance.
2. In low and ordinary hazard industrial occupancies *existing* prior to May 7, 2000, a single *means of egress* shall be permitted from any *story* or section, provided the *exit* can be reached within the distance permitted as a *common path of egress travel*.
3. In low hazard storage occupancies *existing* prior to May 7, 2000, a single *means of egress* shall be permitted from any *story* or section.
4. In ordinary hazard storage occupancies *existing* prior to May 7, 2000, a single *means of egress* shall be permitted from any *story* or section, provided the *exit* can be reached within the distance permitted as a *common path of egress travel*.

(Add) **1104.27 Emergency escape and rescue.** *Emergency escape and rescue openings* shall be provided in *existing buildings* built prior to January 1, 2006, in accordance with Section 1104.27.1 and 1104.27.2. *Emergency rescue and escape openings* shall comply with the requirements in Section 1031 or the 2022 Connecticut State Fire Safety Code, Part IV – Section 24.2.2.3.

(Add) **1104.27.1 Group E and I-4 occupancies.** In Group E and I-4 occupancies built prior to January 1, 2006, every room or space greater than 250 square feet (23.23 m²) and used for classroom or educational purposes or normally subject to student/client occupancy shall have not less than one outside window for emergency escape, ventilation and rescue. or

Exceptions:

1. *Emergency escape and rescue openings* shall not be required in buildings protected throughout by an *approved automatic sprinkler system*.

Justify text

2. *Emergency escape and rescue openings* shall not be required where the room or space has a door leading directly to an exit or directly to the outside of the building.
3. *Emergency escape and rescue openings* shall not be required where the room or space has a second door that leads directly to another corridor located in a separate *smoke compartment*.
4. *Emergency escape and rescue openings* shall not be required where the room or space is located four or more stories above the finished ground level.
5. *Emergency escape and rescue openings* shall not be required where awing-type or hopper-type windows that are hinged or subdivided to provide a clear opening of not less than 4 square feet or any dimension of not less than 22 inches and screen walls or devices located in front of required windows shall not interfere with rescue operations. ⁿ do
6. *Emergency escape and rescue openings* shall not be required where the room or space has one door providing direct access to an adjacent classroom and a second door providing direct access to another adjacent classroom, the two classrooms to which *exit access* travel is made shall each provide *exit access* to the outside of the building or to a *corridor* in a separate *smoke compartment*. The length of travel to exits along such paths shall not exceed 150 feet and no locking devices shall be permitted on the communicating doors. and
7. Where the building is protected throughout by an *approved* automatic fire detection system, the length of travel to an *exit* does not exceed 100 feet, and a window is provided in each room for ventilation. Smoke detection shall be used in all spaces except where not appropriate due to environmental conditions.) substantive issue

(Add) **1104.27.2 Group R.** In Group R occupancies built prior to January 1, 2006, every sleeping room and living area shall be provided with an *emergency rescue and escape opening*.

Exceptions:

1. *Emergency rescue and escape openings* shall not be required where the bedroom or living area has a door leading directly to the outside of the building at or to the finished ground level.
2. *Emergency rescue and escape openings* shall not be required where the *dwelling unit* or sleeping room is protected throughout by an *approved automatic sprinkler system*.

Justify text

sleeping room?

escape and rescue

3. *Emergency* ~~rescue and escape~~ openings shall not be required where the room has two independent doorways that are remotely located and not subject to locking in the direction of egress.

(Add) **1104.28 Clearance for Inclined Lifts on Stairways.** Where a platform or chair lift is installed on an *exit* stair in an *existing* building the minimum clear width on the stair when the inclined lift is in the down or operating position shall be:

1. 18 inches (460 mm) when the stair serves fewer than 10 people
2. 22 inches (560 mm) when the stair serves fewer than 50 people
3. As required by this code when the stair serves 50 or more people

SECTION 1105
(Amd) CODE REQUIREMENTS
FOR EXISTING GROUP I-2

(Add) SECTION 1108

**ADDITIONAL REQUIREMENTS FOR EXISTING APARTMENT OCCUPANCIES
BUILT PRIOR TO JANUARY 1, 2006**

(Add) **1108.1 General.** *Existing* apartment occupancies shall meet all of the following requirements:

1. The minimum fire safety requirements in Section 1103.
2. The minimum *means of egress* requirements in Section 1104.
3. The additional egress and construction requirements in Section 1108.

(Add) **1108.2 Applicability.** The provisions of Sections 1108.3 through 1108.4 shall apply to the *existing* apartment fire area.

(Add) **1108.3 Means of egress.** *Means of egress* in *existing* apartment buildings shall comply with the applicable requirements found in Part IV of the 2022 Connecticut State Fire Safety Code.

(Add) **1108.4 Corridors.** Corridors in *existing* apartment buildings shall be enclosed by minimum 30-minute *fire-resistance-rated* construction. All openings in corridor walls shall be protected with minimum 20-minute opening protectives.

Justify text

(Add) SECTION 1109 #

ADDITIONAL REQUIREMENTS FOR EXISTING RESIDENTIAL BOARD AND CARE OCCUPANCIES BUILT PRIOR TO JANUARY 1, 2006

(Add) **1109.1 General.** *Existing Residential Board and Care* occupancies shall meet all of the following requirements:

1. The minimum fire safety requirements in Section 1103.
2. The minimum *means of egress* requirements in Section 1104.
3. The additional egress and construction requirements in Section 1109.

(Add) **1109.2 Applicability.** The provisions of Chapter 33 of the 2022 Connecticut State Fire Safety Code – Part IV shall apply to the *existing residential board and care fire area*.

(Add) **1109.3 Alternative Compliance.** Any facility meeting the applicable requirements for new occupancy shall not be required to comply with Section 1109.

(Add) SECTION 1110

ADDITIONAL REQUIREMENTS FOR EXISTING LODGING AND ROOMING OCCUPANCIES AND BED AND BREAKFASTS BUILT PRIOR TO JANUARY 1, 2006

(Add) **1110.1 General.** *Existing Lodging or Rooming Houses* and Bed and Breakfasts shall meet all of the following requirements:

4. The minimum fire safety requirements in Section 1103.
5. The minimum *means of egress* requirements in Section 1104.
6. The additional egress and construction requirements in Section 1110.

(Add) **1110.2 Applicability.** The provisions of Chapter 26 of the 2022 Connecticut State Fire Safety Code – Part IV shall apply to the *existing lodging or rooming house or bed and breakfast fire area*.

(Add) **1110.3 Separation of sleeping rooms.** All sleeping rooms shall be separated from the rest of the building in accordance with Section 26.3.5 of the 2022 Connecticut State Fire Safety Code – Part IV.

OR
of NFPA 101, LIFE SAFETY CODE,
incorporated into

(Add) **1110.4 Interior wall and ceiling finish.** Interior wall and ceiling finish materials complying with Section 803 shall be Class A, Class B, or Class C.

(Add) **1110.5 Alternative Compliance.** Any facility meeting the applicable requirements for new occupancy shall not be required to comply with Section 1110.

CHAPTER 12 ENERGY SYSTEMS

(Add) **1203.2.20 Electric fire pumps.** Buildings provided with standby electrical power for the purpose of continuing operations or occupancy shall provide standby power in accordance with Article 701 of the NFPA 70, National Electrical Code, portion of the Connecticut State Building Code for any electric fire pump installed to provide an adequate water supply or minimum operating pressure to a required *automatic sprinkler system*.

(Amd) **1205.2.3 Building-integrated photovoltaic (BIPV) systems.** Where building-integrated photovoltaic (BIPV) systems are installed in a manner that creates areas with electrical hazards to be hidden from view, markings shall be provided to identify the hazardous areas to avoid for ladder placement. The markings shall be reflective and be visible from grade beneath the eaves or other location approved by the fire code official.

(Add) **1205.2.3.1 Required signage.** Where a BIPV system is installed, a placard shall be provided on the outside of the building at the electrical service meter location to which the BIPV system is connected. The placard shall display a firefighter Maltese cross with "TC-PV" printed in the center of the cross. The placard size shall be in accordance with Appendix J and made of a durable material approved by the authority having jurisdiction.

(Amd) **TABLE 1207.6**

ELECTROCHEMICAL ESS TECHNOLOGY-SPECIFIC REQUIREMENTS

COMPLIANCE REQUIRED ^b		BATTERY TECHNOLOGY						OTHER ESS AND BATTERY TECHNOLOGIES ^b	CAPACITORS ^b
Features	Section	Lead-Acid	Nickel-cadmium (Ni-Cd), nickel-metal hydride (Ni-MH) and nickel-zinc (Ni-Zn)	Zinc-manganese dioxide (Zn-MnO ₂)	Lithium-ion	Flow	Sodium nickel chloride		
Exhaust Ventilation	1207.6.1	Yes	Yes	Yes	No ^f	Yes	No	Yes	Yes
Explosion	1207.6	Yes	Yes ^a	Yes	Yes	No	Yes	Yes	Yes

control	.3	^a							
Safety caps	1207.6.4	Yes	Yes	No	No	No	No	Yes	Yes
Spill control and neutralization	1207.6.2	Yes ^c	Yes ^c	Yes ^e	No	Yes	No	Yes	Yes
Thermal runaway	1207.6.5	Yes ^d	Yes	Yes	Yes	No	Yes	Yes	Yes

a. Not required for lead-acid and nickel-cadmium batteries at facilities under the exclusive control of communications utilities that comply with NFPA 76 and operate at less than 50 VAC and 60 VDC.

b. Protection shall be provided unless documentation acceptable to the fire code official is provided in accordance with Section 104.2.2 that provides justification why the protection is not necessary based on the technology used.

c. Applicable to vented-type (i.e., flooded) nickel-cadmium and lead-acid batteries.

d. Not required for vented-type (i.e., flooded) batteries.

e. Not required for batteries with gelled electrolyte.

f. Exhaust ventilation is required when flammable gasses are released under abnormal conditions.

(Amd) **1207.6.1.2.4 Gas detection system.** Where required by Section 1207.6.1.2, rooms, areas and walk-in units containing ESS shall be protected by an *approved* continuous *gas detection system* that complies with Section 916 and with the following:

1. The *gas detection system* shall be designed to activate the mechanical ventilation system when the level of *flammable gas* in the room, area or walk-in unit exceeds 25 percent of the LFL or where the level of toxic or highly toxic gasses exceeds one-half (1/2) of the IDLH, or where gas indicative of venting from a lithium-ion cell is detected.

2. The mechanical ventilation system shall remain on until the *flammable gas* detected is less than 25 percent of the LFL.

3. The *gas detection system* shall be provided with a minimum of 2 hours of standby power in accordance with Section 1203.2.5.

4. Failure of the *gas detection system* shall annunciate a trouble signal at an *approved* central station, proprietary or remote station service in accordance with NFPA 72, or shall initiate an audible and visible trouble signal at an *approved* constantly attended on-site location.

(Add) **1207.6.6.** The thermal runaway detector shall activate upon detection of gas vapors produced by liquid electrolyte in a lithium-ion cell at the start of a battery venting event. Upon detection of gas vapors, the detection system shall shut down the affected ESS rack and transmit a fire alarm signal. Detection of a thermal runaway event shall activate the mechanical ventilation when it is provided as a method of explosion control.

~~CHAPTERS 13 through 19~~
RESERVED

(Del) ~~CHAPTER 20~~
AVIATION FACILITIES

Delete chapter in its entirety and replace with the following.

(Add) ~~CHAPTER 20~~
AVIATION FACILITIES

(Add) **2001.1 Scope.** Airports, heliports, helistops, and aircraft hangers shall be in accordance with this chapter and Section 117 for items involving building construction, building services, or building systems. Pursuant to section 29-291a of the Connecticut General Statutes, the Connecticut State Fire Prevention Code shall be applicable for oil burners, flammable and combustible liquids, gas equipment and piping, liquefied gas and liquefied natural gas, hazardous chemicals, and processes and activities that occur in the building or structure that are not used to support the building components services or systems, and for the purposes of prevention of fire and other related emergencies.

(Add) **2001.2 Regulations not covered.** Regulations ^{where} not specifically addressed shall be in accordance with NFPA 407, NFPA 409, NFPA 410 and NFPA 415. ^{are} shall apply ^{to} the applicable provisions of

(Add) **2001.3 Permits.** The applicable provisions of Section 105.5 shall apply for permits to airport terminal buildings and hangars.

CHAPTER 21
DRY CLEANING

(Amd) **2101.1 Scope.** Dry cleaning plants shall comply with the requirements of this chapter and Section 117 for items involving building construction, building services, or

building systems. Pursuant to section 29-291a of the Connecticut General Statutes, the Connecticut State Fire Prevention Code shall be applicable for oil burners, flammable and combustible liquids, gas equipment and piping, liquefied gas and liquefied natural gas, hazardous chemicals, and processes and activities that occur in the building or structure that are not used to support the building components services or systems, and for the purposes of prevention of fire and other related emergencies.

CHAPTER 22 COMBUSTIBLE DUST-PRODUCING OPERATIONS

(Amd) **2201.1 Scope.** ^{level} Combustible dust producing operations shall ^{and} comply with the provisions of NFPA ~~652~~ Section 117 for items involving building construction, building services, or building systems, ^{as applicable,} ~~and as applicable, NFPA 654 and NFPA 664.~~ Pursuant to section 29-291a of the Connecticut General Statutes, the Connecticut State Fire Prevention Code shall be applicable for oil burners, flammable and combustible liquids, gas equipment and piping, liquefied gas and liquefied natural gas, hazardous chemicals, and processes and activities that occur in the building or structure that are not used to support the building components services or systems, and for the purposes of prevention of fire and other related emergencies.

CHAPTER 23 MOTOR FUEL-DISPENSING FACILITIES AND REPAIR GARAGES

(Amd) **2301.1 Scope.** Automotive motor fuel-dispensing facilities, marine motor fuel-dispensing facilities, fleet motor fuel-dispensing facilities, aircraft motor vehicle fuel-dispensing facilities and repair garages shall be in accordance with this chapter, Section 117, and the Connecticut State Building Code for items involving building construction, building services, or building systems. Pursuant to section 29-291a of the Connecticut General Statutes, the Connecticut State Fire Prevention Code shall be applicable for oil burners, flammable and combustible liquids, gas equipment and piping, liquefied gas and liquefied natural gas, hazardous chemicals, and processes and activities that occur in the building or structure that are not used to support the building components services or systems, and for the purposes of prevention of fire and other related emergencies.

(Add) **2301.7 Cleaning and purging of flammable gas piping systems.** The cleaning and purging of any flammable gas piping system shall be in accordance with NFPA 56. This includes purging into or out of service.

bold
(Del) SECTION 2305
OPERATIONAL REQUIREMENTS

Delete section in its entirety. *Conductor*

(Amd) **2307.1 General.** Motor fuel-dispensing facilities for liquefied petroleum gas (LP-Gas) fuel shall be in accordance with this section, Chapter 61 and NFPA 30A.

(Add) **2307.6.5 Emergency shutoff control.** The system shall be provided with an emergency shut-off switch located within 100 feet (30 m) of, but not less than 20 feet (6 m) from, dispensers.

CHAPTER 24
FLAMMABLE FINISHES *subdivisions*

(Amd) **2401.1 Scope.** Locations or areas where any of the activities under 1. to 5., inclusive, are conducted shall be in accordance with this chapter, and Section 117 for items involving building construction, building services, or building systems. Pursuant to section 29-291a of the Connecticut General Statutes, the Connecticut State Fire Prevention Code shall be applicable for oil burners, flammable and combustible liquids, gas equipment and piping, liquefied gas and liquefied natural gas, hazardous chemicals, and processes and activities that occur in the building or structure that are not used to support the building components, services or systems, and for the purposes of prevention of fire and other related emergencies.

1. The application of flammable finishes to articles or materials by means of spray apparatus.
2. The application of flammable finishes by dipping or immersing articles or materials into the contents of tanks, vats or containers of *flammable* or *combustible liquids* for coating, finishing, treatment or similar processes.
3. The application of flammable finishes by applying combustible powders to articles or materials utilizing powder spray guns, electrostatic powder spray guns, fluidized beds or electrostatic fluidized beds.
4. Floor surfacing or finishing operations using Class I or II liquids in areas exceeding 350 square feet (32.5 m²).
5. The application of flammable finishes consisting of dual-component coatings or Class I or II liquids where applied by brush or roller in quantities exceeding 1 gallon (4 L).

(Amd) **2401.3 Permits.** *Permits* shall be required as set forth in Section 105.5.

CHAPTER 25 FRUIT AND CROP RIPENING

(Amd) **2501.1 Scope.** Ripening processes where ethylene gas is introduced into a room to promote the ripening of fruits, vegetables and other crops shall comply with this chapter and Section 117 for items involving building construction, building services, or building systems. Pursuant to section 29-291a of the Connecticut General Statutes, the Connecticut State Fire Prevention Code shall be applicable for oil burners, flammable and combustible liquids, gas equipment and piping, liquefied gas and liquefied natural gas, hazardous chemicals, and processes and activities that occur in the building or structure that are not used to support the building components, services or systems, and for the purposes of prevention of fire and other related emergencies.

Exception: Mixtures of ethylene and one or more inert gases in concentrations that prevent the gas from reaching greater than 25 percent of the lower explosive limit (LEL) when released to the atmosphere.

CHAPTER 26 FUMIGATION AND INSECTICIDAL FOGGING

(Amd) **2601.1 Scope.** Fumigation and insecticidal fogging operations within buildings, structures and spaces shall comply with this chapter for items involving building construction, building services, or building systems. Pursuant to section 29-291a of the Connecticut General Statutes, the Connecticut State Fire Prevention Code shall be applicable for oil burners, flammable and combustible liquids, gas equipment and piping, liquefied gas and liquefied natural gas, hazardous chemicals, and processes and activities that occur in the building or structure that are not used to support the building components, services or systems, and for the purposes of prevention of fire and other related emergencies.

CHAPTER 27 SEMICONDUCTOR FABRICATION FACILITIES

(Amd) **2701.1 Scope.** Semiconductor fabrication facilities and comparable research and development areas classified as Group H-5 shall comply with this chapter and the *International Building Code* portion of the Connecticut State Building Code for items involving building construction, building services, or building systems. Pursuant to section 29-291a of the Connecticut General Statutes, the Connecticut State Fire Prevention Code shall be applicable for oil burners, flammable and combustible liquids, gas equipment and piping, liquefied gas and liquefied natural gas, hazardous chemicals, and processes and activities that occur in the building or structure that are not used to support the building components, services or systems, and for the purposes of prevention of fire and other related emergencies. The use, storage and handling of hazardous materials in Group H-5 shall comply with this chapter and the Connecticut State Fire Prevention Code.

(Del) **2701.4 Existing buildings and existing fabrication areas.** Delete section.

CHAPTER 28 LUMBER YARDS AND AGRO-INDUSTRIAL, SOLID BIOMASS AND WOODWORKING FACILITIES

(Amd) **2801.1 Scope.** The storage, manufacturing and processing of solid biomass feedstock, timber, lumber, plywood, veneers and agro-industrial byproducts shall be in accordance with this chapter for items involving building construction, building services, or building systems. Pursuant to section 29-291a of the Connecticut General Statutes, the Connecticut State Fire Prevention Code shall be applicable for oil burners, flammable and combustible liquids, gas equipment and piping, liquefied gas and liquefied natural gas, hazardous chemicals, and processes and activities that occur in the building or structure that are not used to support the building components, services or systems, and for the purposes of prevention of fire and other related emergencies.

(Amd) **2810.3 Fire prevention plan.** The *owner* or *owner's* authorized representative shall submit a fire prevention plan for review and approval by the *fire code official* that includes all of the following:

1. Frequency of walk-through inspections to verify compliance with the plan.
2. Hot work permit program in accordance with the requirements of the Connecticut State Fire Prevention Code and Chapter 35.
3. Preventative maintenance program for equipment associated with pallet activities.
4. Inspection, testing and maintenance of *fire protection systems* in accordance with Chapter 9.

(Amd) **2810.9 Fire flow.** Fire flow requirements for the site shall be determined by the *fire chief* in conjunction with the *fire code official*.



CHAPTER 29 MANUFACTURE OF ORGANIC COATINGS

(Amd) **2901.1 Scope.** Organic coating manufacturing processes shall comply with this chapter, except that this chapter shall not apply to processes manufacturing nonflammable or water-thinned coatings or to operations applying coating materials for

items involving building construction, building services, or building systems. Pursuant to section 29-291a of the Connecticut General Statutes, the Connecticut State Fire Prevention Code shall be applicable for oil burners, flammable and combustible liquids, gas equipment and piping, liquefied gas and liquefied natural gas, hazardous chemicals, and processes and activities that occur in the building or structure that are not used to support the building components, services or systems, and for the purposes of prevention of fire and other related emergencies.

(Amd) **2909.4 Nitrocellulose storage.** Nitrocellulose storage shall be located on a detached pad or in a separate structure or a room enclosed in accordance with the *International Building Code* portion of the Connecticut State Building Code. The nitrocellulose storage area shall not be utilized for any other purpose. Electrical wiring and equipment installed in storage areas adjacent to process areas shall comply with Section 2904.2. Also refer to section 29-343 of the Connecticut General Statutes for the definition of "explosive" and the Connecticut Explosives Code adopted pursuant to section 29-349 of the Connecticut General Statutes. *See*

(Amd) **2909.4.2 Spills.** Spilled nitrocellulose shall be promptly wetted with water and disposed of by use or burning in the open at a detached location approved by the local fire marshal and the local open burning official. *(unclear as to whether code is being referred to for definition only)*

CHAPTER 30 INDUSTRIAL OVENS

(Amd) **3001.1 Scope.** This chapter shall apply to the installation and operation of industrial ovens and furnaces. Industrial ovens and furnaces shall comply with the applicable provisions of this chapter, NFPA 54, the *International Mechanical Code* portion of the Connecticut State Building Code, and NFPA 86 for items involving building construction, building services, or building systems. Pursuant to section 29-291a of the Connecticut General Statutes, the Connecticut State Fire Prevention Code shall be applicable for oil burners, flammable and combustible liquids, gas equipment and piping, liquefied gas and liquefied natural gas, hazardous chemicals, and processes and activities that occur in the building or structure that are not used to support the building components, services or systems, and for the purposes of prevention of fire and other related emergencies. The terms "ovens" and "furnaces" are used interchangeably in this chapter.

(Amd) **3001.2 Permits.** *Permits* shall be required as set forth in Section 105.5.

CHAPTER 31
TENTS, TEMPORARY SPECIAL EVENT STRUCTURES AND OTHER MEMBRANE STRUCTURES

(Amd) **3101.1 Scope.** Tents, temporary special event structures and *membrane structures* shall comply with this chapter. The provisions of Section 3103 are applicable only to temporary tents and membrane structures. The provisions of Sections 3104 and 3108 are applicable to temporary and permanent tents and membrane structures. The provisions of Section 3105 are applicable to temporary special event structures. The provisions of Section 3106 are applicable to inflatable amusement devices. The provisions of Section 3107 are applicable to outdoor assembly events. Other temporary structures shall comply with the *International Building Code* portion of the Connecticut State Building Code. Membrane structures covering water storage facilities, water clarifiers, water treatment plants, sewage treatment plants, greenhouses and similar facilities not used for human occupancy, are required to meet only the requirements of Section 3104.2.1. Pursuant to section 29-291a of the Connecticut General Statutes, the Connecticut State Fire Prevention Code shall be applicable for oil burners, flammable and combustible liquids, gas equipment and piping, liquefied gas and liquefied natural gas, hazardous chemicals, and processes and activities that occur in the building or structure that are not used to support the building components, services or systems, and for the purposes of prevention of fire and other related emergencies.

(Amd) **3103.2 Approval required.** Tents and membrane structures required to have a permit, as set forth in Sections 105.5 and 105.6, shall not be erected, operated or maintained for any purpose without obtaining approval from the *fire code official*.

(Amd) **3103.4 Use period.** Temporary, air-supported, air-inflated or tensioned *membrane structures* shall not be erected for a period of more than 180 consecutive calendar days out of any 365 consecutive calendar days on a single premises.

(Amd) **3103.5 Construction documents.** A detailed site and floor plan for *tents* or *membrane structures* with an *occupant load* of 50 or more shall be provided with each application for approval. The *tent* or *membrane structure* floor plan shall indicate details of the *means of egress* facilities, seating capacity, arrangement of the seating and location and type of heating and electrical equipment. Waterfilled vessels used to anchor a tent or membrane structure shall be in accordance with Section 3103.8 and 3103.8.1.

(Add) **3103.5.1 Structural Stability.** *Construction documents* containing structural stability analysis shall be approved by the *building code official*.

(Amd) **3103.8 Structural stability and anchorage required.** *Tents* or *membrane structures* and their appurtenances shall be designed and installed to withstand the

elements of weather and prevent collapsing. Documentation of structural stability shall be furnished to and approved by the *building code official*.

(Del) **3103.8.2 Tents and membrane structures greater than one story.** Delete section.

(Del) **3103.8.3 Tents and membrane structures greater than 7,500 square feet.** Delete section.

(Del) **3103.8.4 Tents and membrane structures with an occupant load greater than 1,000.** Delete section.

(Add) **3103.11.9 Tent stakes adjacent to any means of egress** from any tent open to the public shall be railed off, capped, or covered so as not to present a hazard.

(Add) **3104.2.1 Membrane and interior liner material.** Membranes and interior liners shall be either noncombustible as set forth in Section 703.5 of the *International Building Code* portion of the Connecticut State Building or meet the fire propagation performance criteria of NFPA 701 and the manufacturer's test protocol.

Exception: Plastic less than 20 mil (0.5 mm) in thickness used in greenhouses, where occupancy by the general public is not authorized, and for aquaculture pond covers is not required to meet the fire propagation performance criteria of NFPA 701.

(Amd) **3107.6.2 Generators.** Generators shall be installed not less than 10 feet (3,048 mm) from combustible materials and shall be isolated from the public by physical guard, fence, or enclosure installed not less than 3 feet (914 mm) away from the internal combustion power source.

Exception: Generators 7.5KW or less shall be separated from *tents or membrane structures* by not less than 5 feet (1,524 mm).

(Amd) **3108.15 Separation of generators.** Generators and other internal combustion power sources shall be separated from *tents or membrane structures* by not less than 20 feet (6096 mm) and shall be isolated from contact with the public by fencing, enclosure or other approved means.

Exception: Generators 7.5KW or less shall be separated from *tents or membrane structures* by not less than 5 feet (1,524 mm).

CHAPTER 32 HIGH-PILED COMBUSTIBLE STORAGE

(Amd) **3201.1 Scope.** High-Piled combustible storage shall comply with the requirements of this chapter and Section 117 for items involving building construction, building services, or building systems. Pursuant to section 29-291a of the Connecticut General Statutes, the Connecticut State Fire Prevention Code shall be applicable for oil burners, flammable and combustible liquids, gas equipment and piping, liquefied gas and liquefied natural gas, hazardous chemicals, and processes and activities that occur in the building or structure that are not used to support the building components, services or systems, and for the purposes of prevention of fire and other related emergencies. In addition to the requirements of this chapter, the following material-specific requirements shall apply:

1. Aerosols shall be in accordance with Chapter 51.
2. *Flammable and combustible liquids* shall be in accordance with Chapter 57.
3. Hazardous materials shall be in accordance with Chapter 50.
4. Storage of combustible paper records shall be in accordance with NFPA 13.
5. Storage of *combustible fibers* shall be in accordance with Chapter 37.
6. General storage of combustible material shall be in accordance with Chapter 3.

(Amd) **3201.2 Permits.** *Permits* shall be required as set forth in Section 105.5.

CHAPTER 33 FIRE SAFETY DURING CONSTRUCTION AND DEMOLITION

(Add) **3301.3 Occupied buildings.** In buildings under construction and during the course of additions, renovations or *alterations* to existing buildings, occupied areas shall be separated from work areas on the same floor by a barrier having at least a 1-hour fire resistance rating.

Exception: *As approved by the fire code official.*

CHAPTER 34 TIRE REBUILDING AND TIRE STORAGE

(Amd) **3401.1 Scope.** Tire rebuilding and tire storage shall comply with the requirements of this chapter and Section 117 for items involving building construction, building services, or building systems. Pursuant to section 29-291a of the Connecticut General Statutes,

the Connecticut State Fire Prevention Code shall be applicable for oil burners, flammable and combustible liquids, gas equipment and piping, liquefied gas and liquefied natural gas, hazardous chemicals, and processes and activities that occur in the building or structure that are not used to support the building components, services or systems, and for the purposes of prevention of fire and other related emergencies. Tire rebuilding plants, tire storage and tire byproduct facilities shall comply with this chapter, other applicable requirements of this code and NFPA 13. Tire storage in buildings shall also comply with Chapter 32.

CHAPTER 35 WELDING AND OTHER HOT WORK

(Amd) **3501.1 Scope.** Welding and allied processes, cutting, open torches, heat treating, power driven fasteners, hot riveting and other *hot work* operations and equipment shall comply with this chapter, Section 117 and NFPA 51B for items involving building construction, building services, or building systems. Pursuant to section 29-291a of the Connecticut General Statutes, the Connecticut State Fire Prevention Code shall be applicable for oil burners, flammable and combustible liquids, gas equipment and piping, liquefied gas and liquefied natural gas, hazardous chemicals, and processes and activities that occur in the building or structure that are not used to support the building components, services or systems, and for the purposes of prevention of fire and other related emergencies.

CHAPTER 36 MARINAS

(Amd) **3601.1 Scope.** Marina facilities shall comply with the requirements of this chapter and Section 117 for items involving building construction, building services, or building systems. Pursuant to section 29-291a of the Connecticut General Statutes, the Connecticut State Fire Prevention Code shall be applicable for oil burners, flammable and combustible liquids, gas equipment and piping, liquefied gas and liquefied natural gas, hazardous chemicals, and processes and activities that occur in the building or structure that are not used to support the building components, services or systems, and for the purposes of prevention of fire and other related emergencies.

(Add) **3601.3 Permits.** Permits shall be required as set forth in Section 105.5.

CHAPTER 37 COMBUSTIBLE FIBERS

(Amd) **3701.1 Scope.** The equipment involving combustible fibers shall comply with the

requirements of this chapter and Section 117 for items involving building construction, building services, or building systems. Pursuant to section 29-291a of the Connecticut General Statutes, the Connecticut State Fire Prevention Code shall be applicable for oil burners, flammable and combustible liquids, gas equipment and piping, liquefied gas and liquefied natural gas, hazardous chemicals, and processes and activities that occur in the building or structure that are not used to support the building components, services, or systems, and for the purposes of prevention of fire and other related emergencies.

CHAPTER 38 HIGHER EDUCATION LABORATORIES

(Amd) **3801.1 Scope.** Higher education laboratories complying with the requirements of this chapter shall be permitted to exceed the maximum allowable quantities of hazardous materials in *control areas* set forth in Chapter 50 without requiring classification as a Group H occupancy. Except as specified in this chapter, such laboratories shall comply with all applicable provisions of this code and the *International Building Code* portion of the Connecticut State Building Code and Section 117 for items involving building construction, building services, or building systems. Pursuant to section 29-291a of the Connecticut General Statutes, the Connecticut State Fire Prevention Code shall be applicable for oil burners, flammable and combustible liquids, gas equipment and piping, liquefied gas and liquefied natural gas, hazardous chemicals, and processes and activities that occur in the building or structure that are not used to support the building components, services or systems, and for the purposes of prevention of fire and other related emergencies.

(Add) **3801.3 Permits:** *Permits* shall be required as set forth in Section 105.5.

CHAPTER 39 PROCESSING AND EXTRACTING FACILITIES

(Amd) **3901.1 Scope.** Plant processing or extraction facilities shall comply with the requirements of this chapter, Section 117, and the *International Building Code* portion of the Connecticut State Building Code for items involving building construction, building services, or building systems. Pursuant to section 29-291a of the Connecticut General Statutes, the Connecticut State Fire Prevention Code shall be applicable for oil burners, flammable and combustible liquids, gas equipment and piping, liquefied gas and liquefied natural gas, hazardous chemicals, and processes and activities that occur in the building or structure that are not used to support the building components, services or systems, and for the purposes of prevention of fire and other related emergencies. The extraction process includes the act of extraction of the oils and fats by use of a solvent,

desolventizing of the raw material, production of the miscella, distillation of the solvent from the miscella and solvent recovery. The use, storage, transfilling and handling of hazardous materials in these facilities shall comply with this chapter, other applicable provisions of this code, the *International Building Code* portion of the Connecticut State Building Code and NFPA 36.

Exception: Greenhouses in compliance with Section 3112 of the *International Building Code* portion of the Connecticut State Building Code not utilizing carbon dioxide enrichment.

(Del) **3901.2 Existing buildings or facilities.** Delete section.

(Amd) **3901.3 Permits.** *Permits* shall be required as set forth in Section 105.5.

(Amd) **3905.3 Ventilation.** Continuous mechanical exhaust ventilation shall be provided in accordance with Sections 3905.3.1 through 3905.3.4 and Chapter 4 of the *International Mechanical Code* portion of the Connecticut State Building Code. *HO inclusive*

CHAPTER 40 STORAGE OF DISTILLED SPIRITS AND WINES

(Amd) **4001.1 Scope.** Storage of distilled spirits in barrels and casks shall comply with the requirements of this chapter, in addition to other applicable requirements of this code, and Section 117 for items involving building construction, building services, or building systems. Pursuant to section 29-291a of the Connecticut General Statutes, the Connecticut State Fire Prevention Code shall be applicable for oil burners, flammable and combustible liquids, gas equipment and piping, liquefied gas and liquefied natural gas, hazardous chemicals, and processes and activities that occur in the building or structure that are not used to support the building components, services or systems, and for the purposes of prevention of fire and other related emergencies.

(Amd) **4001.1.1 Nonapplicability.** Chapter 50 and Chapter 57 are not applicable to the storage of distilled spirits in barrels and casks as identified in Section 5001.1, Exception 10, and Section 5701.2, Item 10.

(Add) **4001.1.2 Permits.** *Permits* shall be required as set forth in Section 105.5.

(Amd) **4003.2 Ventilation.** For rooms and spaces where distilled spirits in barrels and casks are stored, ventilation shall be provided in accordance with the *International Mechanical Code* portion of the Connecticut State Building Code and one of the following: *justify*

1. The rooms and spaces shall be ventilated at a rate sufficient to maintain the concentration of vapors within the area at or below 25 percent of the *lower flammable limit* (LFL). This shall be confirmed by sampling the actual vapor concentration under normal operating conditions. The sampling shall be conducted throughout the enclosed storage area, extending to or toward the bottom and the top of the enclosed storage area. The vapor concentration used to determine the required ventilation rate shall be the highest measured concentration during the sampling procedure. The sampling shall be conducted manually or by installation of a continuously monitoring flammable vapor detection system.

2. The rooms and spaces shall be provided exhaust ventilation at a rate of not less than 1 cfm per square foot [0.00508 m³/(s × m²)] of solid floor area. The exhaust ventilation shall be accomplished by natural or mechanical means, with discharge of the exhaust to a safe location outside the building.

(Del) **4005.3 Wine with 20 percent or less alcohol content.** Delete section.

CHAPTER 41 TEMPORARY HEATING AND COOKING OPERATIONS

(Amd) **4101.1 General.** The provisions of this chapter shall apply to the use, operation, testing and maintenance of mobile and portable equipment and devices used for temporary heating and cooking. Temporary heating and cooking operations with open flames shall also comply with any additional applicable requirements in Section 308, and Section 117 for items involving building construction, building services, or building systems. Pursuant to section 29-291a of the Connecticut General Statutes, the Connecticut State Fire Prevention Code shall be applicable for oil burners, flammable and combustible liquids, gas equipment and piping, liquefied gas and liquefied natural gas, hazardous chemicals, and processes and activities that occur in the building or structure that are not used to support the building components, services or systems, and for the purposes of prevention of fire and other related emergencies.

Exception: Temporary heating devices used in the course of construction, alteration and demolition of structures shall comply with Section 3304.

(Amd) **4101.2 Permits.** *Permits* shall be required as set forth in Section 105.5.

(Amd) **4101.4.1 Forest Fire Danger.** Temporary heating and cooking operations shall be in accordance with applicable fire weather danger risk regulations. (where?) citation needed

(Amd) **4103.1 Portable unvented heaters.** Portable unvented heaters shall conform to the requirements of sections 29-318 to 29-318c, inclusive, of the Connecticut General

Spacing

Statutes. Portable unvented fuel fired heating equipment shall be prohibited in occupancies in Groups A, E, I, R-1, R-2, R-3 and R-4 and ambulatory care facilities.

Exception: Portable outdoor gas-fired heating appliances in accordance with Section 4103.1.2.

(Amd) **4104.4 Cooking operations.** Cooking that produces sparks or grease-laden vapors shall not be performed within 10 feet (3048 mm) of a tent or membrane structure, except where the following conditions are met:

1. Cooking devices shall be isolated from the public.
2. Cooking devices shall be maintained and used according to the manufacturer's instructions.
3. Isolated cooking tents as approved by the fire code official.

Exception: Designated cooking tents with an automatic sprinkler system installed in accordance with **Section 903.3.1.1.** umbrella

(Amd) **4104.6 Operations.** Operations such as warming of foods, cooking demonstrations and similar operations that use solid flammables, butane or other similar devices that in the opinion of the local fire code official do not pose an ignition hazard, shall be approved.

(Del) **4106 MOBILE FOOD PREPERATION VEHICLES.** Delete section in its entirety.

initial cap, lower case

(ADD) CHAPTER 42

Fixed Guideways Transit and Passenger Rail Systems

All caps

(Amd) **4201.1 General.** Fixed guideway transit and passenger rail system facilities shall comply with NFPA 130.

(ADD) CHAPTERS 43 through 49
RESERVED

CHAPTER 50
HAZARDOUS MATERIALS – GENERAL PROVISIONS

(Amd) **5001.1 Scope.** Prevention, control and mitigation of dangerous conditions related to storage, dispensing, use and handling of hazardous materials shall comply with the requirements this chapter in addition to other applicable requirements of this code, and Section 117 for items involving building construction, building services, or building

systems. Pursuant to section 29-291a of the Connecticut General Statutes, the Connecticut State Fire Prevention Code shall be applicable for oil burners, flammable and combustible liquids, gas equipment and piping, liquefied gas and liquefied natural gas, hazardous chemicals, and processes and activities that occur in the building or structure that are not used to support the building components, services or systems, and for the purposes of prevention of fire and other related emergencies. Where applicable, NFPA 400 shall also apply.

This chapter shall apply to all hazardous materials, including those materials regulated elsewhere in this code, except that where specific requirements are provided in other chapters, those specific requirements shall apply in accordance with the applicable chapter. Where a material has multiple hazards, all hazards shall be addressed.

Exceptions:

1. In retail or wholesale sales occupancies, medicines, foodstuff, cosmetics, and commercial or institutional products containing not more than 50 percent by volume of water-miscible liquids and with the remainder of the solutions not being flammable, provided that such materials are packaged in individual containers not exceeding 1.3 gallons (5 L).
2. Alcoholic beverages in retail or wholesale sales occupancies provided that the liquids are packaged in individual containers not exceeding 1.3 gallons (5 L).
3. Application and release of pesticide and agricultural products and materials intended for use in weed abatement, erosion control, soil amendment or similar applications where applied in accordance with the manufacturers' instructions and label directions.
4. The off-site transportation of hazardous materials where in accordance with Department of Transportation (DOTn) regulations.
5. Building materials not otherwise regulated by this code.
6. Refrigeration systems (see Section 605).
7. Stationary storage battery systems regulated by Section 1206.2.
8. The display, storage, sale or use of fireworks and *explosives* in accordance with Chapter 56.
9. *Corrosives* utilized in personal and household products in the manufacturers' original consumer packaging in Group M occupancies.
10. The storage of beer, distilled spirits and wines in barrels and casks.
11. The use of, storage or both of dispensers containing alcohol-based hand rubs classified as Class I or II liquids where in accordance with Section 5705.5.
12. Specific provisions for flammable liquids in motor fuel-dispensing facilities, repair garages, airports and marinas in Chapter 23.

subject to OF

13. Storage and use of fuel oil in tanks and containers connected to oil-burning equipment. Such storage and use shall be in accordance with Section 605. For abandonment of fuel oil tanks, Chapter 57 applies.

14. Storage and display of aerosol products complying with Chapter 51.

15. Storage and use of *flammable or combustible liquids* that do not have a fire point when tested in accordance with ASTM D92, not otherwise regulated by this code.

16. *Flammable or combustible liquids* with a *flash point* greater than 95°F (35°C) in a water-miscible solution or dispersion with a water and inert (noncombustible) solids content of more than 80 percent by weight, which do not sustain combustion, not otherwise regulated by this code.

17. Commercial cooking oil storage tank systems located within a building and designed and installed in accordance with Section 607 and NFPA 30.

(Amd) **5001.1.1 Permits.** Permits shall be required as set forth in Section 105.5.

(Add) **5001.7 Cleaning and purging of flammable gas piping systems.** The cleaning and purging of any flammable gas piping system shall be in accordance with NFPA 56, *Fire and Explosion Prevention during Cleaning and Purging of Flammable Gas Piping Systems*. This includes purging into or out of service.

(Amd) **5003.3 Release of hazardous materials.** Release of hazardous materials shall be in accordance with the Regulations of Connecticut State Agencies adopted by the Department of Energy and Environmental Protection pursuant to title 22a of the Connecticut General Statutes.

(Del) **5003.3.1 Unauthorized discharges.** Delete section in its entirety.

(Amd) **5003.9. General safety precautions.** General precautions for the safe storage, handling or care of hazardous materials shall be in accordance with Sections 5003.9.1 to 5003.9.10, inclusive, and section 29-307a of the Connecticut General Statutes.

STET.

CHAPTER 51 AEROSOLS

(Amd) **5101.1 Scope.** The provisions of this chapter, the *International Building Code* portion of the Connecticut State Building Code and NFPA 30B shall apply to the manufacturing, storage and display of aerosol products, aerosol cooking spray products and plastic aerosol 3 products as it relates to items involving building construction, building services, or building systems. Pursuant to section 29-291a of the Connecticut

General Statutes, the Connecticut State Fire Prevention Code shall be applicable for oil burners, flammable and combustible liquids, gas equipment and piping, liquefied gas and liquefied natural gas, hazardous chemicals, and processes and activities that occur in the building or structure that are not used to support the building components, services or systems, and for the purposes of prevention of fire and other related emergencies. Manufacturing of aerosol products, aerosol cooking spray products and plastic aerosol 3 products using hazardous materials shall also comply with Chapter 50.

CHAPTER 53 COMPRESSED GASES

(Amd) **5301.1 Scope.** Storage, use and handling of compressed gases in compressed gas containers, cylinders, tanks and systems shall comply with this chapter, NFPA 55 and NFPA 400, including those gases regulated elsewhere in this code. as it relates to items involving building construction, building services, or building systems. Pursuant to section 29-291a of the Connecticut General Statutes the Connecticut State Fire Prevention Code shall be applicable for oil burners, flammable and combustible liquids, gas equipment and piping, liquefied gas and liquefied natural gas, hazardous chemicals, and processes and activities that occur in the building or structure that are not used to support the building components, services or systems, and for the purposes of prevention of fire and other related emergencies.

Partially full compressed gas containers, cylinders or tanks containing residual gases shall be considered as full for the purposes of the controls required.

Liquefied natural gas for use as a vehicular fuel shall also comply with NFPA 52 and NFPA 59A.

Compressed gases classified as hazardous materials shall also comply with Chapter 50 for general requirements and chapters addressing specific hazards, including Chapters 58 (Flammable Gases), 60 (Highly Toxic and Toxic Materials), 63 (Oxidizers, Oxidizing Gases and Oxidizing Cryogenic Fluids) and 64 (Pyrophoric Materials).

Compressed hydrogen (CH₂) shall also comply with the applicable portions of Chapters 23 and 58 of this code, the *International Fuel Gas Code* and NFPA 2.

Cutting and welding gases shall also comply with Chapter 35.

Exceptions:

1. Gases used as refrigerants in refrigeration systems (see Section 608).
2. Compressed natural gas (CNG) for use as a vehicular fuel shall comply with Chapter 23, NFPA 52 and the *International Fuel Gas Code*.
3. Cryogenic fluids shall comply with Chapter 55.
4. LP-gas shall comply with Chapter 61 and the *International Fuel Gas Code*.

Standards for
(Add) **5301.3 Cleaning and purging of flammable gas piping systems.** The cleaning and purging of any flammable gas piping system shall be in accordance with NFPA 56, *Fire and Explosion Prevention During Cleaning and Purging of Flammable Gas Piping Systems*. This includes purging into or out of service.

(Amd) **5306.5 Medical gas systems and equipment.** Medical gas systems and equipment shall be installed, tested and *labeled* in accordance with NFPA 99 and the general provisions of this chapter.

CHAPTER 54 CORROSIVE MATERIALS

(Amd) **5401.1 Scope.** The storage and use of *corrosive* materials shall be in accordance with this chapter and NFPA 400 as it relates to items involving building construction, building services, or building systems. Pursuant to section 29-291a of the Connecticut General Statutes, the Connecticut State Fire Prevention Code shall be applicable for oil burners, flammable and combustible liquids, gas equipment and piping, liquefied gas and liquefied natural gas, hazardous chemicals, and processes and activities that occur in the building or structure that are not used to support the building components, services or systems, and for the purposes of prevention of fire and other related emergencies.

Compressed gases shall also comply with Chapter 53.

Exceptions:

1. Display and storage in Group M and storage in Group S occupancies complying with Section 5003.11.
2. Stationary storage battery systems in accordance with Section 1207.
3. This chapter shall not apply to R-717 (ammonia) where used as a refrigerant in a refrigeration system (see Section 608).

justify

CHAPTER 55 CRYOGENIC MATERIALS

(Amd) **5501.1 Scope.** Storage, use and handling of *cryogenic fluids* shall comply with this chapter, NFPA 55 and NFPA 400 as it relates to items involving building construction, building services, or building systems. Pursuant to section 29-291a of the Connecticut General Statutes, the Connecticut State Fire Prevention Code shall be applicable for oil burners, flammable and combustible liquids, gas equipment and piping, liquefied gas and liquefied natural gas, hazardous chemicals, and processes and activities that occur in the building or structure that are not used to support the building components, services or

systems, and for the purposes of prevention of fire and other related emergencies. *Cryogenic fluids* classified as hazardous materials shall also comply with the general requirements of Chapter 50. Partially full containers containing residual *cryogenic fluids* shall be considered as full for the purposes of the controls required.

Exceptions:

1. Fluids used as refrigerants in refrigeration systems (see Section 608).
2. Liquefied natural gas (LNG), which shall comply with NFPA 59A.

Oxidizing *cryogenic fluids*, including oxygen, shall comply with Chapter 63, as applicable.

Flammable *cryogenic fluids*, including hydrogen, methane and carbon monoxide, shall comply with Chapters 23 and 58, as applicable.

Inert *cryogenic fluids*, including argon, helium and nitrogen, shall comply with ANSI/CGA P-18.

(Add) **5501.3 Cleaning and purging of flammable gas piping systems.** The cleaning and purging of any flammable gas piping system shall be in accordance with NFPA 56, *Fire and Explosion Prevention During Cleaning and Purging of Flammable Gas Piping Systems*. This includes purging into or out of service.

Standards
for

CHAPTER 56 EXPLOSIVES AND FIREWORKS

(Amd) **5601.1 Scope.** The provisions of this chapter shall govern the possession, manufacture, storage, handling, sale and use of explosives, explosive materials, fireworks and small ammunition. In addition to the requirements of this code, compliance with sections 29-343 to 29-370, inclusive, of the Connecticut General Statutes and sections 29-357-1b to 29-357-12b, inclusive, of the Regulations of the Department of Emergency Services and Public Protection pertaining to explosives, fireworks and special effects is required.

and 29-357-15a to 29-357-23a, inclusive?

(Del) **5601.1.1 Explosive material standard.** Delete section.

(Del) **5601.1.2 Explosive material terminals.** Delete section.

(Amd) **5601.1.3 Sparklers and fountains.** The possession, storage, handling and use of sparklers and fountains shall be in compliance with sections 29-343 to 29-370, inclusive, of the Connecticut General Statutes and sections 29-357-1b to 29-357-12b, inclusive, of the Regulations of the Department of Emergency Services and Public Protection.

(Amd) **5601.1.4 Rocketry.** The storage, handling and use of model and high-power rockets shall comply with section 29-367 of the Connecticut General Statutes and

Should this be 29-357-1b to 29-357-12b, inclusive, and sections 29-357-15a to 29-357-23a, inclusive, of the Connecticut Fireworks and Special Effects Code.

sections 29-367-1 to 29-367-3, inclusive, of the Regulations of Connecticut State Agencies.

(Amd) **5601.1.5 Ammonium nitrate.** The storage, handling and use of ammonium nitrate shall comply with section 29-349 of the Connecticut General Statutes and sections 29-349-106 to 29-349-378, inclusive, of the Regulations of Connecticut State Agencies.

Do all of these regulations apply to ammonium nitrate?

(Amd) **5601.2 Permit required.** Permits shall be required as set forth in section 105.5.

(Del) **5601.2.1 Residential uses.** Delete section.

(Del) **5601.2.2 Sale and retail display.** Delete section.

(Del) **5601.2.3 Permit restrictions.** Delete section.

(Del) **5601.2.4 Financial responsibility.** Delete section in its entirety.

(Del) **5601.3 Prohibited explosives.** Delete section.

(Del) **5601.4 Qualifications.** Delete section.

(Del) **5601.5 Supervision.** Delete section.

(Del) **5601.6 Notification.** Delete section.

(Del) **5601.7 Seizure.** Delete section.

(Del) **5601.8 Establishment of quantity of explosives and distances.** Delete section in its entirety.

(Del) **5603 RECORDKEEPING AND REPORTING.** Delete section in its entirety.

(Del) **5604 EXPLOSIVE MATERIALS STORAGE AND HANDLING.** Delete section in its entirety.

(Del) **5605 MANUFACTURE, ASSEMBLY AND TESTING OF EXPLOSIVES, EXPLOSIVE MATERIALS AND FIREWORKS.** Delete section in its entirety.

(Del) **5606 SMALL ARMS AMMUNITION AND SMALL ARMS AMMUNITION COMPONENTS.** Delete section in its entirety.

(Del) **5607 BLASTING.** Delete section in its entirety.

(Amd) **5608.1 General.** Outdoor fireworks displays and use of pyrotechnics before a proximate audience and pyrotechnic special effects in motion picture, television, theatrical

initial copy only

and group entertainment productions shall comply with sections 29-357 and 29-357a of the Connecticut General Statutes and the Department of Emergency Services and Public Protection's regulations pertaining to explosives and fireworks. (Sections 29-357-1b to 29-357-12b, inclusive, and Sections 29-106 to 20-378, inclusive).
do all these apply?
29-357-15a to 29-357-23a, inclusive?

(Del) **5608.2 Permit application.** Delete section in its entirety.

(Del) **5608.3 Approved fireworks displays.** Delete section.

(Del) **5608.4 Clearance.** Delete section.

(Del) **5608.5 Storage of fireworks at display site.** Delete section in its entirety.

(Del) **5608.6 Installation of mortars.** Delete section.

(Del) **5608.7 Handling.** Delete section.

(Del) **5608.8 Fireworks display supervision.** Delete section.

(Del) **5608.9 Post-fireworks display inspection.** Delete section.

(Del) **5608.10 Disposal.** Delete section.

(Amd) **5609.1. General.** The retail display and sale of sparklers and fountains shall comply with the applicable requirements of NFPA 1124.

(Add) **5609.1.1** The provisions of NFPA 1124, 2006 edition, are amended for use in Connecticut as follows:

(Amd) **NFPA 1124** *bold* **7.3.7 Storage Rooms.** Storage rooms containing consumer fireworks, regardless of size, in a new or existing permanent store shall be protected with an automatic sprinkler system installed in accordance with NFPA 13, *Standard for the Installation of Sprinkler Systems*, or separated from the retail sales area by a fire barrier having a fire resistance rating of not less than 1 hour. The quantity of fireworks permitted in storage shall not exceed 3,600 cubic feet (102 m³), including packaging. Such storage shall be segregated into areas of 1,200 cubic feet (34 m³) or less and separated by a minimum of 4 feet (1.22 m) of clear space.

(Amd) **NFPA 1124** *bold* **7.5.3 Storage Rooms.** Storage rooms containing consumer fireworks, regardless of size, in a new or existing permanent store shall be protected with an automatic sprinkler system installed in accordance with NFPA 13, *Standard for the Installation of Sprinkler Systems*, or separated from the retail sales area by a fire barrier having a fire-resistance rating of not less than 1 hour.

The quantity of *fireworks* permitted in storage shall not exceed 3,600 cubic feet (102 m³), including packaging. Such storage shall be segregated into areas of 1,200 cubic feet (34 m³) or less and separated by a minimum of 4 feet (1.22 m) of clear space.

(Add) **5609.2 Permit required.** Permits for the retail sale of sparklers and fountains shall be required as set forth in Section 105.5.

CHAPTER 57 FLAMMABLE AND COMBUSTIBLE LIQUIDS

(Amd) **5701.1 Scope and application.** Prevention, control and mitigation of dangerous conditions related to storage, use, dispensing, mixing and handling of flammable and combustible liquids shall be in accordance with this chapter, Chapter 50, and NFPA 30. The provisions of this code regulates items involving building construction, building services, or building systems. Pursuant to section 29-291a of the Connecticut General Statutes, the Connecticut State Fire Prevention Code shall be applicable for oil burners, flammable and combustible liquids, gas equipment and piping, liquefied gas and liquefied natural gas, hazardous chemicals, and processes and activities that occur in the building or structure that are not used to support the building components services or systems, and for the purposes of prevention of fire and other related emergencies.

space → (Del) **5703.6.3.1 Existing piping.** Delete section.

(Del) **5706.3 Well drilling and operating.** Delete section in its entirety.

(Del) **5706.6 Tank vehicles and vehicle operation.** Delete section in its entirety.

(Del) **Section 5707 ON-DEMAND MOBILE FUELING OPERATIONS** Delete section in its entirety.

initial cap, then lowercase

CHAPTER 58 FLAMMABLE GASES AND FLAMMABLE CRYOGENIC FLUIDS

(Amd) **5801.1 Scope.** The storage and use of flammable gases and flammable *cryogenic fluids* shall be in accordance with this chapter, NFPA 2, NFPA 55 and NFPA 400. *Compressed gases* shall also comply with Chapter 53 and *cryogenic fluids* shall also comply with Chapter 55. Flammable *cryogenic fluids* shall comply with Section 5806. Hydrogen motor fuel-dispensing stations and repair garages and their associated above-ground hydrogen storage systems shall also be designed, constructed and maintained in accordance with Chapter 23. The provisions of this code regulates items involving building construction, building services, or building systems. Pursuant to section 29-291a

of the Connecticut General Statutes, the Connecticut State Fire Prevention Code shall be applicable for oil burners, flammable and combustible liquids, gas equipment and piping, liquefied gas and liquefied natural gas, hazardous chemicals, and processes and activities that occur in the building or structure that are not used to support the building components, services or systems, and for the purposes of prevention of fire and other related emergencies.

Exceptions:

1. Gases used as refrigerants in refrigeration systems (see Section 608).
2. Liquefied petroleum gases and natural gases regulated by Chapter 61.
3. Fuel-gas systems and appliances regulated under the *International Fuel Gas Code* other than gaseous hydrogen systems and appliances.
4. Pyrophoric gases in accordance with Chapter 64.

(Add) **5801.3 Cleaning and purging of flammable gas piping systems.** The cleaning and purging of any flammable gas piping system shall be in accordance with NFPA 56, *Fire and Explosion Prevention During Cleaning and Purging of Flammable Gas Piping Systems*. This includes purging into or out of service.

~~(Del) Section 5809 ON-DEMAND HYDROGEN MOBILE FUELING OPERATIONS~~

Delete section in its entirety.

**CHAPTER 59
FLAMMABLE SOLIDS**

(Amd) **5901.1 Scope.** The storage and use of flammable solids shall be in accordance with this chapter and NFPA 400. The provisions of this code regulates items involving building construction, building services, or building systems. Pursuant to section 29-291a of the Connecticut General Statutes, the Connecticut State Fire Prevention Code shall be applicable for oil burners, flammable and combustible liquids, gas equipment and piping, liquefied gas and liquefied natural gas, hazardous chemicals, and processes and activities that occur in the building or structure that are not used to support the building components, services and/or systems, and for the purposes of prevention of fire and other related emergencies.

**CHAPTER 60
HIGHLY TOXIC AND TOXIC MATERIALS**

(Amd) **6001.1 Scope.** The storage and use of highly toxic and toxic materials shall comply with this chapter and NFPA 400. *Compressed gases* shall also comply with Chapter 53.

The provisions of this code regulates items involving building construction, building services, or building systems. Pursuant to section 29-291a of the Connecticut General Statutes, the Connecticut State Fire Prevention Code shall be applicable for oil burners, flammable and combustible liquids, gas equipment and piping, liquefied gas and liquefied natural gas, hazardous chemicals, and processes and activities that occur in the building or structure that are not used to support the building components, services or systems, and for the purposes of prevention of fire and other related emergencies.

Exceptions:

1. Display and storage in Group M and storage in Group S occupancies complying with Section 5003.11.
2. Conditions involving pesticides or agricultural products as follows:
 - 2.1. Application and release of pesticide, agricultural products and materials intended for use in weed abatement, erosion control, soil amendment or similar applications when applied in accordance with the manufacturer's instruction and label directions.
 - 2.2. Transportation of pesticides in compliance with the Federal Hazardous Materials Transportation Act and regulations thereunder.
 - 2.3. Storage in *dwellings* or private garages of pesticides registered by the U.S. Environmental Protection Agency to be utilized in and around the home, garden, pool, spa and patio.

**CHAPTER 61
LIQUEFIED PETROLEUM GASES**

remove underline
(Amd) **6101.1 Scope.** Storage, handling and transportation of liquefied petroleum gas (LP-gas) and the installation of LP-gas equipment pertinent to systems for such uses shall comply with this chapter and NFPA 58. Properties of LP-gases shall be determined in accordance with Appendix B of NFPA 58. The provisions of this code regulates items involving building construction, building services, or building systems. Pursuant to section 29-291a of the Connecticut General Statutes, the Connecticut State Fire Prevention Code shall be applicable for oil burners, flammable and combustible liquids, gas equipment and piping, liquefied gas and liquefied natural gas, hazardous chemicals, and processes and activities that occur in the building or structure that are not used to support the building components, services or systems, and for the purposes of prevention of fire and other related emergencies.

space → (Amd) **6101.2 Permits.** Permits shall be required as set forth in Section 105.5. Distributors shall not fill an LP-gas container for which a permit is required unless a permit for installation has been issued for that location by the *fire code official*.

(Add) **6101.4 Cleaning and purging of flammable gas piping systems.** The cleaning

Standard for and purging of any flammable gas piping system shall be in accordance with NFPA 56, *Fire and Explosion Prevention During Cleaning and Purging of Flammable Gas Piping Systems*. This includes purging into or out of service.

(Amd) **6104.2 Maximum capacity within established limits.** For the protection of heavily populated or congested areas, storage of liquified petroleum gas shall not exceed an aggregate capacity in accordance with NFPA 58 Section 4.3.1.

Exception: In particular installations, this capacity limit shall be determined by the *fire code official*, after consideration of special features such as topographical conditions, nature of occupancy, and proximity to buildings, capacity of proposed LP-gas containers, degree of fire protection to be provided and capabilities of the local fire department.

(Add) **6106.4 Written emergency plan.** A written emergency response plan shall be required for industrial plants, bulk plants, and dispensing stations. The facility emergency response plan, when required, shall be in writing and amended as required but at least every two years. Written documentation of the current emergency response plan shall be maintained at the facility and shall be provided upon written request to the local fire marshal and emergency response agencies. The fire safety analysis and special fire protection provisions referred to in Section 6.30 of NFPA 58 shall be incorporated into the emergency response plan as appropriate.

(Add) **6106.5 Identification** LP-gas fuel suppliers shall affix and maintain in a legible condition, their firm name(s) and emergency telephone number(s) in a readily visible location on or near LP-gas supplier-owned Department of Transportation (DOT) and American Society of Mechanical Engineers (ASME) containers installed on a consumer's premises.

(Add) **6106.5.1** The firm name(s) and emergency telephone number(s) on the containers shall be at least one-half (1/2) inch (12.7 mm) high and of contrasting color to the container.

(Add) **6106.5.2** The emergency telephone number(s) shall be staffed 24 hours a day to ensure that the LP-gas supplier is available in the event of an emergency at the consumer's premises.

(Add) **6106.6 Ownership.** Cylinders, tanks or containers shall be filled, evacuated or transported only by the owner of the cylinder, tank or container or upon the owner's authorization.

(Amd) **6107.4 Protecting containers from vehicles.** Where exposed to vehicular damage due to proximity to alleys, driveways or parking areas, LP-gas containers, regulators and piping shall be protected in accordance with Section 312 and NFPA 58.

CHAPTER 62 ORGANIC PEROXIDES

(Amd) **6201.1 Scope.** The storage and use of organic peroxides shall be in accordance with this chapter, Chapter 50 and NFPA 400. The provisions of this code regulates items involving building construction, building services, or building systems. Pursuant to section 29-291a of the Connecticut General Statutes, the Connecticut State Fire Prevention Code shall be applicable for oil burners, flammable and combustible liquids, gas equipment and piping, liquefied gas and liquefied natural gas, hazardous chemicals, and processes and activities that occur in the building or structure that are not used to support the building components, services or systems, and for the purposes of prevention of fire and other related emergencies.

Unclassified detonable organic peroxides that are capable of *detonation* in their normal shipping containers under conditions of fire exposure shall be stored in accordance with Chapter 56.

CHAPTER 63 OXIDIZERS, OXIDIZING GASES AND OXIDIZING CRYOGENIC FLUIDS

(Amd) **6301.1 Scope.** The storage and use of oxidizing materials shall be in accordance with this chapter, Chapter 50 and NFPA 400. Oxidizing gases shall also comply with Chapter 53. Oxidizing *cryogenic fluids* shall also comply with Chapter 55. The provisions of this code regulates items involving building construction, building services, or building systems. Pursuant to section 29-291a of the Connecticut General Statutes, the Connecticut State Fire Prevention Code shall be applicable for oil burners, flammable and combustible liquids, gas equipment and piping, liquefied gas and liquefied natural gas, hazardous chemicals, and processes and activities that occur in the building or structure that are not used to support the building components, services or systems, and for the purposes of prevention of fire and other related emergencies.

Exceptions:

1. Display and storage in Group M and storage in Group S occupancies complying with Section 5003.11.
2. Bulk oxygen systems at industrial and institutional consumer sites shall be in accordance with NFPA 55.
3. Liquid oxygen stored or used in home health care in Group I-1, I-4 and R occupancies in accordance with Section 6306.

CHAPTER 64 PYROPHORIC MATERIALS

(Amd) **6401.1 Scope.** The storage and use of pyrophoric materials shall be in accordance with this chapter and NFPA 400. *Compressed gases* shall also comply with Chapter 53. The provisions of this code regulates items involving building construction, building services, or building systems. Pursuant to section 29-291a of the Connecticut General Statutes, the Connecticut State Fire Prevention Code shall be applicable for oil burners, flammable and combustible liquids, gas equipment and piping, liquefied gas and liquefied natural gas, hazardous chemicals, and processes and activities that occur in the building or structure that are not used to support the building components services or systems, and for the purposes of prevention of fire and other related emergencies.

~~PYROXYLIN~~ CHAPTER 65 ~~PYROXLIN (CELLULOSE NITRATE) PLASTICS~~

(Amd) **6501.1 Scope.** This chapter shall apply to the storage and handling of plastic substances, materials or compounds with cellulose nitrate (pyroxylin) as a base, by whatever name known, in the form of blocks, sheets, tubes or fabricated shapes. The provisions of this code regulates items involving building construction, building services, or building systems. Pursuant to section 29-291a of the Connecticut General Statutes, the Connecticut State Fire Prevention Code shall be applicable for oil burners, flammable and combustible liquids, gas equipment and piping, liquefied gas and liquefied natural gas, hazardous chemicals, and processes and activities that occur in the building or structure that are not used to support the building components services or systems, and for the purposes of prevention of fire and other related emergencies.

Cellulose nitrate (pyroxylin) motion picture film shall comply with the requirements of Section 306.

CHAPTER 66 UNSTABLE (REACTIVE) MATERIALS

(Amd) **6601.1 Scope.** The storage and use of unstable (reactive) materials shall be in accordance with this chapter and NFPA 400. The provisions of this code regulates items involving building construction, building services, or building systems. Pursuant to section 29-291a of the Connecticut General Statutes, the Connecticut State Fire Prevention Code shall be applicable for oil burners, flammable and combustible liquids, gas equipment and piping, liquefied gas and liquefied natural gas, hazardous chemicals, and processes and activities that occur in the building or structure that are not used to support the building components services or systems, and for the purposes of prevention of fire and other related emergencies.

Compressed gases shall also comply with Chapter 53.

Exceptions:

1. Display and storage in Group M and storage in Group S occupancies complying with Section 5003.11.
2. Detonable unstable (reactive) materials shall be stored in accordance with Chapter 56.

**CHAPTER 67
WATER-REACTIVE SOLIDS AND LIQUIDS**

delete underline
(Amd) **6701.1 Scope.** The storage and use of water-reactive solids and liquids shall be in accordance with this chapter and NFPA 400. The provisions of this code regulates items involving building construction, building services, or building systems. Pursuant to section 29-291a of the Connecticut General Statutes, the Connecticut State Fire Prevention Code shall be applicable for oil burners, flammable and combustible liquids, gas equipment and piping, liquefied gas and liquefied natural gas, hazardous chemicals, and processes and activities that occur in the building or structure that are not used to support the building components services or systems, and for the purposes of prevention of fire and other related emergencies.

Exceptions:

1. Display and storage in Group M and storage in Group S occupancies, complying with Section 5003.11.
2. Detonable water-reactive solids and liquids shall be stored in accordance with Chapter 56.

**CHAPTER 80
REFERENCED STANDARDS**

this Chapter
(Add) **8001 General.** When a requirement differs between this code and a referenced code or standard, the requirement of this code shall apply. Where the extent of a referenced code or standard includes subject matter that is within the scope of this code, the provisions of this code, as applicable, shall take precedence over the provisions that are in the referenced code or standard. The documents or portions thereof listed in ~~Chapter 80~~ as referenced, except as amended, shall be considered part of the requirements of this code to the extent called for by this code.

(Del) IFGC—24: International Fuel Gas Code®

(Amd) NFPA

National Fire Protection Association
1 Batterymarch Park
Quincy, MA 02169-7471

02—23: Hydrogen Technologies Code

1206.3, 1206.4, 2309.1, 2309.3.1.1, 2309.3.1.2, 2309.4, 2309.6, 2311.8,
2311.8.2, 2311.8.10, 2311.8.11, 5301.1, 5801.1

04—24: Standard for Integrated Fire Protection and Life Safety System Testing

901.6.2.1, 901.6.2.2

10—22: Standard for Portable Fire Extinguishers

Table 901.6.1, 906.2, Table 906.3(1), Table 906.3(2), 906.3.2, 906.3.4,
3006.3

11—24: Standard for Low-, Medium-, and High-Expansion Foam

904.7, 904.14, 5704.2.9.2.2

12—22: Standard on Carbon Dioxide Extinguishing Systems

Table 901.6.1, 904.8, 904.12, 1207.5.5

12A—22: Standard on Halon 1301 Fire Extinguishing Systems

Table 901.6.1, 904.9

13—22: Standard for the Installation of Sprinkler Systems

903.3.1.1, 903.3.2, 903.3.8.2, 903.3.8.5, 904.13, 905.3.4, 907.6.4, 914.3.2,
1019.3, 1103.4.8, 3201.1, 3204.2, 3205.5, Table 3206.2, 3206.4.1,
3206.10, 3207.2, 3207.2.1, 3208.2.2, 3208.2.2.1, 3208.4, 3210.1, 3401.1,
5104.1, 5104.1.1, 5106.5.7, 5704.3.3.9, Table 5704.3.6.3(7), 5704.3.7.5.1,
5704.3.8.4

13D—22: Standard for the Installation of Sprinkler Systems in One- and Two-Family Dwellings and Manufactured Homes

903.3.1.3

13R—22: Standard for the Installation of Sprinkler Systems in Low-Rise Residential Occupancies

903.3.1.2, 903.3.5.2, 903.4.1

14—24: Standard for the Installation of Standpipe and Hose Systems

905.2, 905.3.4, 905.4.2, 905.6.2, 905.8

15—22: Standard for Water Spray Fixed Systems for Fire Protection

1207.5.5, 5704.2.9.2.3

17—24: Standard for Dry Chemical Extinguishing Systems

Table 901.6.1, 904.6, 904.14

17A—24: Standard for Wet Chemical Extinguishing Systems

Table 901.6.1, 904.5, 904.14

20—22: Standard for the Installation of Stationary Pumps for Fire Protection
913.1, 913.2, 913.5.1

22—23: Standard for Water Tanks for Private Fire Protection
507.2.2

the
24—22: Standard for Installation of Private Fire Service Mains and Their Appurtenances
507.2.1, 2809.5

25—23: Standard for the Inspection, Testing, and Maintenance of Water-Based Fire Protection Systems
507.5.3, Table 901.6.1, 901.7, 904.7.1, 912.7, 913.5

30—24: Flammable and Combustible Liquids Code
607.1, 5001.1, 5701.2, 5703.6.2, 5703.6.2.1, 5704.2.7, 5704.2.7.1, 5704.2.7.2, 5704.2.7.3.2, 5704.2.7.4, 5704.2.7.6, 5704.2.7.7, 5704.2.7.8, 5704.2.7.9, 5704.2.9.3, 5704.2.9.4, 5704.2.9.6.1.1, 5704.2.9.6.1.2, 5704.2.9.6.1.3, 5704.2.9.6.1.4, 5704.2.9.6.1.5, 5704.2.9.6.2, 5704.2.9.7.3, 5704.2.10.2, 5704.2.11.3, 5704.2.11.4.2, 5704.2.12.1, 5704.3.1, 5704.3.6, Table 5704.3.6.3(1), Table 5704.3.6.3(2), Table 5704.3.6.3(3), 5704.3.7.2.3, 5704.3.8.4, 5706.8.3

delete hyphen
30A—24: Code for Motor Fuel-Dispensing Facilities and Repair Garages
2301.4, 2301.5, 2301.6, 2306.6.3, 2310.1

30B—23: Code for the Manufacture and Storage of Aerosol Products
5101.1, 5103.1, 5104.1, Table 5104.3.1, Table 5104.3.2, Table 5104.3.2.2, 5104.3.3, 5104.4.1, 5104.5.2, 5104.6, 5104.8.2, 5106.2.2, 5106.2.4, 5106.3.2, Table 5106.4, 5106.5.1, 5106.5.6, 5107.1

31—20: Standard for the Installation of Oil-Burning Equipment
605.1.6, 605.4.1, 605.4.3

32—21: Standard for Drycleaning Facilities
2107.1, 2107.3

33—24: Standard for Spray Application Using Flammable or Combustible Materials
2403.3, 2404.5.3, 2404.5.5

34—21: Standard for Dipping, Coating, and Printing Processes Using Flammable or Combustible Liquids
2405.3, 2405.4.1.1

35—21: Standard for the Manufacture of Organic Coatings
2901.3, 2905.4

36—21: Standard for Solvent Extraction Plants
3909.1

40—22: Standard for the Storage and Handling of Cellulose Nitrate Film

306.2

45—24: Standard on Fire Protection for Laboratories Using Chemicals

3803.1.5, 3804.1.1.7, 3805.2.1, 3805.2.2

51—23: Standard for the Design and Installation of Oxygen-Fuel Gas Systems for Welding, Cutting and Allied Processes

3501.5, 3507.1, 3509.1

51B—24: Standard for Fire Prevention During Welding, Cutting, and Other Hot Work

3501.1

52—23: Vehicular ~~Gaseous~~ Fuel Systems Code

5301.1

54—24: National Fuel Gas Code

102.14,

55—23: Compressed Gases and Cryogenic Fluids Code

3508.1, 5301.1, 5307.4.2, 5501.1, 5801.1, 6301.1

56—23: Standard for Fire and Explosion Prevention During Cleaning and Purging of Flammable Gas Piping Systems

3309.2.2

58—24: Liquefied Petroleum Gas Code

603.4.2.1.1, 2311.5, 3903.6, 6101.1, 6103.1, 6103.2.1, 6103.2.1.2, 6103.2.1.7, 6103.2.2, 6104.1, 6104.3.2, 6104.4, 6105.2, 6106.2, 6106.3, 6107.2, 6107.4, 6108.1, 6108.2, 6109.11.2, 6111.3

59A—23: Standard for the Production, Storage, and Handling of Liquefied Natural Gas (LNG)

5301.1, 5501.1

61—20: Standard for the Prevention of Fires and Dust Explosions in Agricultural and Food Processing Facilities

Table 2205.1

68—23: Standard on Explosion Protection by Deflagration Venting

911.1, 911.4, Table 2205.1

69—19: Standard on Explosion Prevention Systems

911.1, 911.3, Table 2205.1

70—23: National Electrical Code -- as AMENDED by the State Building Code

309.2, 603.1, 603.1.1, 603.2.1, 603.4, 603.4.3, 603.5, 603.8, 605.1.2, 605.1.6, 605.5.2, 607.6, 607.7, 608.17, 608.18, 904.3.1, 907.6.1, 909.12.2, 909.16.3, 910.4.6, 1006.2.2.4, 1010.2.8.2, 1201.2, 1203.1.3, 1205.1, 1206.4, 1206.13, 1206.3, 1207.4.1, 1207.4.2, 1207.4.8, 1207.5.3, 1207.10.6, 1207.10.7.4, 1207.11.5, 1207.11.9, 2006.3.4, 2104.2.3, 2108.2, 2203.4.1, 2203.5, Table 2205.1, 2301.5, 2305.4, 2308.8.1.2.4, 2309.2.3,

2311.3.1, 2311.8.10, 2403.2.1, 2403.2.1.1, 2403.2.1.4, 2403.2.5, 2404.6.1.2.2, 2404.9.4, 2504.5, 2603.2.1, 2703.7.1, 2703.7.2, 2703.7.3, 2803.4, 2904.1, 3103.11.6.1, 3107.6, 3107.12.7, 3305.6, 3506.4, 3901.4, 4003.3.3, 4003.3.4, 4101.5, 5003.8.7.1, 5003.9.4, 5303.7.6, 5303.8, 5303.16.11, 5303.16.14, 5503.6, 5503.6.2, 5703.1, Table 5703.1.1, 5703.1.3, 5704.2.8.12, 5704.2.8.17, 5706.2.8, 5803.1.5, 5803.1.5.1, 5807.1.10, 5906.5.5, 5906.5.6, 6109.15.1

72—22: National Fire Alarm and Signaling Code

508.1.6, Table 901.6.1, 903.4.2, 904.3.5, 907.1.2, 907.2, 907.2.6, 907.2.9.3, 907.2.11, 907.2.13.2, 907.3, 907.3.3, 907.3.4, 907.5.2.1.2, 907.5.2.1.3, 907.5.2.1.3.2, 907.5.2.2, 907.5.2.2.5, 907.6, 907.6.1, 907.6.2, 907.6.6, 907.7, 907.7.1, 907.7.2, 907.8, 907.8.2, 907.8.4, 915.3.2, 915.3.3, 915.3.4, 915.5.2, 917.1, 1032.8, 1103.3.2, 1203.2.4, 1207.5.4, 1207.6.1.2.3, 1207.6.1.2.4, Table 1207.7, 2810.11

76—24: Standard for the Fire Protection of Telecommunications Facilities

1207.1.4.1, 1207.2.1, 1207.3.1, 1207.3.7.1, 1207.4.1, 1207.5.1, 1207.5.2, 1207.5.3, 1207.5.5, Table 1207.6, 1207.6.2.3, Table 1207.7

77—24: Recommended Practice on Static Electricity

Table 2205.1

80—22: Standard for Fire Doors and Other Opening Protectives

705.2, 705.2.7, 706.1, Table 901.6.1, 909.18.3, 1010.3.3, 1032.2.2

85—23: Boiler and Combustion Systems Hazards Code

Table 2205.1

86—23: Standard for Ovens and Furnaces

3001.1

92—24: Standard for Smoke Control Systems

909.7, 909.8

96—24: Standard for Ventilation Control and Fire Protection of Commercial Cooking Operations

606.2, 606.3, 904.14

99—24: Health Care Facilities Code

603.1.2, 603.5.1.1, 609.1, 1105.11.1, 1105.11.2, 1203.4.1, 1203.5.1, 5003.7.4, 5306.4, 5306.5

101—24: Life Safety Code

1030.6.2

101—21: Life Safety Code -- as AMENDED by the 2022 Connecticut State Fire Safety Code Part IV.

1101.3.1, 1104.27, 1108.3, 1109.2, 1110.2, 1110.3

105—22: Standard for Smoke Door Assemblies and Other Opening Protectives

*delete
space → (*

*em
dash*

705.2, 706.1, Table 901.6.1, 909.18.3

110—22: Standard for Emergency and Standby Power Systems

913.5.2, 913.5.3, 1203.1.3, 1203.4, 1203.5

111—22: Standard on Stored Electrical Energy Emergency and Standby Power Systems

1203.1.3, 1203.4, 1203.5

120—23: Standard for Fire Prevention and Control in Coal Mines

Table 2205.1

130—23: Standard for Fixed Guideway Transit and Passenger Rail Systems

4201.1

160—21: Standard for the Use of Flame Effects Before an Audience

308.3.2

170—24: Standard for Fire Safety and Emergency Symbols

1025.2.6.1

204—24: Standard for Smoke and Heat Venting

Table 901.6.1, 910.5.1, 910.5.2

232—22: Standard for the Protection of Records

3210.1.1

241—22: Standard for Safeguarding Construction, Alteration, and Demolition Operations

3301.1, 3303.2

253—23: Standard Method of Test for Critical Radiant Flux of Floor Covering Systems Using a Radiant Heat Energy Source

804.3.1, 804.3.2, 804.4

260—24: Standard Methods of Tests and Classification System for Cigarette Ignition Resistance of Components of Upholstered Furniture

805.1.1.1, 805.2.1.1, 805.3.1.1, 805.4.1.1

261—23: Standard Method of Test for Determining Resistance of Mock-up Upholstered Furniture Material Assemblies to Ignition by Smoldering Cigarettes

805.2.1.1, 805.2.1.1, 805.3.1.1, 805.1.1.1, 805.4.1.1

265—23: Standard Methods of Fire Tests for Evaluating Room Fire Growth Contribution of Textile or Expanded Vinyl Wall Coverings in Full Height Panels and Walls

803.5.1, 803.5.1.1

286—24: Standard Methods of Fire Tests for Evaluating Contribution of Wall and Ceiling Interior Finish to Room Fire Growth

803.1, 803.1.1, 803.1.1.1, 803.3, 803.12, 803.13, 804.1.1, 804.2.4

289—23: Standard Method of Fire Test for Individual Fuel Packages

807.3, 807.4.1, 807.5.1.1, 808.2

- 303—21: Fire Protection Standard for Marinas and Boatyards**
3603.5, 3603.6, 3604.2
- 318—22: Standard for the Protection of Semiconductor Fabrication Facilities**
2703.16
- 326—20: Standard for the Safeguarding of Tanks and Containers for Entry, Cleaning, or Repair**
3510.1
- 385—22: Standard for Tank Vehicles for Flammable and Combustible Liquids**
5706.5.4.5, 5706.6, 5706.6.1, 5707.2
- 400—22: Hazardous Materials Code**
5601.1.5, Table 6303.1.4, 6304.1.2, Table 6304.1.5(1), Table 6304.1.5(2),
6401.1, 6601.1, 6701.1
- 407—22: Standard for Aircraft Fuel Servicing**
2006.2, 2006.3
- 409—22: Standard on Aircraft Hangars**
914.8.3, Table 914.8.3, 914.8.3.1, 914.8.6
- 410—20: Standard on Aircraft Maintenance**
2004.7
- 415—22: Standard on Airport Terminal Buildings, Fueling Ramp Drainage, and Loading Walkways**
2001.2
- 484—22: Standard for Combustible Metals**
319.3.4, 319.3.6, 319.6, Table 2205.1
- 495—23: Explosive Materials Code**
202, 911.1, 911.5
- 498—23: Standard for Safe Havens and Interchange Lots for Vehicles Transporting Explosives**
5601.1.2
- 502—23: Standard for Road Tunnels, Bridges, and Other Limited Access Highways**
403.10.7
- 505—24: Fire Safety Standard for Powered Industrial Trucks, Including Type Designations, Areas of Use, Conversions, Maintenance, and Operations**
309.2, 4003.3.3
- 652—19: Standard on the Fundamentals of Combustible Dust**
319.3.5, 2203.4.8, 2203.5, 2204.1, 2204.2, 2205.1.1
- 654—20: Standard for the Prevention of Fire and Dust Explosions from the Manufacturing, Processing, and Handling of Combustible Particulate Solids**
319.3.5, 2203.1, 2203.5, Table 2205.1
- 655—17: Standard for Prevention of Sulfur Fires and Explosions**

Table 2205.1

664—20: Standard for the Prevention of Fires and Explosions in Wood Processing and Woodworking Facilities

2203.1, 2203.5, Table 2205.1, 2805.3

701—23: Standard Methods of Fire Tests for Flame Propagation of Textiles and Films

807.3, 807.4.1, 807.5.1.2, 2603.5, 3104.2, 3106.3

703—24: Standard for Fire-Retardant-Treated Wood and Fire-Retardant Coatings for Building Materials

803.4

704—22: Standard System for the Identification of the Hazards of Materials for Emergency Response

202, 608.8, 5003.2.2.2, 5003.5, 5003.10.2, 5005.1.10, 5005.1.12, 5005.2.1.1, 5005.4.4, 5503.4.1, 5704.2.3.2

750—23: Standard on Water Mist Fire Protection Systems

202, Table 901.6.1, 904.11.1.1, 904.14, 1207.5.5

770—21: Standard on Hybrid (Water and Inert Gas) Fire-Extinguishing Systems

904.13

780—23: Standard for the Installation of Lightning Protection Systems

4003.4

853—20: Installation of Stationary Fuel Cell Power Systems

1206.3, 1206.4, 1206.6.2, 1206.11, 1206.12

855—23: Standard for the Installation of Stationary Energy Storage Systems

1201.1, 1207

914—23: Code for Fire Protection of Historic Structures

1122—18: Code for Model Rocketry

5601.1.4

1123—22: Code for Fireworks Display

202, 5608.1

1124—06: Code for the Manufacture, Transportation, and Storage and Retail Sales of Fireworks and Pyrotechnic Articles -- as AMENDED by Section 5609.1.2 of this Code

202, 5601.1.3, 5609.1

1125—22: Code for the Manufacture of Model Rocket and High-Power Rocket Motors

5601.1.4

bold
Standard for the

doesn't exist?
5609.2?

ADOPTED

1126: Standard for the Use of Pyrotechnics Before a Proximate Audience as adopted in the Regulations of Connecticut State Agencies; Connecticut Fireworks and Special Effects Code

5608.1

1127—18: Code for High Power Rocketry

5601.1.4

1225—22: Standard for Emergency Services Communications

510.4.2, 510.5

2001—22: Standard on Clean Agent Fire Extinguishing Systems

Table 901.6.1, 904.10, 1207.5.5

2010—20: Standard for Fixed Aerosol Fire-Extinguishing Systems

Table 901.6.1, 904.13, 1207.5.5

State of Connecticut

Department of Emergency Services and Public Protection

1111 Country Club Road

Middletown, CT

Sections 29-357-1b to 29-357-12b, inclusive, of the Regulations of Connecticut State Agencies; Connecticut Fireworks and Special Effects Code.

Sections 29-349-106 to 29-378, inclusive, of the Regulations of Connecticut State Agencies; Connecticut Storage, Transportation and Use of Explosives and Blasting Agents Code.

State of Connecticut

Department of Administrative Services

450 Columbus Blvd.

Hartford, CT 06103

State Fire Prevention Code – 2026

The Connecticut State Fire Prevention Code adopted pursuant to section 29-291a of the Connecticut General Statutes.

Building Code – 2026

The Connecticut State Building Code adopted pursuant to section 29-252 of the Connecticut General Statutes.

Safety Code for Elevators and Escalators - 2018

Connecticut (see -1e)

2026 Connecticut State Fire Safety Code

Issued for LRRC: December 2, 2025

edition year?

sections 29-337-1b to 29-337-16a (-23a?), inclusive, of

see -1b...

-16a? (-23a?) ← see -1b...

justified

space →

State

-6e

Sections 29-192-1e to 29-192-16e, inclusive, of the Regulations of Connecticut State Agencies, concerning the Safety Code for Elevators and Escalator, Adopted pursuant to section 29-192 of the Connecticut General Statutes.

Connecticut

~~(DEL)~~ APPENDIX A
BOARD OF APPEALS

un-bold
(Del) Delete Appendix.

only initial cap, spacing

(ADD) APPENDIX A
CONNECTICUT STATE FIRE SAFETY CODE HISTORY

September 29, 1947 - Connecticut Fire Safety Code

Established the first Fire Safety Code as authorized by the Connecticut General Assembly pursuant to Public Act 419 of the Public Acts of 1947. This code was published in progressive installments as follows:

September 29, 1947

Added Sections 172-1-1 to 172-1-25 dealing with Places of Assembly to the Administrative Regulations of Connecticut State Agencies (see *Connecticut Law Journal* September 29, 1947 page 5)

inclusive,

January 19, 1948

Revised current regulations and added Sections 172-1-26 to 172-1-67 dealing with Hotels, Outside Stairs and Heating and Cooking Facilities to the Administrative Regulations of Connecticut State Agencies (see *Connecticut Law Journal* January 19, 1948 page 2)

inclusive,

June 28, 1948

Revised current regulations and added Sections 172-1-68 to 172-1-134 dealing with Hospitals and Convalescent Homes to the Administrative Regulations of Connecticut State Agencies

inclusive,

*See document titled **1947 CFSC with 1949 Statute revisions** that includes revised section numbers that were changed in 1949.

December 15, 1953

Revised current regulations and added Sections 172-1-135 to 172-1-175 dealing with Schools to the Administrative Regulations of Connecticut State Agencies

inclusive,

justify text

justify text on This page and pages 140 to 140, inclusive

April 27, 1954

Revised current regulations and added Sections 172-1-176 to 172-1-203, dealing with Boarding Homes to the Administrative Regulations of Connecticut State Agencies

August 10, 1954

Revised current regulations added Sections 172-1-204 to 172-1-213, dealing with Rooming Houses to the Administrative Regulations of Connecticut State Agencies (see *Connecticut Law Journal* August 10, 1954, page 15)

January 11, 1955

Revised current regulations added Sections 172-1-214 to 172-1-230, dealing with Child Day Care Centers to the Administrative Regulations of Connecticut State Agencies (see *Connecticut Law Journal* January 11, 1955, page 8)

1956 Connecticut Fire Safety Code

(Revised to January 1, 1956 – various effective dates)

The Connecticut Fire Safety Code had been published in progressive installments since September of 1947. This edition was a compilation of all regulations and amendments as of January 1, 1956.

August 27, 1957

Revised current regulations for construction and use of buildings of combustible construction; Sections 29-40-67 to 29-40-68 for hospitals, Sections 29-40-101 to 29-40-102 for convalescent homes, Sections 29-40-132 for schools, and Section 29-40-173 to 29-40-174 for boarding homes.

September 3, 1968

Revised current regulations added Section 29-40-150a dealing with private schools for trade instruction.

*See document titled **CFSC prior to 11-30-1971** that contains the 1956 Connecticut Fire Safety Code (CFSC) with the 1957 & 1968 revisions prior to November 30, 1971.

1971 State Fire Safety Code

(Effective November 30, 1971)

Sections 29-41-1.01 to 29-41-18.25 and Appendix, inclusive, of the

Administrative Regulations of Connecticut State Agencies

1981 Connecticut State Fire Safety Code

(Effective September 1, 1981)

Section 29-41-19 of the Administrative Regulations of Connecticut State Agencies

1987 Connecticut Fire Safety Code

(Effective April 15, 1987)

Section 29-292-1 of the Administrative Regulations of Connecticut State Agencies (see *Connecticut Law Journal* March 10, 1987 page 48C)

- Adopts 1985 edition of National Fire Protection Association Standard No. 101, Life Safety Code, (NFPA 101) with Connecticut Amendments

1989 Connecticut Fire Safety Code

(Effective October 16, 1989)

Section 29-292-1b of the Administrative Regulations of Connecticut State Agencies

- Adopts 1988 edition of NFPA 101 with Connecticut Amendments

1994 Connecticut Fire Safety Code

(Effective June 15, 1994)

Section 29-292-1c of the Administrative Regulations of Connecticut State Agencies

- Adopts 1991 edition of NFPA 101 with Connecticut Amendments
- **Effective April 25, 1997, errata and revisions were issued for the 1994 Connecticut Fire Safety Code**

1999 Connecticut State Fire Safety Code

(Effective May 1, 1999)

Sections 29-292-1d to 29-292-9d, inclusive, of the Administrative Regulations of Connecticut State Agencies

- Adopts 1997 edition of NFPA 101 with Connecticut Amendments
- **2000 Connecticut Amendment to the 1999 Connecticut State Fire Safety Code (Effective April 7, 2000)**

2005 Connecticut State Fire Safety Code
(Effective December 31, 2005)

Added the The regulations of the Department of Public Safety, sections 29-292-1e to 29-292-25e, inclusive, *to* of the Regulations of Connecticut State Agencies

- The provisions of Part I, Part II and Part V of this code shall *all apply* to all occupancies and uses located within a building or structure. *were made applicable*
- *Adopted* Adopts 2003 edition of International Fire Code (IFC) with Connecticut Amendments as Part III for new construction, renovations, additions, or change of use built on or after December 31, 2005.
- *Adopted* Adopts 2003 edition of NFPA 101 with Connecticut Amendments as Part IV for existing construction built prior to December 31, 2005.
- *Adopted* Adopts 2003 edition of NFPA 1 with Connecticut Amendments as Part V for Maintenance and Operational Issues for all occupancies and uses located within buildings and structures.

2009 Connecticut Amendment to the 2005 Connecticut State Fire Safety Code
(Effective August 1, 2009)

- Changes and revisions made to the 2005 CSFSC.

2012 Connecticut Amendment to the 2005 Connecticut State Fire Safety Code
(Effective October 2, 2012)

- Part V was removed for maintenance and operational issues after the Connecticut State Fire Prevention Code was adopted *effective June 1, 2010.*

2016 Connecticut State Fire Safety Code
(Effective October 1, 2016)

- *Adopted* Adopts 2012 edition of International Fire Code (IFC) with Connecticut Amendments as Part III for new construction, renovations, additions, or change of use built on or after December 31, 2005.
- *Adopted* Adopts 2012 edition of NFPA 101 with Connecticut Amendments as Part IV for existing construction built prior to December 31, 2005.

2018 Connecticut State Fire Safety Code
(Effective October 1, 2018)

- *Adopted* Adopts 2015 edition of International Fire Code (IFC) with Connecticut Amendments as Part III for new construction, renovations, or change of use built on or after December 31, 2005.

- ~~Adopts~~ 2015 edition of NFPA 101 with Connecticut Amendments as Part IV for existing construction built prior to December 31, 2005.

2022 Connecticut State Fire Safety Code

(Effective October 1, 2022)

- ~~Adopts~~ 2021 edition of International Fire Code (IFC) with Connecticut Amendments as Part III for new construction, renovations, additions, or change of use built on or after January 1, 2006.
- ~~Adopts~~ 2021 edition of NFPA 101 with Connecticut Amendments as Part IV for existing construction built prior to January 1, 2006.
- ***Effective April 12, 2023, errata and revisions were issued for the 2022 Connecticut State Fire Safety Code***

The Office of the State Fire Marshal and the Connecticut State Library have copies of all editions for review.

A P P E N D I X B FIRE-FLOW REQUIREMENTS FOR BUILDINGS

This Appendix is permitted to be used as guidance by the State of Connecticut.

A P P E N D I X C FIRE HYDRANT LOCATIONS AND DISTRIBUTION

un-bol
(Del) **Delete Appendix.**

A P P E N D I X D
FIRE APPARATUS ACCESS ROADS

This Appendix is adopted by the State of Connecticut.

(Amd) **D105.1 Where required.** Where the vertical distance between the *grade plane* and the highest roof surface exceeds 30 feet (9144 mm), *approved* aerial fire apparatus access roads shall be provided. For purposes of this section, the highest roof surface shall be determined by measurement to the eave of a pitched roof, the intersection of the roof to the *exterior wall*, or the top of parapet walls, whichever is greater.

Exception: Where *approved* by the *fire code official*, *high rise buildings* of Type IA, Type IB or Type IIA construction equipped throughout with an *automatic sprinkler system* in accordance with Section 903.3.1.1 and having firefighter access through an enclosed *stairway* with a Class I standpipe from the lowest level of fire department vehicle access to all roof surfaces.

bold
(Del) ~~SECTION D107~~ **ONE- OR TWO-FAMILY RESIDENTIAL DEVELOPMENTS** *un-bold*
Delete section in its entirety.

A P P E N D I X E
HAZARD CATEGORIES

This Appendix is permitted to be used as guidance by the State of Connecticut.

A P P E N D I X F
HAZARD RANKING

This Appendix is permitted to be used as guidance by the State of Connecticut.

A P P E N D I X G
CRYOGENIC FLUIDS – WEIGHT AND VOLUME EQUIVALENTS

This Appendix is permitted to be used as guidance by the State of Connecticut.

A P P E N D I X H
HAZARDOUS MATERIALS MANAGEMENT PLAN (HMMP) AND HAZARDOUS MATERIALS INVENTORY STATEMENT (HMIS) INSTRUCTIONS

This Appendix is permitted to be used as guidance by the State of Connecticut.

ALL-CAPS

(Add) SECTION H100
Reference to Connecticut General Statutes

(Add) H100.1 Manufacturing establishments. Manufacturing establishments, as defined in section 29-307a of the Connecticut General Statutes, shall comply with the reporting requirements found in section 29-307a of the Connecticut General Statutes.

A
notice
provision

A P P E N D I X I
FIRE PROTECTION SYSTEMS – NONCOMPLIANT CONDITIONS

This Appendix is adopted by the State of Connecticut.

A P P E N D I X J
BUILDING INFORMATION SIGN

This Appendix is adopted by the State of Connecticut.

(Amd) J101.1.4 Sign size and lettering. The minimum size of the building information sign and lettering shall be in accordance with the following:

1. The width and height shall be 6 inches by 6 inches (152 mm by 152 mm).
2. The height or width of each Maltese cross wing area shall be 1-1/4 inches (32 mm) and have a stroke width of 1/2 inch (12.7 mm).
3. The center of the Maltese cross, a circle or oval, shall be 3 inches (76 mm) in diameter and have a stroke width of 1/2 inch (12.7 mm).
4. All Roman numerals and alphabetic designations shall be 1-1/8 inches (29 mm) in height and have a stroke width of 1/4 inch (6.4 mm).

A P P E N D I X K
CONSTRUCTION REQUIREMENTS FOR EXISTING AMBULATORY CARE FACILITIES

un-bold
(Del) Delete Appendix.

APPENDIX L
REQUIREMENTS FOR FIREFIGHTER AIR REPLENISHMENT SYSTEMS

(Del) ~~Delete Appendix.~~

un-bolt

APPENDIX M
HIGH-RISE BUILDINGS – RETROACTIVE AUTOMATIC SPRINKLER
REQUIREMENT

(Del) ~~Delete Appendix.~~

APPENDIX N
INDOOR TRADE SHOWS AND EXHIBITIONS

This Appendix is adopted by the State of Connecticut as amended.

(Amd) **N106.1 Automatic sprinkler systems.** An *approved automatic sprinkler system* in accordance with Section 903.3.1.1 of this code shall be provided in covered booths exceeding 400 square feet (37 m²) in floor area per level.

(Amd) **N106.2 Fire alarm and detection.** Each covered booth with a floor area exceeding 400 square feet (37 m²) on any level shall be provided with an *approved fire alarm system* in accordance with Section 907.2.

APPENDIX O
VALET TRASH AND RECYCLING COLLECTION IN GROUP R-2 OCCUPANCIES

This Appendix is adopted by the State of Connecticut.

(Amd) **O102.4 Capacity and limit.** Individual containers shall not exceed 2.0 cubic feet (15 gallons; 56.8 L) in capacity. Only one trash or recycling container per *dwelling unit* or sleeping unit shall be permitted to be placed outside the dwelling unit or sleeping unit at one time. Trash and recycling containers shall not be placed outside a *dwelling unit* or sleeping unit at the same time.

Exception: Individual containers placed within non-combustible exterior egress balconies are permitted to not exceed 2.94 cubic feet (22 gallons; 95 L) in capacity.

83

(Amd) **O102.5 Construction materials.** Containers and lids used for valet trash collections shall be constructed entirely of noncombustible materials or of materials that

meet a peak rate of heat release not exceeding 300 kW/m² when tested in accordance with ASTM E1354 at an incident heat flux of 50 kW/m² in the horizontal orientation.

Exceptions: Containers on egress balconies in buildings with noncombustible or limited combustible exteriors and protected throughout with an *automatic sprinkler system* complying with Section 903.

(Add) **O103.4 Single Exit Buildings.** Containers shall not be permitted within Group R-2 occupancies that contain a single exit designed in accordance with Section 1006.3.4.

initial cap only, spacing
(ADD) APPENDIX S

GROUP R-2 – TRIPLEX AND QUADRUPLEX PROVISIONS

This Appendix is adopted by the State of Connecticut.

User notes: *un-bald*

About this appendix: *This appendix provides for the design and construction of triplexes and quadruplexes that are unique to this appendix, where otherwise not permitted in other sections of the main code as an alternative to two- and multiple-family residential construction that promotes increased housing supply and affordability.*

**SECTION S101
GENERAL**

S101.1 General. Where provided in Group R occupancies, *triplexes and quadruplexes* shall comply with the provisions of this code, except as modified by this appendix. *Triplexes and quadruplexes* shall be in accordance with this appendix, other applicable requirements in this code, and the *International Building Code* portion of the Connecticut State Building Code.

S101.2 [IRC R101.2] Scope. The provisions of this appendix shall apply to the construction, *alteration*, movement, enlargement, replacement, *repair, equipment*, use and occupancy, location, removal and demolition of detached *three- and four-family dwellings*, that are not *townhouses*, not more than three stories above grade plane in height with a separate *means of egress* and their *accessory structures* not more than three stories above grade plane in height.

Exceptions:

1. Live/work units in three- and four-family dwellings, that provide professional

services and employ a maximum of one employee within the dwelling in addition to the residents of the ~~dwelling~~ unit, shall be permitted to comply with the requirements of this code.

live/work

S101.3 Reserved.

S101.4 Reserved.

SECTION S102 DEFINITIONS

S102.1 Definitions. The following words and terms shall, for the purposes of this appendix, have the meanings shown herein:

DWELLING, THREE-FAMILY (TRIPLEX). A detached structure ~~on a single lot~~, other than a *townhouse*, with common walls or common floor/ceiling between the ~~units~~, designed for and occupied exclusively as the residence of ~~not more than three (3) dwelling units with~~ not more than six lodgers or boarders per *dwelling unit*.

not more than three dwelling

DWELLING, FOUR-FAMILY (QUADRUPLEX). A detached structure (on a single lot), other than a *townhouse*, with common walls or common floor/ceiling between the ~~units~~, designed for and occupied exclusively as the residence of ~~not more than four (4) dwelling units with~~ not more than six lodgers or boarders per *dwelling unit*.

not more than four dwelling

TRIPLEX. See "*Dwelling, three-family*."

QUADRUPLEX. See "*Dwelling, four-family*."

SECTION S103 FIRE AND SMOKE PROTECTION FEATURES

S103.1 [IRC R302.1] Exterior walls. Construction, projections, openings and penetrations of exterior walls of *dwelling*s and accessory buildings shall comply with Table S103.1(1) of this appendix based on *fire separation distance*; or *dwelling*s equipped throughout with an *automatic sprinkler system* installed in accordance with Section 903.3.1 of this code shall comply with S103.1(2) of this appendix based on *fire separation distance*.

Table

For the purposes of determining *fire separation distance*, *dwelling*s on the same *lot* shall be assumed to have an imaginary line between them. Where a new *dwelling* is to be erected on the same *lot* as an existing *dwelling*, the location of the assumed imaginary line with relation to the existing *dwelling* shall be such that the existing *dwelling* meets

requirements of this section.

Exceptions:

1. Walls, projections, openings or penetrations in walls perpendicular to the line used to determine the *fire separation distance*.
2. Walls of *individual dwelling units* and their *accessory* buildings located on the same *lot*.
3. Detached tool sheds and storage sheds, playhouses and similar structures exempted from *permits* are not required to provide wall protection based on location on the *lot*. Projections beyond the exterior wall shall not extend over the *lot line*.
4. Detached garages accessory to a *dwelling unit* located within 2 feet (610 mm) of a *lot line* are permitted to have roof eave projections not exceeding 4 inches (102 mm).
5. Foundation vents installed in compliance with this code are permitted.

TABLE S103.1(1) [IRC R302.1(1)] EXTERIOR WALLS

EXTERIOR ELEMENT	WALL	MINIMUM FIRE-RESISTANCE RATING	MINIMUM FIRE SEPARATION DISTANCE
Walls	Fire-resistance rated	1 hour— tested in accordance with ASTM E119, UL 263 or Section 703.2.2 of <u>this code</u> with exposure from both sides	0 feet
	Not fire-resistance rated	0 hours	≥ 5 feet
Projections	Not allowed	NA	< 2 feet
	Fire-resistance rated	1 hour on the underside, or heavy timber, or fire-retardant-treated wood ^{a, b}	≥ 2 feet to < 5 feet
	Not fire-resistance rated	0 hours	≥ 5 feet
Openings in	Not allowed	NA	< 3 feet

→ the International Building Code portion of the Connecticut State Building Code

walls	25% maximum of wall area	0 hours	3 feet
	Unlimited	0 hours	5 feet
Penetrations	All	Comply with Section 714 of <u>this code</u>	< 3 feet
		None required	3 feet
Projections	Not allowed	NA	< 2 feet
	Fire-resistance rated	1 hour on the underside, or heavy timber, or fire-retardant-treated wood^{a, b}	≥ 2 feet to < 5 feet
	Not fire-resistance rated	0 hours	≥ 5 feet

the International Residential Code portion of the Connecticut State Building Code

duplicative of above

For SI: 1 foot = 304.8 mm.

NA = Not Applicable.

- a. The fire-resistance rating shall be permitted to be reduced to 0 hours on the underside of the eave overhang if fire blocking is provided from the wall top plate to the underside of the roof sheathing.
- b. The fire-resistance rating shall be permitted to be reduced to 0 hours on the underside of the rake overhang where vent openings that communicate with the attic are not installed in the overhang or gable wall.

TABLE S103.1(2) [IRC R302.1(2)] EXTERIOR WALLS—DWELLINGS WITH AN AUTOMATIC SPRINKLER SYSTEM

EXTERIOR WALL ELEMENT		MINIMUM FIRE-RESISTANCE RATING	MINIMUM FIRE SEPARATION DISTANCE
Walls	Fire-resistance rated	1 hour—tested in accordance with ASTM E119, UL 263 or Section 703.2.2 of <u>this code</u> with exposure from the outside	0 feet
	Not fire-resistance rated	0 hours	3 feet ^a

the International Building Code portion of the Connecticut State Building Code

Projections	Not allowed	NA	< 2 feet
	Fire-resistance rated	1 hour on the underside, or heavy timber, or fire-retardant-treated wood ^{b, c}	2 feet ^a
	Not fire-resistance rated	0 hours	3 feet
Openings in walls	Not allowed	NA	< 3 feet
	Unlimited	0 hours	3 feet ^a
Penetrations	All	Comply with Section 714 of this code ¹	< 3 feet
		None required	3 feet ^a

the International Residential Code portion of the Connecticut State Building Code

For SI: 1 foot = 304.8 mm.

NA = Not Applicable.

a. For residential subdivisions where all dwellings are equipped throughout with an *automatic sprinkler system* installed in accordance with Section 903.3.1 of this code, the fire separation distance for exterior walls not fire-resistance rated and for fire-resistance-rated projections shall be permitted to be reduced to 0 feet, and unlimited unprotected openings and penetrations shall be permitted, where the adjoining lot provides an open setback yard that is 6 feet or more in width on the opposite side of the property line.

b. The fire-resistance rating shall be permitted to be reduced to 0 hours on the underside of the eave overhang if fire blocking is provided from the wall top plate to the underside of the roof sheathing.

c. The fire-resistance rating shall be permitted to be reduced to 0 hours on the underside of the rake overhang where vent openings that communicate with the attic are not installed in the overhang or gable wall.

S103.2 [IRC R302.3] Three and four-family dwellings.

Dwelling units in three and four-family dwellings shall be separated from each other in accordance with Sections S103.2.1 through S103.3.4 of this appendix, regardless of whether a lot line exists between *dwelling units*.

S103.2.1 [IRC R302.3.1] Dwelling unit separation. The *dwelling units* shall be separated by fire-resistance rated assemblies that are vertical, horizontal, or a combination thereof.

S103.2.2 [R302.3.2] Fire-resistance rating. Vertical and horizontal assemblies

separating *dwelling units* shall have a fire-resistance rating of 1-hour, or a fire-resistance rating of one-half hour in buildings equipped throughout with an *automatic sprinkler system* installed in accordance with Section 903.3.1 of this code. Fire-resistance ratings shall be based on testing in accordance with ASTM E119 or UL 263, or an analytical method in accordance with Section 703.2.2 of the *International Building Code* portion of the Connecticut State Building Code.

S103.2.3 [R302.3.3] Continuity. Vertical and horizontal assemblies separating *dwelling units* shall be constructed in a manner that provides continuity of the fire-resistance rating between the *dwelling units*.

S103.2.3.1 [R302.3.3.1] Horizontal assemblies. Horizontal assemblies separating *dwelling units* shall extend to and be tight against exterior walls or vertical separation assemblies complying with Section S103.2.2 of this appendix.

S103.2.3.2 [R302.3.3.2] Vertical assemblies. Vertical assemblies separating *dwelling units* shall extend to and be tight against any combination of the following:

1. The foundation.
2. A horizontal assembly complying with Section S103.2.3 of this appendix.
3. The underside of roof sheathing.
4. The ceiling beneath an uninhabitable *attic*, provided that the ceiling is constructed using not less than $\frac{5}{8}$ -inch (15.9 mm) *Type X gypsum board*, an *attic draft stop* constructed as specified in Section 708.4.3 of the *International Building Code* portion of the Connecticut State Building Code is provided above and along the vertical assembly terminating at the ceiling, and the structural framing supporting the ceiling is protected by not less than $\frac{1}{2}$ -inch (12.7 mm) gypsum board or equivalent.

S103.2.4 [R302.3.4] Supporting construction. Vertical and horizontal assemblies separating *dwelling units* shall be supported by construction having an equal or greater fire-resistance rating.

S103.2.5 [R302.3.5] Vertically stacked dwelling units. Where *dwelling units* in three ~~or~~ and four-family dwellings is located above the other and an *automatic sprinkler system* complying with NFPA 13 is not provided in both *dwelling units*, both of the following shall apply:

1. Horizontal and vertical assemblies separating the *dwelling units*, including an interior *stairway* serving as the *means of egress* for the upper *dwelling unit*, shall have a fire-resistance rating of 1-hour based on testing in accordance with ASTM

E119 or UL 263, or an analytical method in accordance with Section 703.2.2 ^{of} the *International Building Code* portion of the Connecticut State Building Code.

2. A notification appliance connected to smoke alarms in the other *dwelling unit* shall be provided in each *dwelling unit*.

S103.3 [R302.3.6] Shared accessory areas. Shared accessory areas or spaces shall be separated from each individual *dwelling unit* by fire-resistance rated assemblies that are vertical, horizontal, or a combination thereof having not less than a 1-hour *fire-resistance rating* based on testing in accordance with ASTM E119, UL 263 or an analytical method in accordance with Section 703.2.2 of the *International Building Code* portion of the Connecticut State Building Code. Openings and penetrations between the shared common area and *dwelling unit* shall comply with Sections S103.3.6.1, S103.3.2, and S103.3.3 of this appendix.

S103.3.1 [R302.3.6.1] Opening protection. Openings from ^{or} a shared accessory ^{areas or} spaces ~~or area~~ directly into a room used for sleeping purposes shall not be permitted. Other openings between the shared accessory ^{areas} spaces ~~or area~~ and dwelling units shall be provided with a fire door assembly in accordance with Section 716 of the *International Building Code* portion of the Connecticut State Building Code.

S103.3.2 [R302.3.6.2] Duct penetration. Ducts penetrating the walls or ceilings separating the dwelling from the shared accessory ^{area or space} room shall be constructed of sheet steel not less than No. 26 gage (0.48 mm) or other *approved* material and shall not have openings into the shared accessory room.

S103.3.3 [R302.3.6.3] Other penetrations. Penetrations through the walls, ceiling and floor-level separation required in Section S103.3 shall be protected as required by Section 714 of the *International Building Code* portion of the Connecticut State Building Code.

S103.4 [IRC R302.6] Dwelling unit garage fire separation. The garage shall be separated as required by Table S103.4(1) except that wood structural members of the minimum dimension specified in the *International Building Code* portion of the Connecticut State Building Code for Type IV-HT construction shall be acceptable without further protection. Openings in garage walls shall comply with Section 406.3.2 of the *International Building Code* portion of the Connecticut State Building Code. Attachment of *gypsum board* shall comply with Table S103.4(2) of this appendix. The wall separation provisions of Table S103.4 of this appendix shall not apply to garage walls that are perpendicular to the adjacent *dwelling unit* wall.

"dwelling unit"?

TABLE S103.4(1) [IRC R302.6] DWELLING UNIT GARAGE SEPARATION

SEPARATION	MATERIAL
From the residence and attics	Not less than 5/8 inch Type X gypsum board or equivalent applied to the garage side ^a
From all habitable rooms above the garage	Not less than 5/8 inch Type X gypsum board or equivalent
Structure(s) supporting floor/ceiling assemblies used for separation required by this section	Not less than 5/8 inch Type X gypsum board or equivalent ^a
Garages located less than 3 feet from a dwelling unit on the same lot	Not less than 5/8 inch Type X gypsum board or equivalent applied to the interior side of exterior walls that are within this area ^a

For SI: 1 inch = 25.4 mm, 1 foot = 304.8 mm.

^a. If building is sprinklered in accordance with Section 903.3.1.1 or Section 903.3.1.2 of this code, then not less than 1/2-inch gypsum board or equivalent is required.

TABLE S103.4(2) [R702.3.5] MINIMUM THICKNESS AND APPLICATION OF GYPSUM BOARD AND GYPSUM PANEL PRODUCTS

THICKNESS OF GYPSUM BOARD OR GYPSUM PANEL PRODUCTS (inches)	APPLICATION	ORIENTATION OF GYPSUM BOARD OR GYPSUM PANEL PRODUCTS TO FRAMING	MAXIMUM SPACING OF FRAMING MEMBERS (inches o.c.)	MAXIMUM SPACING OF FASTENERS (inches)		SIZE OF NAILS FOR APPLICATION TO WOOD FRAMING ^c
				Nails ^a	Screws ^b	
Application without adhesive						
3/8	Ceiling ^d	Perpendicular	16	7	12	13 gage, 1 1/4" long, 19/64" head; 0.098" diameter, 1 1/4" long, ring shank; or 4d cooler
	Wall	Either direction	16	8	16	

						nail, 0.080" diameter, 1 ³ / ₈ " long, 7 ⁷ / ₃₂ " head.
1/2	Ceiling	Either direction	16	7	12	13 gage, 1 ³ / ₈ " long, 19 ¹⁹ / ₆₄ " head;
	Ceiling ^d	Perpendicular	24	7	12	0.098" diameter, 1 ¹ / ₄ " long, ring shank; 5d cooler nail, 0.086" diameter, 1 ⁵ / ₈ " long, 15 ¹⁵ / ₆₄ " head; or gypsum board nail, 0.086" diameter, 1 ⁵ / ₈ " long, 9 ⁹ / ₃₂ " head.
	Wall	Either direction	24	8	12	
5/8	Wall	Either direction	16	8	16	
	Ceiling	Either direction	16	7	12	13 gage, 1 ⁵ / ₈ " long, 19 ¹⁹ / ₆₄ " head;
	Ceiling	Perpendicular	24	7	12	0.098" diameter, 1 ³ / ₈ " long, ring shank; 6d cooler nail, 0.092" diameter, 1 ⁷ / ₈ " long, 1 ¹ / ₄ " head; or

						gypsum board nail, 0.0915" diameter, 1 ⁷ / ₈ " long, 1 ⁹ / ₆₄ " head.
Type X at garage ceiling beneath habitable rooms	Perpendicular	24	6	6		1 ⁷ / ₈ " long 0.099" diameter galvanized nails or equivalent drywall screws. Screws shall comply with Section S103.4.1.
Wall	Either direction	24	8	12		13 gage, 1 ⁵ / ₈ " long, 1 ⁹ / ₆₄ " head; 0.098" diameter, 1 ³ / ₈ " long, ring shank; 6d cooler nail, 0.092" diameter, 1 ⁷ / ₈ " long, 1 ⁴ / ₄ " head; or gypsum board nail, 0.0915" diameter, 1 ⁷ / ₈ " long, 1 ⁹ / ₆₄ " head.
Wall	Either direction	16	8	16		

Application with adhesive						
$\frac{3}{8}$	Ceiling ^d	Perpendicular	16	16	16	Same as above for $\frac{3}{8}$ " gypsum board and gypsum panel products.
	Wall	Either direction	16	16	24	
$\frac{1}{2}$ or $\frac{5}{8}$	Ceiling	Either direction	16	16	16	Same as above for $\frac{1}{2}$ " and $\frac{5}{8}$ " gypsum board and gypsum panel products, respectively.
	Ceiling ^d	Perpendicular	24	12	16	
	Wall	Either direction	24	16	24	
Two $\frac{3}{8}$ layers	Ceiling	Perpendicular	16	16	16	Base ply nailed as above for $\frac{1}{2}$ " gypsum board and gypsum panel products; face ply installed with adhesive.
	Wall	Either direction	24	24	24	

For SI: 1 inch = 25.4 mm.

a. For application without adhesive, a pair of nails spaced not less than 2 inches apart or more than $2\frac{1}{2}$ inches apart shall be permitted to be used with the pair of nails spaced 12 inches on center.

b. Screws shall be in accordance with Section S103.4.1 of this appendix. Screws for attaching gypsum board or gypsum panel products to structural insulated

panels shall penetrate the wood structural panel facing not less than $\frac{7}{16}$ inch.

c. Where cold-formed steel framing is used with a clinching design to receive nails by two edges of metal, the nails shall be not less than $\frac{5}{8}$ inch longer than the gypsum board or gypsum panel product thickness and shall have ringed shanks. Where the cold-formed steel framing has a nailing groove formed to receive the nails, the nails shall have barbed shanks or be 0.086-inch diameter, $1\frac{5}{8}$ inches long, $\frac{15}{64}$ -inch head for $\frac{1}{2}$ -inch gypsum board or gypsum panel product; and 0.099-inch diameter, $1\frac{7}{8}$ inches long, $\frac{15}{64}$ -inch head for $\frac{5}{8}$ -inch gypsum board or gypsum panel product.

d. Three-eighths-inch-thick single-ply gypsum board or gypsum panel product shall not be used on a ceiling where a water-based textured finish is to be applied, or where it will be required to support insulation above a ceiling. On ceiling applications to receive a water-based texture material, either hand or spray applied, the gypsum board or gypsum panel product shall be applied perpendicular to framing. Where applying a water-based texture material, the minimum gypsum board thickness shall be increased from $\frac{3}{8}$ inch to $\frac{1}{2}$ inch for 16-inch on center framing, and from $\frac{1}{2}$ inch to $\frac{5}{8}$ inch for 24-inch on center framing or $\frac{1}{2}$ -inch sag-resistant gypsum ceiling board shall be used.

S103.4.1 [R702.3.5.1] Screw fastening. Screws for attaching *gypsum board* and *gypsum panel products* to wood framing shall be Type W or Type S in accordance with ASTM C1002 and shall penetrate the wood not less than $\frac{5}{8}$ inch (15.9 mm). Gypsum board and *gypsum panel products* shall be attached to cold-formed steel framing with minimum No. 6 screws. Screws for attaching gypsum board and *gypsum panel products* to cold-formed steel framing less than 0.033 inch (1 mm) thick shall be Type S in accordance with ASTM C1002 or bugle head style in accordance with ASTM C1513 and shall penetrate the steel not less than $\frac{3}{8}$ inch (9.5 mm). Screws for attaching gypsum board and *gypsum panel products* to cold-formed steel framing 0.033 inch to 0.112 inch (1 mm to 3 mm) thick shall be in accordance with ASTM C954 or bugle head style in accordance with ASTM C1513. Screws for attaching *gypsum board* and *gypsum panel products* to *structural insulated panels* shall penetrate the wood structural panel facing not less than $\frac{7}{16}$ inch (11.1 mm).

SECTION S104 FIRE PROTECTION AND LIFE SAFETY SYSTEMS

S104.1 Automatic sprinkler systems. *Automatic sprinkler systems* shall comply with Section 903.2.8 of this code.

S104.2 Smoke alarms. *Smoke alarms* shall comply with this section.

Section S104 of
this appendix

S104.2.1 [IRC R310.2.2] Alterations, repairs and additions. ^{where} When alterations, repairs or additions requiring a permit occur, or when one or more sleeping rooms are added or created in existing dwellings, the entire dwelling unit shall be provided with smoke alarms located as required for new dwellings. ^{where} (see S104.3.1) ^{equipped}

Exceptions:

1. Work involving the exterior surfaces of dwellings, such as the replacement of roofing or siding, or the addition or replacement of windows or doors, or the addition of a porch or deck, are exempt from the requirements of this section.
2. Installation, alteration or repairs of plumbing, mechanical, or electrical systems are exempt from the requirements of this section.

S104.2.2 [IBC 907.2.11] New buildings. Listed single- and multiple-station smoke alarms complying with UL 217 shall be installed in accordance with Sections 907.2.11.1 through 907.2.11.7 of this code, NFA 72, and the manufacturer's instructions.

S104.3 Carbon monoxide alarms. Carbon monoxide alarms shall comply with this section. ^{to} ^{inclusive,} Section S104 of this appendix

S104.3.1 [IRC R311.2.2] Alterations, repairs and additions. Where alterations, repairs or additions requiring a permit occur, or where one or more sleeping rooms are added or created in existing dwellings, the individual dwelling unit shall be equipped with carbon monoxide alarms located as required for new dwellings. ^(? see S104.2.1)

Exceptions:

1. Work involving the exterior surfaces of dwellings, such as the replacement of roofing or siding, or the addition or replacement of windows or doors, or the addition of a porch or deck.
2. Installation, alteration or repairs of plumbing, mechanical, or electrical systems that are not fuel-fired.

S104.3.2 New buildings. Carbon monoxide detection shall be installed in accordance with Section 915 of this code.

**SECTION S105
RESERVED**

**SECTION S106
MEANS OF EGRESS**

The International Building Code portion of the Connecticut State Building Code

Section S106 of this appendix

*dwelling?
triplex/
quadplex?*

S106.1 [IRC R318.1] Means of egress. *Triplexes and quadruplexes* shall be provided with a means of egress in accordance with Chapter 10 of this code unless otherwise indicated in this section. The means of egress shall provide a continuous and unobstructed path of vertical and horizontal egress travel from all portions of the dwelling unit to the required egress or exit door without requiring travel through a garage. The required egress door shall open directly into a *public way* or to a yard or court that opens to a *public way*.

S106.2 [IRC R318.2] Egress door. Not less than one egress or exit door shall be provided for each *dwelling unit*. The egress door shall be side-hinged, and shall provide a clear width of not less than 32 inches (813 mm) where measured between the face of the door and the stop, with the door open 90 degrees (1.57 rad). The clear height of the door opening shall be not less than 78 inches (1981 mm) in height measured from the top of the threshold to the bottom of the stop. Other doors shall not be required to comply with these minimum dimensions. Egress doors shall be readily openable from inside the *dwelling unit* without the use of a key or special knowledge or effort.

S106.3 [IRC R318.7] Stairways. Where required by this code or provided, *stairways* shall comply with this section. — Section S106 of this appendix

Exceptions:

1. Stairways not within or serving a building, porch or deck.
2. Stairways leading to nonhabitable attics.
3. Stairways leading to *crawl spaces*.

S106.3.1 [IRC R318.7.1] Width. *Stairways* shall not be less than 36 inches (914 mm) in clear width at all points above the permitted *handrail* height and below the required headroom height. The clear width of stairways at and below the *handrail* height, including treads and landings, shall not be less than 29 inches where *handrails* are provided on both sides.

(737 mm)

Exceptions:

1. The width of spiral *stairways* shall be in accordance with Section 1011.10 of this code.
2. The width of existing *stairways* serving existing unfinished *attics* or existing unfinished *basements* being converted to *habitable space* or replacement *stairways* within existing *dwelling*s shall not be less than 32 inches (813 mm) in clear width at all points above the permitted *handrail* height and below the required headroom height. The clear width of stairways at and below the *handrail* height, including treads and landings, shall not be less than 28 inches

(711 mm) where a *handrail* is installed on one side and 24 inches (610 mm) where *handrails* are provided on both sides.

3. Where an incline platform lift or *stairway* chairlift is installed on a *stairway* within a *dwelling unit*, a clear passage width not less than 20 inches (508 mm) shall be provided. If the seat and platform can be folded when not in use, the distance shall be measured from the folded position.
4. *Flights of stairways* within *dwelling units* and *flights of spiral stairways* are permitted to have a *handrail* on one side only.
5. Where permitted to have one *handrail*, the clear width of *stairways* at and below the handrail height, including treads and landings, shall not be less than 32-1/2 inches (826 mm) where a *handrail* is installed on one side.

S106.3.2 [IRC R318.7.2] Headroom. The minimum headroom in all parts of the *stairway* shall not be less than 6 feet 8 inches (2032 mm) measured vertically from the sloped line adjoining the tread *nosing* or from the floor surface of the landing or platform on that portion of the *stairway*.

Exceptions:

1. Where the *nosing* of treads at the side of a *flight* extend under the edge of a floor opening through which the stair passes, the floor opening shall be allowed to project horizontally into the required headroom a maximum of 4 3/4 inches (121 mm).
2. The minimum headroom in all parts of existing *stairways* serving existing unfinished *attics* or existing unfinished *basements* being converted to *habitable space* or serving only one *dwelling unit* or replacement *stairs* where the pitch or slope cannot be reduced because of existing construction shall be 6 feet, 4 inches (1930 mm), measured in accordance with Section 1011.3 of this code.

S106.3.3 [IRC R318.7.3] Vertical rise. A flight of stairs shall not have a vertical rise greater than 12 feet 7 inches (3835 mm) between floor levels or landings.

S106.3.4 [R318.7.5] Stair treads and risers. *Stair treads and risers* shall meet the requirements of this section. For the purposes of this section, dimensions and dimensioned surfaces shall be exclusive of carpets, rugs or runners.

S106.3.4.1 [R318.7.5.1] Risers. The riser height shall be not more than 8 1/4 inches (209.5 mm). The riser shall be measured vertically between leading edges of adjacent treads. The greatest riser height within any *flight of stairs* shall not exceed the smallest by more than 3/8 inch (9.5 mm). Risers shall be vertical or sloped from the underside of

the *nosing* of the tread above at an angle not more than 30 degrees (0.51 rad) from the vertical. Open risers are permitted provided that the opening between treads does not permit the passage of a 4-inch-diameter (102 mm) sphere.

Exceptions:

1. The maximum riser height of *existing stairs* serving *existing unfinished attics* or *existing unfinished basements* being converted to *habitable space* or replacement *stairs* where the pitch or slope cannot be reduced because of existing construction shall be 9 inches (229 mm), measured in accordance with Section 1011.5.2 of this code.
2. The opening between adjacent treads is not limited on spiral stairways.
3. The riser height of spiral stairways shall be in accordance with Section 1011.10 of this code.

S106.3.4.2 [R318.7.5.2] Treads. The minimum tread depth shall be 9 inches (229 mm). The tread depth shall be measured horizontally between the vertical planes of the foremost projection of adjacent treads and at a right angle to the tread's leading edge. The greatest tread depth within any *flight of stairs* shall not exceed the smallest by more than $\frac{3}{8}$ inch (9.5 mm).

Exception: The minimum tread depth of existing stairs serving existing unfinished *attics* or existing unfinished *basements* being converted to *habitable space* or replacement stairs within *existing dwellings* shall be 8 inches (203 mm), measured in accordance with Section 1011.5.2 of this code.

S106.3.5 [R318.7.6] Landings for stairways. There shall be a floor or landing at the top and bottom of each stairway. The width perpendicular to the direction of travel shall be not less than the width of the flight served. For landings of shapes other than square or rectangular, the depth at the walk line and the total area shall be not less than that of a quarter circle with a radius equal to the required landing width. Where the stairway has a straight run, the depth in the direction of travel shall be not less than 36 inches (914 mm).

Exception: A floor or landing is not required at the top of an interior *flight of stairs*, including *stairs* in an enclosed garage, provided that a door does not swing over the *stairs*.

S106.4 [IRC R319.1] Emergency escape and rescue opening required. *Basements, habitable attics*, the room to which a sleeping loft is open, and every sleeping room shall have not less than one operable *emergency escape and rescue opening*. Where *basements* contain one or more sleeping rooms, an *emergency escape and rescue opening* shall be required in each sleeping room. *Emergency escape and rescue openings* shall open directly into a *public way*, or to a *yard* or *court* that opens to a *public*

way.

Exceptions:

1. Basements used only to house mechanical *equipment* not exceeding a total floor area of 200 square feet (18.58 m²).
2. Storm shelters constructed in accordance with ICC 500.
3. Where the dwelling *unit* is equipped with an *automatic sprinkler system* installed in accordance with Section 903.3.1 of this code, sleeping rooms in *basements* shall not be required to have *emergency escape and rescue openings* provided that the *basement* has one of the following:
 - 3.1. One means of egress complying with Chapter 10 of this code and one *emergency escape and rescue opening*.
 - 3.2. Two means of egress complying with Chapter 10 of this code.
4. A *yard* shall not be required to open directly into a *public way* where the *yard* opens to an unobstructed path from the *yard* to the *public way*. Such path shall have a width of not less than 36 inches (914 mm).

S106.4.1 [IRC R319.2.1] Minimum size. *Emergency escape and rescue openings shall have a net clear opening of not less than 5.7 square feet (0.530 m²).*

Exceptions:

1. *Grade floor openings* or below grade openings *shall* have a net clear opening of not less than 5 square feet (0.465 m²).
2. Existing *buildings* undergoing *alterations* or installation of replacement windows *shall* be permitted to utilize removable sashes to achieve the required minimum net clear openings. Such removable sashes *shall* be capable of being removed without the use of a key or tool.

S106.4.2 [IRC R319.2.2] Minimum dimensions. The minimum net clear opening height dimension shall be 24 inches (610 mm). The minimum net clear opening width dimension shall be 20 inches (508 mm). The net clear opening dimensions shall be the result of normal operation of the opening.

S106.5 [IBC 1015.8] Window openings. Windows in Group R-2 and R-3 *buildings* including *dwelling units*, where the bottom of the clear opening of an operable window is located less than 24 inches (610 mm) above the finished floor and more than 72 inches (1829 mm) above the finished grade or other surface below on the exterior of the *building*, shall comply with one of the following:

1. Operable windows where the openings will not allow a 4-inch-diameter (102 mm) sphere to pass through the opening when the window is in its largest opened position, provided that the opening is not required for emergency escape or rescue.
2. Operable windows where the openings are provided with window fall prevention devices that comply with ASTM F2090.
3. Operable windows where the openings are provided with window opening control devices that comply with ASTM F2090. The window opening control device, after operation to release the control device allowing the window to fully open, shall not reduce the minimum net clear opening area of the window unit to less than the area required by Section 1031.3.1 of this code for *emergency escape and rescue openings*.

**SECTION S107
RESERVED**

**SECTION S108
INTERIOR ENVIRONMENT**

S108.1 Reserved.

S108.2 [IRC R313.1] Minimum height. *Habitable space, hallways and portions of basements containing these spaces shall have a ceiling height of not less than 7 feet (2134 mm). Bathrooms, toilet rooms and laundry rooms shall have a ceiling height of not less than 6 feet 8 inches (2032 mm). Existing basements being converted to habitable space shall have a ceiling height of not less than 6 feet 8 inches (2032 mm).*

Exceptions:

1. For rooms with sloped ceilings, the required floor area of the room shall have a ceiling height of not less than 5 feet (1524 mm) and not less than 50 percent of the required floor area shall have a ceiling height of not less than 7 feet (2134 mm).
2. The ceiling height above bathroom and toilet room fixtures shall be such that the fixture is capable of being used for its intended purpose. A shower or tub equipped with a showerhead shall have a ceiling height of not less than 6 feet 8 inches (2032 mm) above an area of not less than 30 inches (762 mm) by 30 inches (762 mm) at the showerhead.
3. Beams, girders, ducts or other obstructions in *basements* containing *habitable space* shall be permitted to project to within 6 feet 4 inches (1931 mm) of the finished floor.
4. Beams and girders spaced apart not less than 36 inches (914 mm) in clear finished

width shall have a ceiling height of not less than 6 feet 6 inches (1981 mm) from the finished floor.

S108.4 [R316.1] Habitable attics. Habitable attics shall comply with Sections S108.4.1 and S108.4.2 of this code.

S108.4.1 [R316.2] Minimum dimensions. A *habitable attic* shall have a floor area in accordance with Section 1208.1 of the *International Building Code* portion of the Connecticut State Building Code and a *ceiling height* in accordance with Section 1208.2 of the *International Building Code* portion of the Connecticut State Building Code.

S108.4.2 [R316.3] Story above grade plane. A *habitable attic* shall be considered a *story above grade plane*.

Exceptions: A *habitable attic* shall not be considered to be a *story above grade plane* provided that the *habitable attic* meets all the following:

1. The aggregate area of the *habitable attic* is either of the following:
 - 1.1. Not greater than one-third of the floor area of the *story* below.
 - 1.2. Not greater than one-half of the floor area of the *story* below where the *habitable attic* is located within a *dwelling unit* equipped with an *automatic sprinkler system* in accordance with Section 903.3.1 of this code.
2. The occupiable space is enclosed by the *roof assembly* above, knee walls, if applicable, on the sides and the floor-ceiling assembly below.
3. The floor of the *habitable attic* does not extend beyond the exterior walls of the *story* below.
4. Where a *habitable attic* is located above a third story, an *automatic sprinkler system* in accordance with Section 903.3.1 of this code shall be installed in the *habitable attic* and remaining portion of the *dwelling unit* or units located beneath the *habitable attic*.

S108.4.3 [R316.4] Means of egress. The means of egress for habitable attics shall comply with the applicable provisions of Chapter 10 of this code.

**SECTION S109
RESERVED**